

SECTION 00 91 11

ADDENDUM NUMBER 2

PARTICULARS

- 1.01 DATE: NOVEMBER 23, 2020**
- 1.02 PROJECT: ELMORE SPORTS MEDICINE RENOVATIONS**
- 1.03 PROJECT NUMBER: DCM NO. 2020452**
- 1.04 OWNER: ALABAMA A&M UNIVERSITY**
- 1.05 ARCHITECT: NOLA | VAN PEURSEM ARCHITECTS, PC**

TO PROSPECTIVE BIDDERS

- 2.01 THIS ADDENDUM FORMS A PART OF THE CONTRACT DOCUMENTS AND MODIFIES THE BIDDING DOCUMENTS DATED SEPTEMBER 3, 2020, WITH AMENDMENTS AND ADDITIONS NOTED BELOW.**
- 2.02 ACKNOWLEDGE RECEIPT OF THIS ADDENDUM IN THE SPACE PROVIDED IN THE PROPOSAL FORM. FAILURE TO DO SO MAY DISQUALIFY THE BIDDER.**
- 2.03 THIS ADDENDUM CONSISTS OF 9 PAGES.**

CHANGES TO THE PROJECT MANUAL

3.02 SECTION 00 22 00-OWNER'S SUPPLEMENTARY INSTRUCTIONS TO BIDDERS:

- A. Add Paragraph 1.03.E to read as follows:
 - E. Pre-Qualification of General Contractors is required for this project. An Advertisement for Pre-Qualification was published on October 16, 2020, October 21, 2020, and October 28, 2020 for Elmore Sports Medicine Renovations in accordance with Code of Alabama Public Works Law. As a result, the following General Contractors have been pre-qualified for the project:
 - Baggette Construction, Inc.
 - Boyett Construction Company, Inc.
 - Carmon Construction Company, Inc.
 - Consolidated Construction Co of Ala
 - Dunlap Contracting, Inc.
 - Garber Construction Company, Inc.
 - Highland Wake Construction, LLC
 - Lee Builders, Inc.
 - Provision Contracting Services, LLC

CHANGES TO THE DRAWINGS

4.01 SHEET A-0.1 – LIFE SAFETY PLAN:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Added U.L. Design #U419
 - 2. Added U.L. Design #L556
 - 3. Added U.L. Design #L524

4.02 SHEET A-1.1 – DEMOLITION PLAN:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Added hatch to area of existing terrazzo to be removed and replaced.

4.03 SHEET A-1.2 – RENOVATION PLAN:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Added additional dimensions to Partial Mezzanine Plan.
 - 2. Revised tags referencing sheet A-9.2 to reference A-9.1.
 - 3. Added enlarged plan tag 5/A-6.1 for enlarged laundry room.
 - 4. Added mechanical platform plan.

4.04 SHEET A-3.2 – BUILDING SECTIONS & INTERIOR ELEVATIONS:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Added acoustical ceiling to portion of sports medicine training area.
 - 2. Added attachment note to typical steel ladder detail.

4.05 SHEET A-3.3 – BUILDING SECTIONS:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Revised elevator pit ladder width.
 - 2. Added high ceiling at elevator section 2/A-3.3.
 - 3. Added new terrazzo detail note.



4.06 SHEET A-5.1 – DOOR SCHEDULE & DETAILS:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Added reflected ceiling plan.

4.07 SHEET A-6.1 – FINISH FLOOR SCHEDULE & ENLARGED RESTROOMS:

- A. Replace this sheet in its entirety. Revisions include the following:
 - 1. Added enlarged laundry plan and elevations.
 - 2. Added floor finish plan mezzanine.
 - 3. Added floor finish plan lobby.

END OF ADDENDUM NUMBER 2

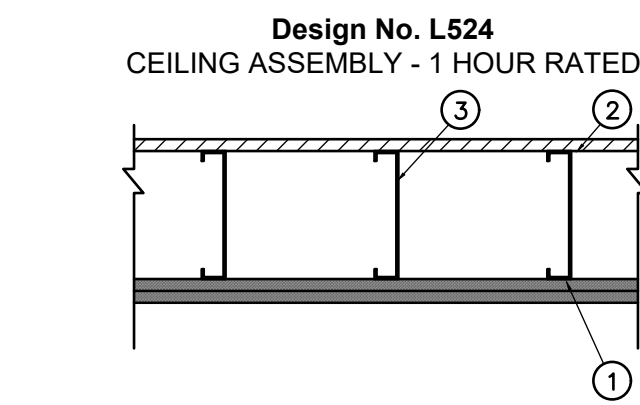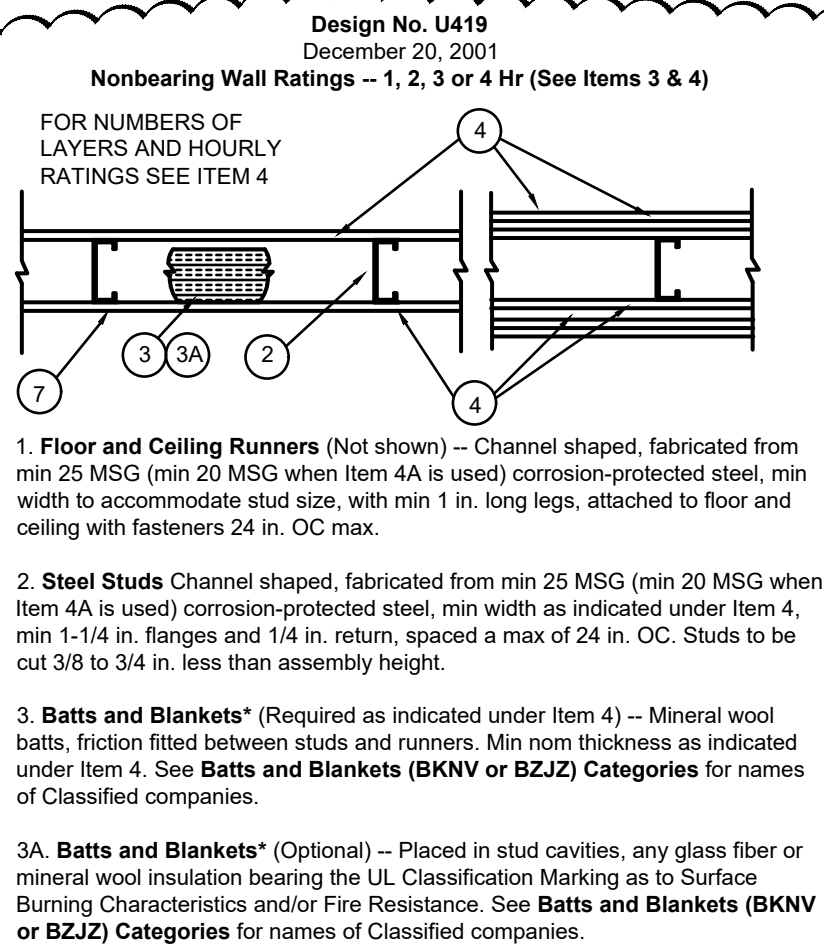

- Finish Ceiling** - Base layer - 3/4" proprietary type X gypsum wallboard applied at right angles to channel with 1" Type S-12 drywall screws 8" o.c. at butt joints and 12" o.c. at intermediate joists. Face layer - 3/4" proprietary type X gypsum wallboard applied at right angles to joists with 1 1/2" Type G drywall screws at butt joints between joists and 18" Type S-12 drywall screws 12" o.c. at intermediate joists, joints offset from base layer joints.
- Subflooring** - 3/4" T&G plywood floor applied at right angles to joists 18" o.c. 6-20 S-12 point screws 8" o.c. at floor perimeter and end joints and 10" o.c. at intermediate joists.
- Steel Channel Joists** - 7" deep, 18 gauge steel "C" shaped joists spaced 24" o.c.

U.L. DESIGN #L524
A-0.1 NOT TO SCALE

Wallboard Protection on Each Side of Wall

Rating	Min Stud Depth	No. of Layers & Thins of Panel	Min Thins of Insulation (Item 3)
1	3-1/2"	1 layer, 5/8 in. thick	1-1/2 in.
2	2-1/2"	1 layer, 1/2 in. thick	Optional
2	1-5/8"	1 layer, 3/4 in. thick	Optional
2	1-5/8"	2 layers, 1/2 in. thick	Optional
2	1-5/8"	2 layers, 5/8 in. thick	Optional
3	3-1/2"	1 layer, 5/8 in. thick	3 in.
3	1-5/8"	1 layer, 1/2 in. thick	Optional
3	1-5/8"	2 layers, 3/4 in. thick	Optional
3	1-5/8"	2 layers, 5/8 in. thick	Optional
4	1-5/8"	4 layers, 5/8 in. thick	Optional
4	1-5/8"	4 layers, 1/2 in. thick	Optional
4	2-1/2"	2 layers, 3/4 in. thick	2 in.

CANADIAN GYPSUM COMPANY - 1/2 in. thick Type C, IP-X2 or IPC-AR, WRC, 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SDX, SHX, WRX or WRC; 3/4 in. thick Type IP-X3, ULTRACODE, ULTRACODE SHC or ULTRACODE WRC.

UNITED STATES GYPSUM CO - 1/2 in. thick Type C, IP-X2, IPC-AR or WRC; 5/8 in. thick Type SDX, SHX, WRX, IP-X1, AR, C, WRC, FRX-G, IP-AR, IP-X2, IPC-AR, 3/4 in. thick Type IP-X3, ULTRACODE, ULTRACODE SHC or ULTRACODE WRC.

USG MEXICO S A DE C V - 1/2 in. thick Type C, IP-X2, IPC-AR or WRC; 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SDX, SHX, WRX or 3/4 in. thick Type IP-X3, ULTRACODE, ULTRACODE SHC or ULTRACODE WRC.

4A. **Gypsum Board** (As an alternate to Item 4) - 5/8 in. thick gypsum panels, installed as described in Item 4 with Type S-12 steel screws. The length and spacing of the screws as specified under Item 5.

CANADIAN GYPSUM COMPANY - Type FRX

UNITED STATES GYPSUM CO - Type FRX

4B. **Gypsum Board** (As an alternate to Items 4 and 4A) - 5/8 in. thick, 2 ft. wide, tongue and groove edge, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 5. Joint covering (Item 7) not required.

CANADIAN GYPSUM COMPANY - Type SHX

UNITED STATES GYPSUM CO - Type SHX

USG MEXICO S A DE C V - Type SHX

5. **Fasteners** (Not shown) - Type S or S-12 steel screws used to attach panels to studs (Item 2) or furring channels (Item 6). Single layer systems: 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 8 in. O.C. when panels are applied horizontally, or 8 in. O.C. along vertical and bottom edges and 12 in. O.C. in the field when panels are applied vertically. Two layer systems: First layer: 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 16 in. O.C. Second layer: 1-5/8 in. long for 1/2 in. 5/8 in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. O.C. with screws offset 8 in. from first layer. Three-layer systems: First layer: 1 in. long for 1/2 in. 5/8 in. thick panels, spaced 24 in. O.C. Second layer: 1-5/8 in. long for 1/2 in. 5/8 in. thick panels, spaced 24 in. O.C. Third layer: 2-1/4 in. long for 1/2 in. 5/8 in. thick panels, spaced 24 in. O.C. Screws offset min 6 in. from layer below. Four-layer systems: First layer: 1 in. long for 1/2 in. 5/8 in. thick panels, spaced 24 in. O.C. Second layer: 1-5/8 in. long for 1/2 in. 5/8 in. thick panels, spaced 24 in. O.C. Third layer: 2-1/4 in. long for 1/2 in. 5/8 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels, spaced 24 in. O.C. Fourth layer: 2-5/8 in. long for 1/2 in. thick panels or 3 in. long for 5/8 in. thick panels, spaced 12 in. O.C. Screws offset min 6 in. from layer below.

6. **Furring Channels** (Optional, not shown, for single or double layer systems) - Resilient furring channels fabricated from min 25 MSG corrosion-protected steel, spaced vertically a max of 24 in. O.C. Flange portion attached to each intersecting stud with 1/2 in. long Type S-12 steel screws. Not for use with Item 4A.


7. **Joint Tape and Compound** (Optional, not shown) - A bead of premixed joint compound applied in two coats to joints and screw heads of outer layers. Paper tape, nom 2 in. wide, embedded in first layer of compound over all joints of outer layer panels. Paper tape and joint compound may be omitted when gypsum panels are supplied with a square edge.

8. **Siding, Brick or Stucco** (Optional, not shown) - Aluminum, vinyl or steel siding, brick veneer or stucco, meeting the requirements of local code agencies, installed over gypsum panels. Brick veneer attached to studs with corrugated metal wall ties attached to each stud with steel screws, not more than each sixth course of brick.

9. **CaULKing and Sealants** (Optional, not shown) - A bead of acoustical sealant applied around the partition perimeter for sound control.


UNITED STATES GYPSUM CO - Type AS

*Bearing the U.L. Classification Mark

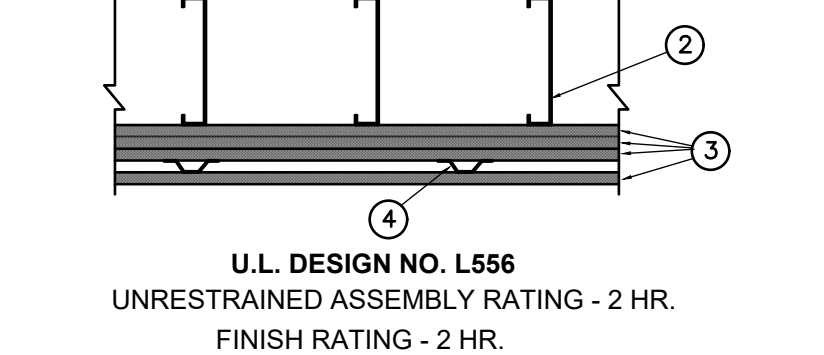

- Flooring System** - Subflooring - Min 3/4" in. thick wood structural panels, min grade "Underlayment" or "Single Floor". Plywood or panels secured to steel joists (Item 2B) with 1-5/8 in. long No. 10 steel screws spaced 12 in. O.C. along ea. joint. Floor Mat Materials (Optional) - Min 3/4" to Max 3/4" thick floor mat material loose laid over subfloor. Finish Flooring - Floor topping mixture* - Min 3/4" thickness of floor topping mixture installed having a minimum compressive strength of 1500 psi. (Alternate finishes listed omitted for clarity)
- Steel Channel Joists** - Steel channel shaped joists, min 8" deep with min 1-1/2 in. flanges and 3/4 in. stiffening flanges. The joists are fabricated from min 18 MSG galvanized steel. Min. yield strength is 33 ksi. Joists spaced max 24 in. O.C.
- Gypsum Board** - Four layers of nom 3/4 in. thick, 4 ft wide gypsum board. First three layers installed with long dimension perpendicular to bottom chord of structural members. Adjacent butt joints staggered approx. 4 ft O.C. Overlapping layers installed so that edges and butt joints offset min 10 in. from previous layer. Base layer fastened to bottom chord of structural members with 1-1/4 in. long Type W or S-12 steel screws spaced 12 in. O.C. Second layer secured to bottom chord of structural members with 2 in. long Type S or S-12 steel screws spaced 12 in. O.C. Third layer secured to bottom chord of structural members with 2-1/2 in. Type S or S-12 steel screws spaced 12 in. O.C. Fourth layer secured to resilient channels with 1-1/8 in. long Type S steel screws spaced 12 in. O.C. Screws to be spaced 3/4 in. from butt end joints and 1 in. from side joints.
- Resilient Channels** - Hat shaped channels formed from No. 25 MSG galv steel spaced 24 in. O.C. perpendicular to structural wood members. Channels secured to bottom chord of structural member through third layer of gypsum board with 2-1/2 in. Type S or S-12 steel screws spaced 12 in. O.C.
- Finishing System** (Not shown for clarity) - Vinyl, dry, or premixed joint compound applied in two coats to joints and screw heads. Nom. 2 in. wide paper tape embedded in first layer of compound over all joints. As an alternate, nom 3/2 in. thick veneer plaster may be applied to the entire surface of gypsum board.

U.L. DESIGN #L556
A-0.1 NOT TO SCALE

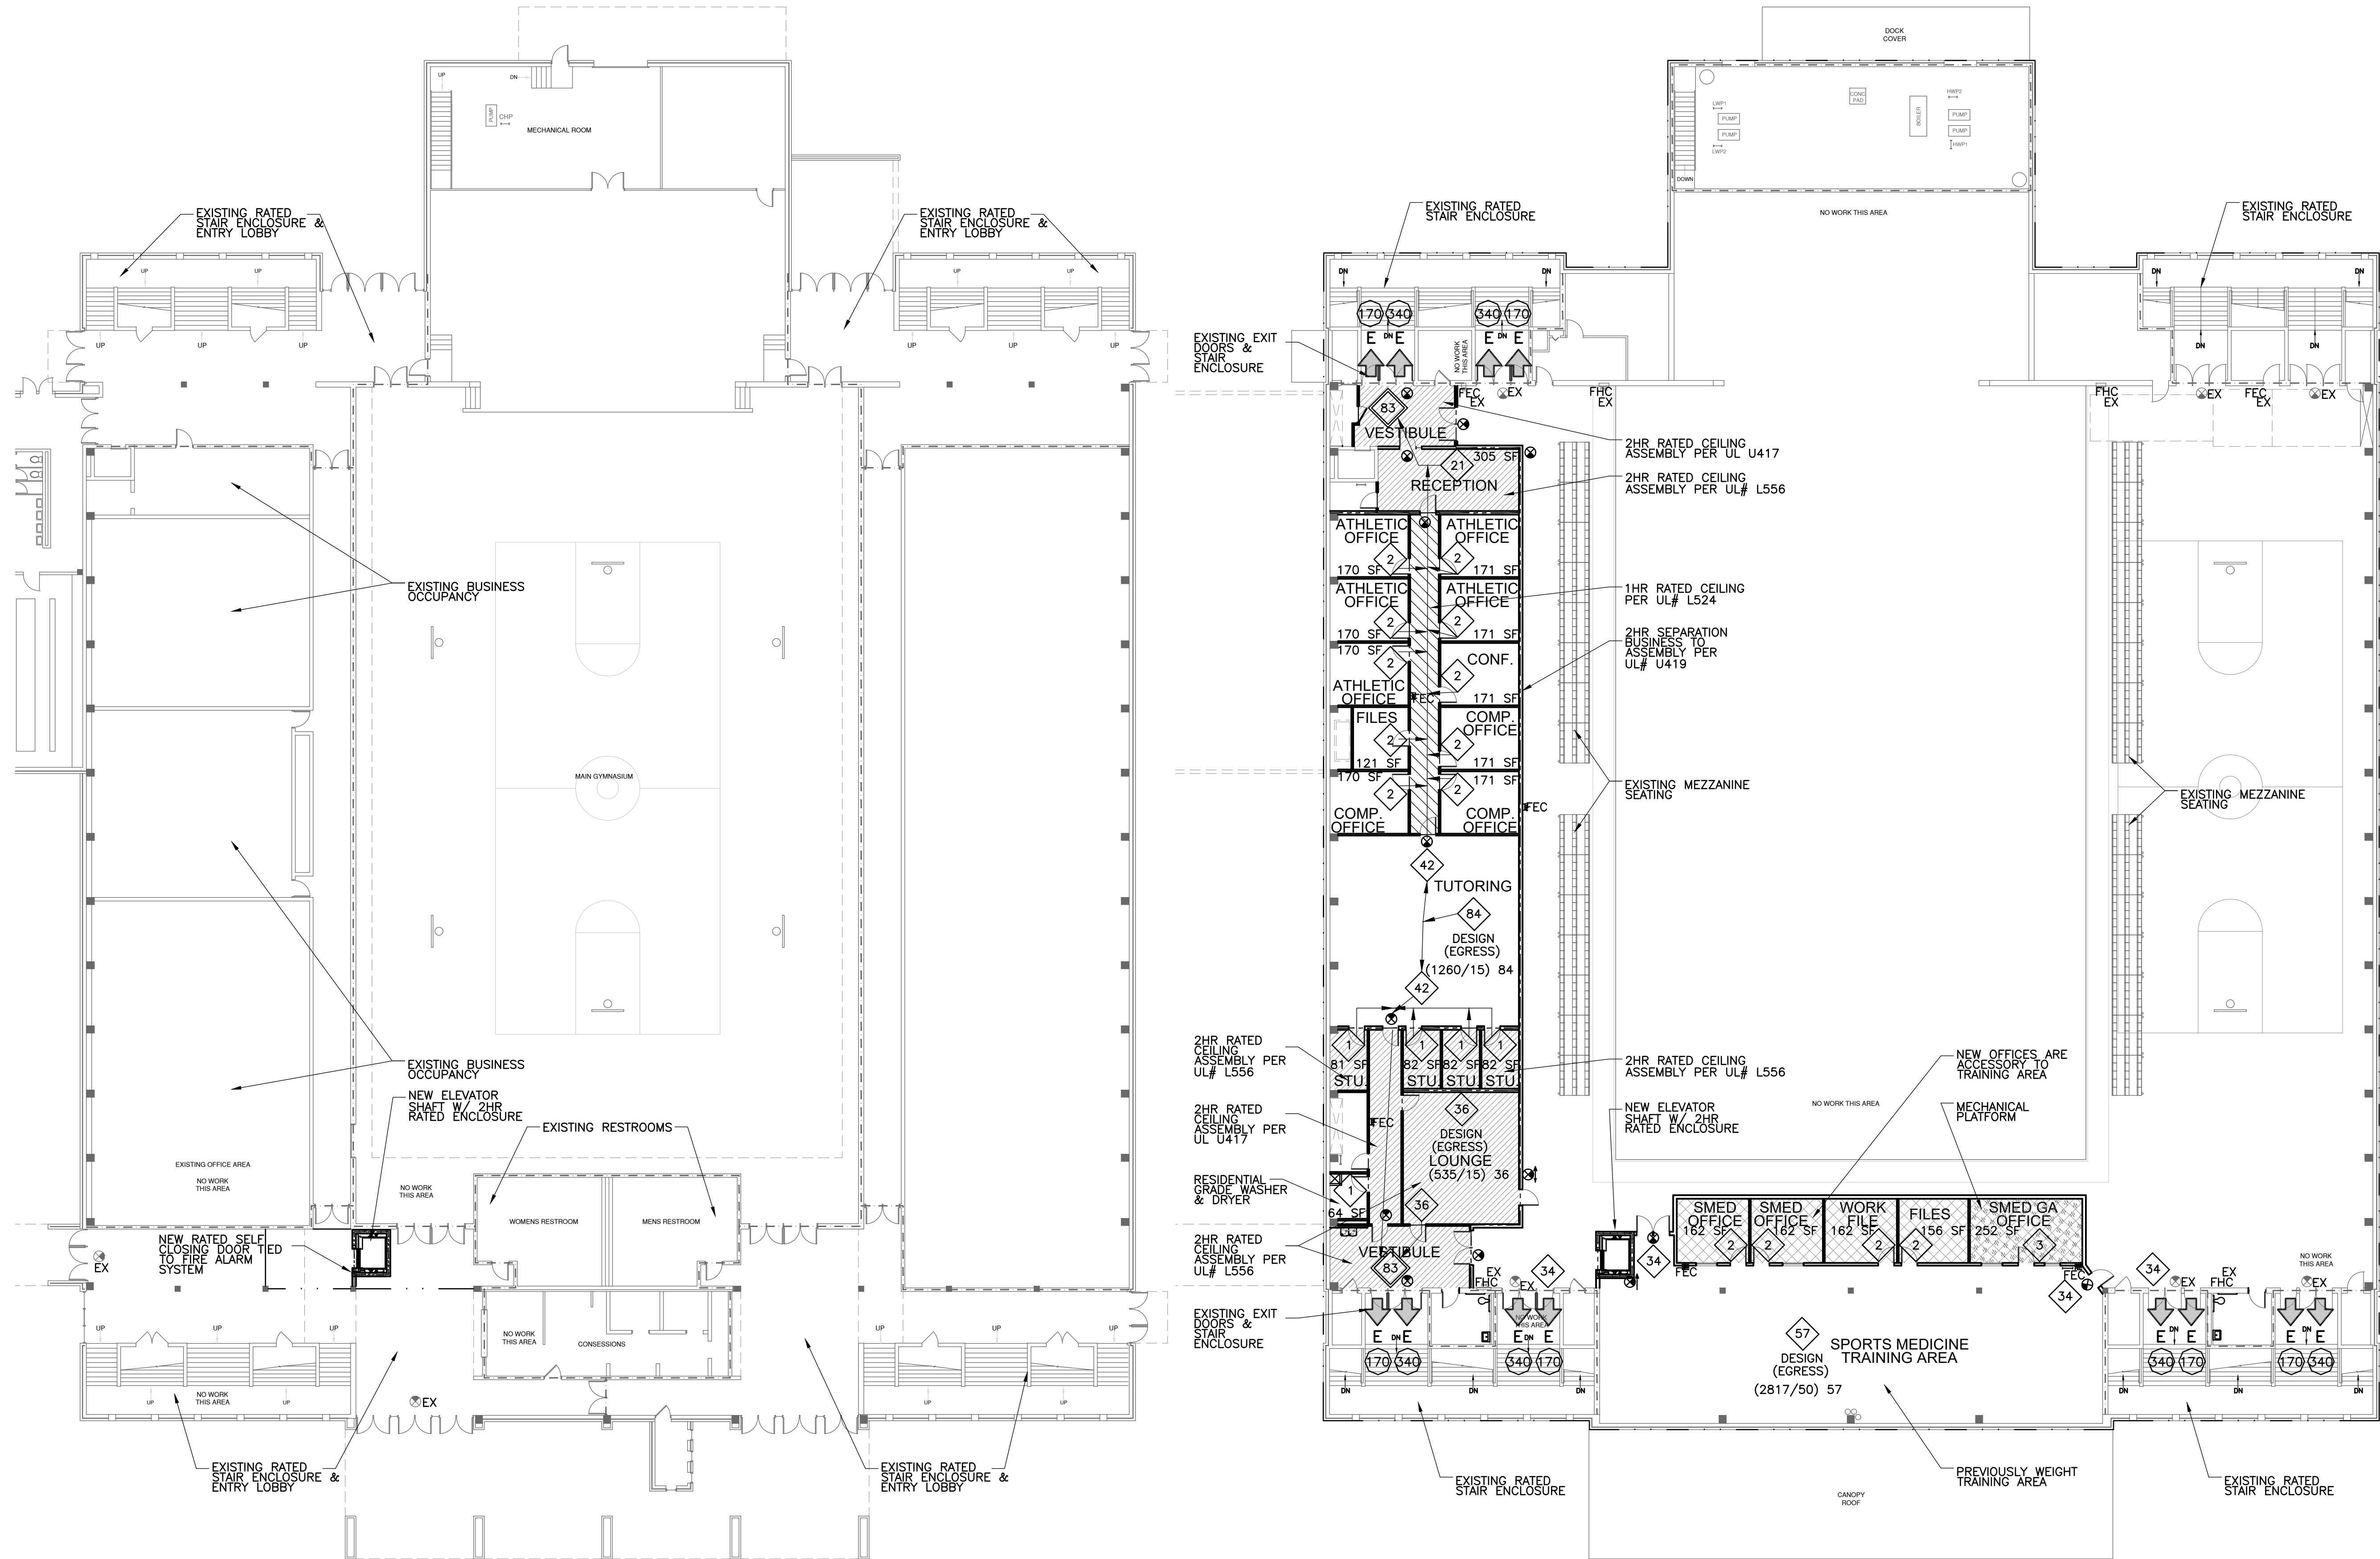

1 FLOOR PLAN
A-0.1 SCALE: 1/16" = 1'-0"



2 LIFE SAFETY MEZZANINE PLAN
A-0.1 SCALE: 1/16" = 1'-0"



TABLE 2902.1 MINIMUM NUMBER OF REQUIRED PLUMBING FACILITIES

B Business Areas (new offices) Occupant Load = 56 (28 male, 28 female)						
	Male WC 1/25 first 50 1/50 remainder	Female WC 1/25 first 50 1/50 remainder	Unisex WC	Lavatories 1/40 first 80 1/80 remainder	DF 1/100	Utility Sinks
Required	2	2	0	2	1	1

A-3 Assembly Areas (new - Tutoring, Lounge Areas & Renovated Training/weight area): Occupant Load = 177 (88 male, 89 female)						
	Male WC 1/125	Female WC 1/65	Unisex WC	Lavatories 1/200	DF 1/500	Utility Sinks
Required	1	2	0	1	1	1

TOTALS:						
	Male WC	Female WC	Unisex WC	Lavatories	DF	Utility Sinks
Total Required	3	4	0	3	2	2
Total Provided	1 + 10 exist. on ground floor	1 + 10 exist. on ground floor	0	2 + 20 exist. on ground floor	2	1

EXISTING BUILDING

OCCUPANCY TYPE: GROUP A-4 ASSEMBLY (RENOVATIONS TO WEIGHT TRAINING AREA) GROUP B BUSINESS (RECLASSIFICATION OF MEZZANINE SPACE OVER EXISTING BUSINESS OCCUPANCY)

CONSTRUCTION TYPE: IIB, UNPROTECTED, NON-SPRINKLERED

ALLOWABLE STORIES (PER TABLE 504.4) = 2-STORY
ACTUAL STORIES = 1-STORY-MEZZANINE

ACTUAL NET RENOVATED AREA (B OCCUPANCY ON MEZZANINE) = 5,713 S.F.
ALLOWABLE B OCCUPANCY PER 506.2 = 23,000 S.F.

ACTUAL NET EXISTING BUILDING AREA (REMAINDER OF MEZZANINE INCLUDING WEIGHT TRAINING AREA) = 17,619 S.F.
ACTUAL NET RENOVATED AREA (B ACCESSORY OCCUPANCY ON MEZZANINE) = 910 S.F.

TOTAL RENOVATION OCCUPANT LOAD: (FOR EGRESS & PLUMBING) 234

TYPICAL DESIGN CRITERIA FOR OCCUPANCY TYPES A & B:

- PER IBC TABLE 601, REQUIRED FIRE RESISTANCE RATING FOR BUILDING ELEMENTS = 0
- PER IBC 713.4, RATING AT SHAFT ENCLOSURES, (ELEVATORS & STAIRS) = 1 HR.
- PROVIDE 1 HOUR RATED WALLS AROUND ALL STAIRWAYS AND ELEVATOR SHAFTS - TYP. U.O.N.
- PER IBC TABLE 1017.1, ALLOWABLE EXIT ACCESS TRAVEL DISTANCE ASSEMBLY/BUSINESS = 200' W/O SPRINKLER SYSTEM
- PER NFPA TABLE A7.6, ALLOWABLE EXIT ACCESS TRAVEL DISTANCE = 200'
- PER IBC TABLE 1020.1 - CORRIDOR FIRE-RESISTANCE RATING: 1 HOUR FOR BUSINESS, GREATER THAN 30. W/O SPRINKLER SYSTEM
- PER IBC 1020.2, CORRIDOR WIDTH: MIN CORRIDOR WIDTH 44". WITH EXCEPTIONS FOR 36" WITH AN OCCUPANT LOAD <50, AND 24" FOR ELECTRICAL - MECHANICAL - PLUMBING ACCESS
- PER NFPA TABLE 7.3.3.1 & IBC 1005, ALLOWABLE WIDTH PER PERSON AT STAIRS = 3, AND AT OTHER EGRESS COMPONENTS = 2
- PER IBC 1020.6, EXCEPTION 1, CORRIDOR CONTINUITY: FOYERS, LOBBIES OR RECEPTION ROOMS CONSTRUCTED AS REQUIRED FOR CORRIDOR SHALL NOT BE CONSTRUCTED AS INTERVENING ROOMS
- PER IBC 508.2, ACCESSORY OCCUPANCIES: FOYERS, LOBBIES OR RECEPTION ROOMS CONSTRUCTED AS REQUIRED FOR CORRIDOR SHALL NOT BE CONSTRUCTED AS INTERVENING ROOMS

APPLICABLE CODES:

- INTERNATIONAL BUILDING CODE - 2015 EDITION
- 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN
- INTERNATIONAL FUEL GAS CODE - 2015 EDITION
- INTERNATIONAL PLUMBING CODE - 2015 EDITION
- INTERNATIONAL MECHANICAL CODE - 2015 EDITION
- INTERNATIONAL ELECTRICAL CODE - 2014 EDITION
- INTERNATIONAL FIRE CODE - 2015 EDITION

LIFE SAFETY LEGEND

H/E = HORIZONTAL EXIT

E = EXIT

XX = OCCUPANT LOAD PER TABLE 1004.1.1

XXX = AGGREGATE LOAD CALCULATION

XXX = DOOR/STAIR EXIT CAPACITY

1HR = 1HR RATED LID

2HR = 2HR RATED LID

XXX = ACCESSORY OCCUPANCY PER 508.2

EX = LIGHTED EXIT SIGN (EX=EXISTING)

FEC = FIRE EXTINGUISHER CABINET (EX=EXISTING)

FHC = FIRE HOSE CABINET (EX=EXISTING)

--- = 1 HOUR FIRE SEPARATION

--- = 2 HOUR FIRE SEPARATION

STUD WALLS: EQUIV. TO UL #U419

NOTE: NOT ALL EXISTING EXIT SIGNS, FEC, FHC SHOWN

NOLA VANPURSEM
ARCHITECTS, PC
MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
301 JEFFERSON STREET
HUNTSVILLE, ALABAMA 35891
(256) 535-6617
NVPARCHITECTS.COM

THIS DRAWING MAY NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE CONSENT OF NOLA VANPURSEM ARCHITECTS

ALABAMA A&M UNIVERSITY
ELMORE SPORTS MEDICINE RENOVATIONS
NORMAL, ALABAMA


JOB NUMBER
20132

ESN / RVP / 09.03.20
DRAWN / CHECKED / DATE

REVISIONS
A-0.1 11-29-20

SHEET TITLE
LIFE SAFETY PLAN


SHEET NUMBER
A-0.1
OF

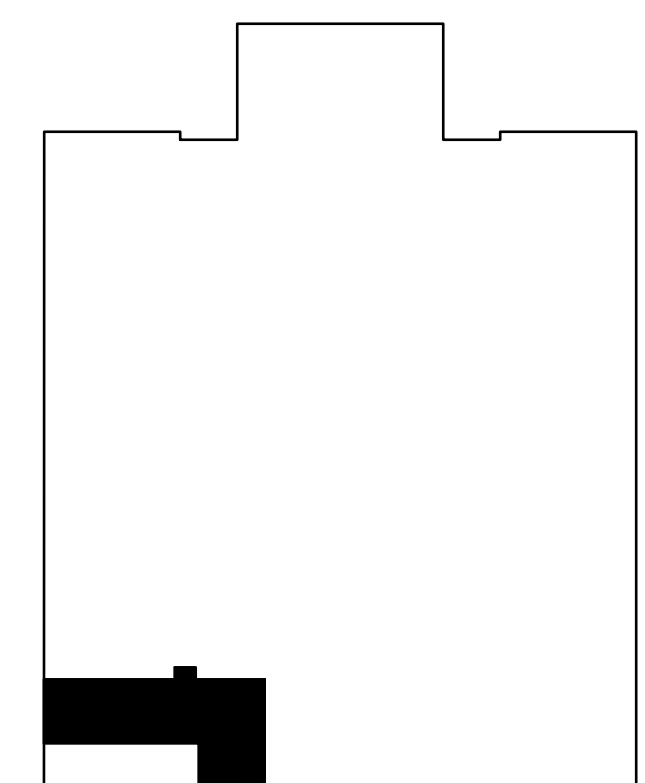


PARTIAL MEZZANINE DEMO PLAN

SCALE: 1/8" = 1'-0"


NORTH

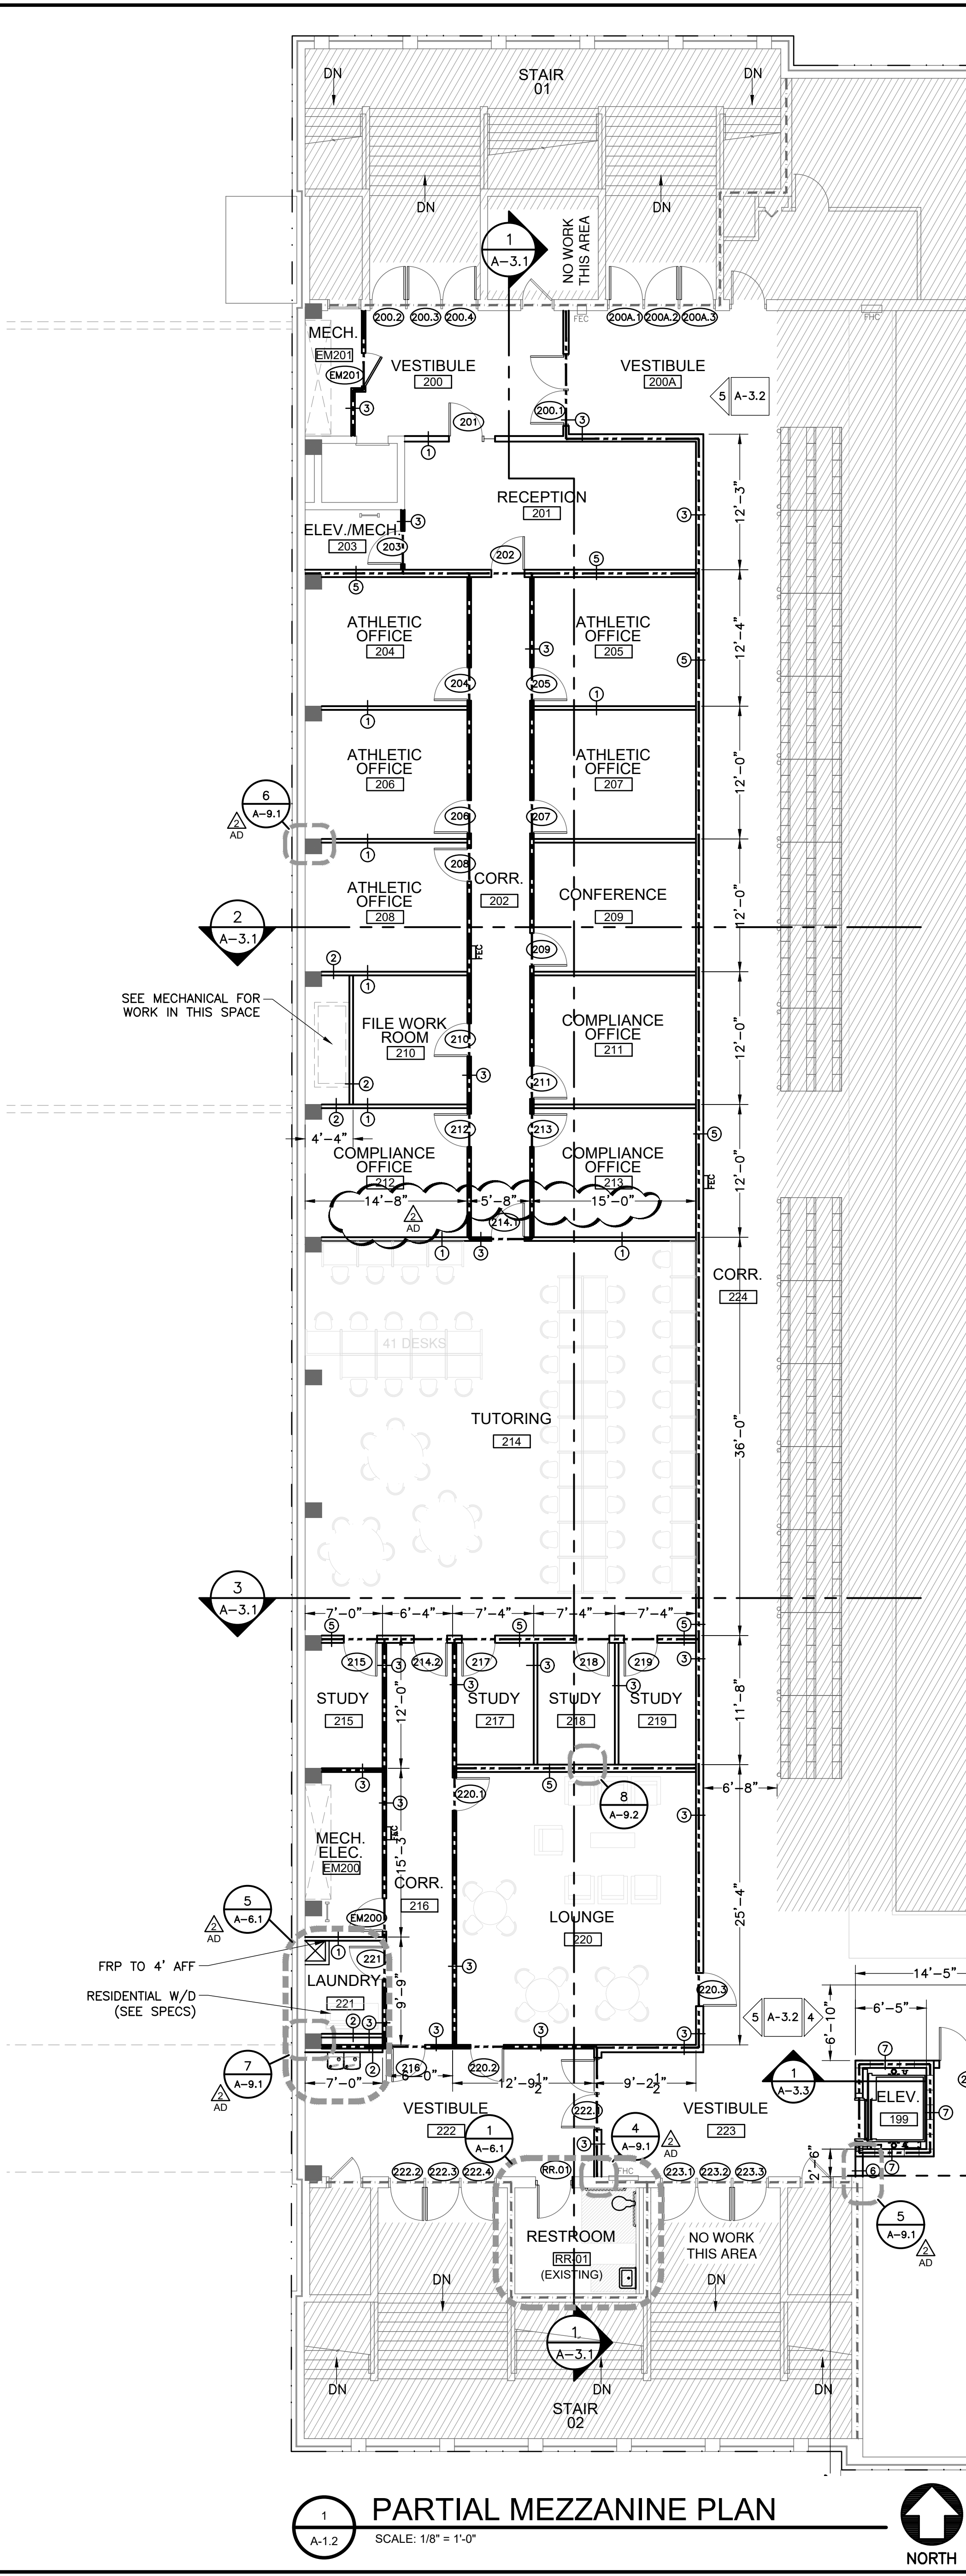


1
A-1.2
PARTIAL MEZZANINE PLAN
SCALE: 1/8" = 1'-0"
NORTH

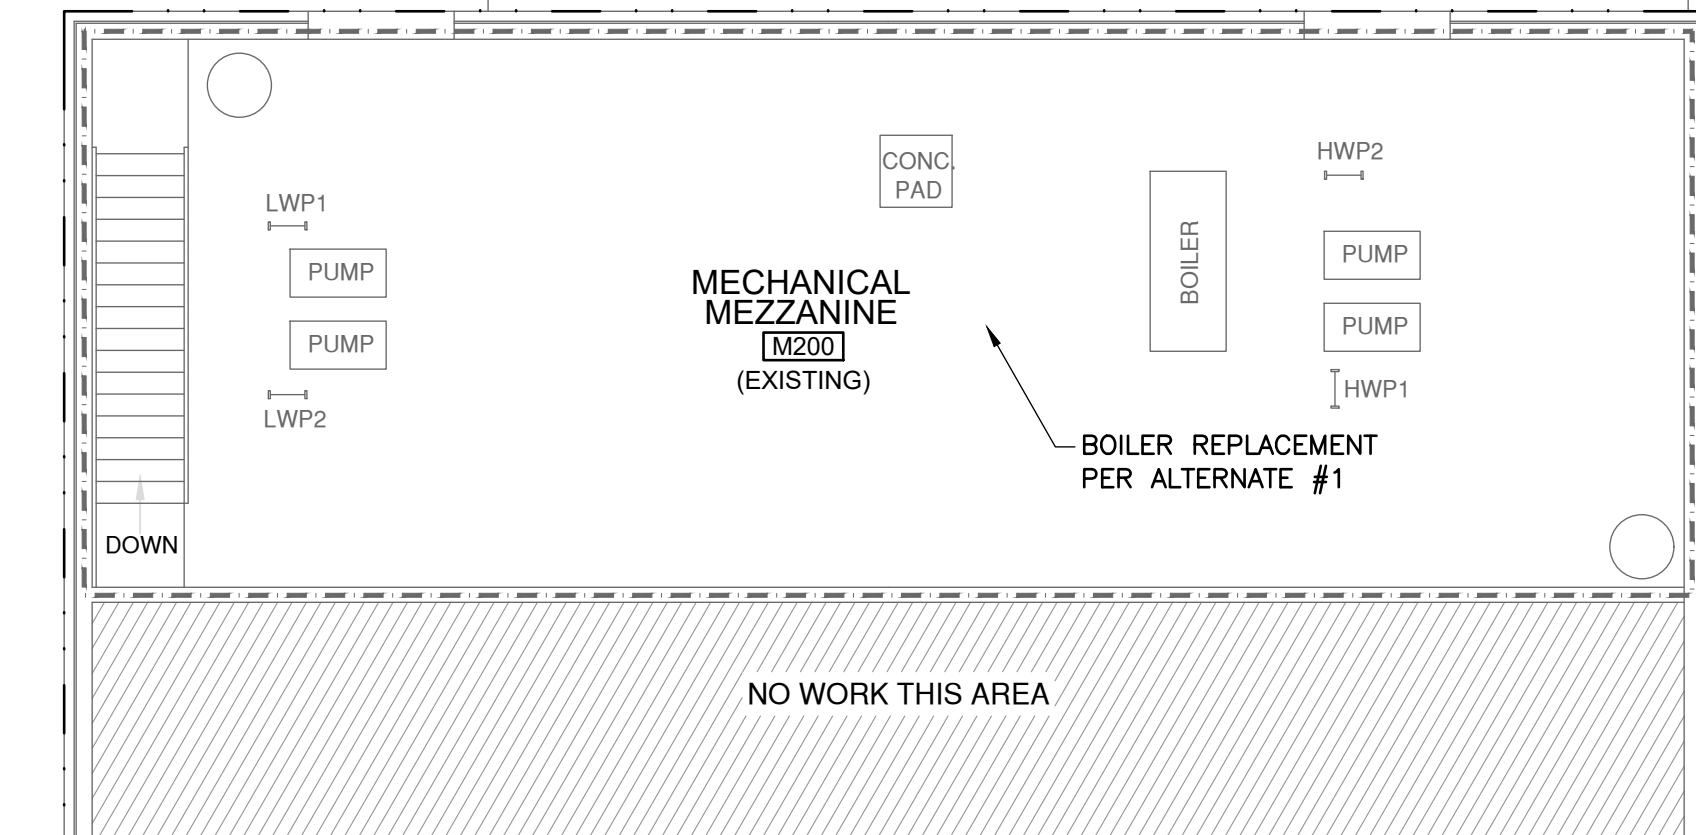


3
A-1.2
MECHANICAL ROOM
SCALE: 1/8" = 1'-0"
NORTH

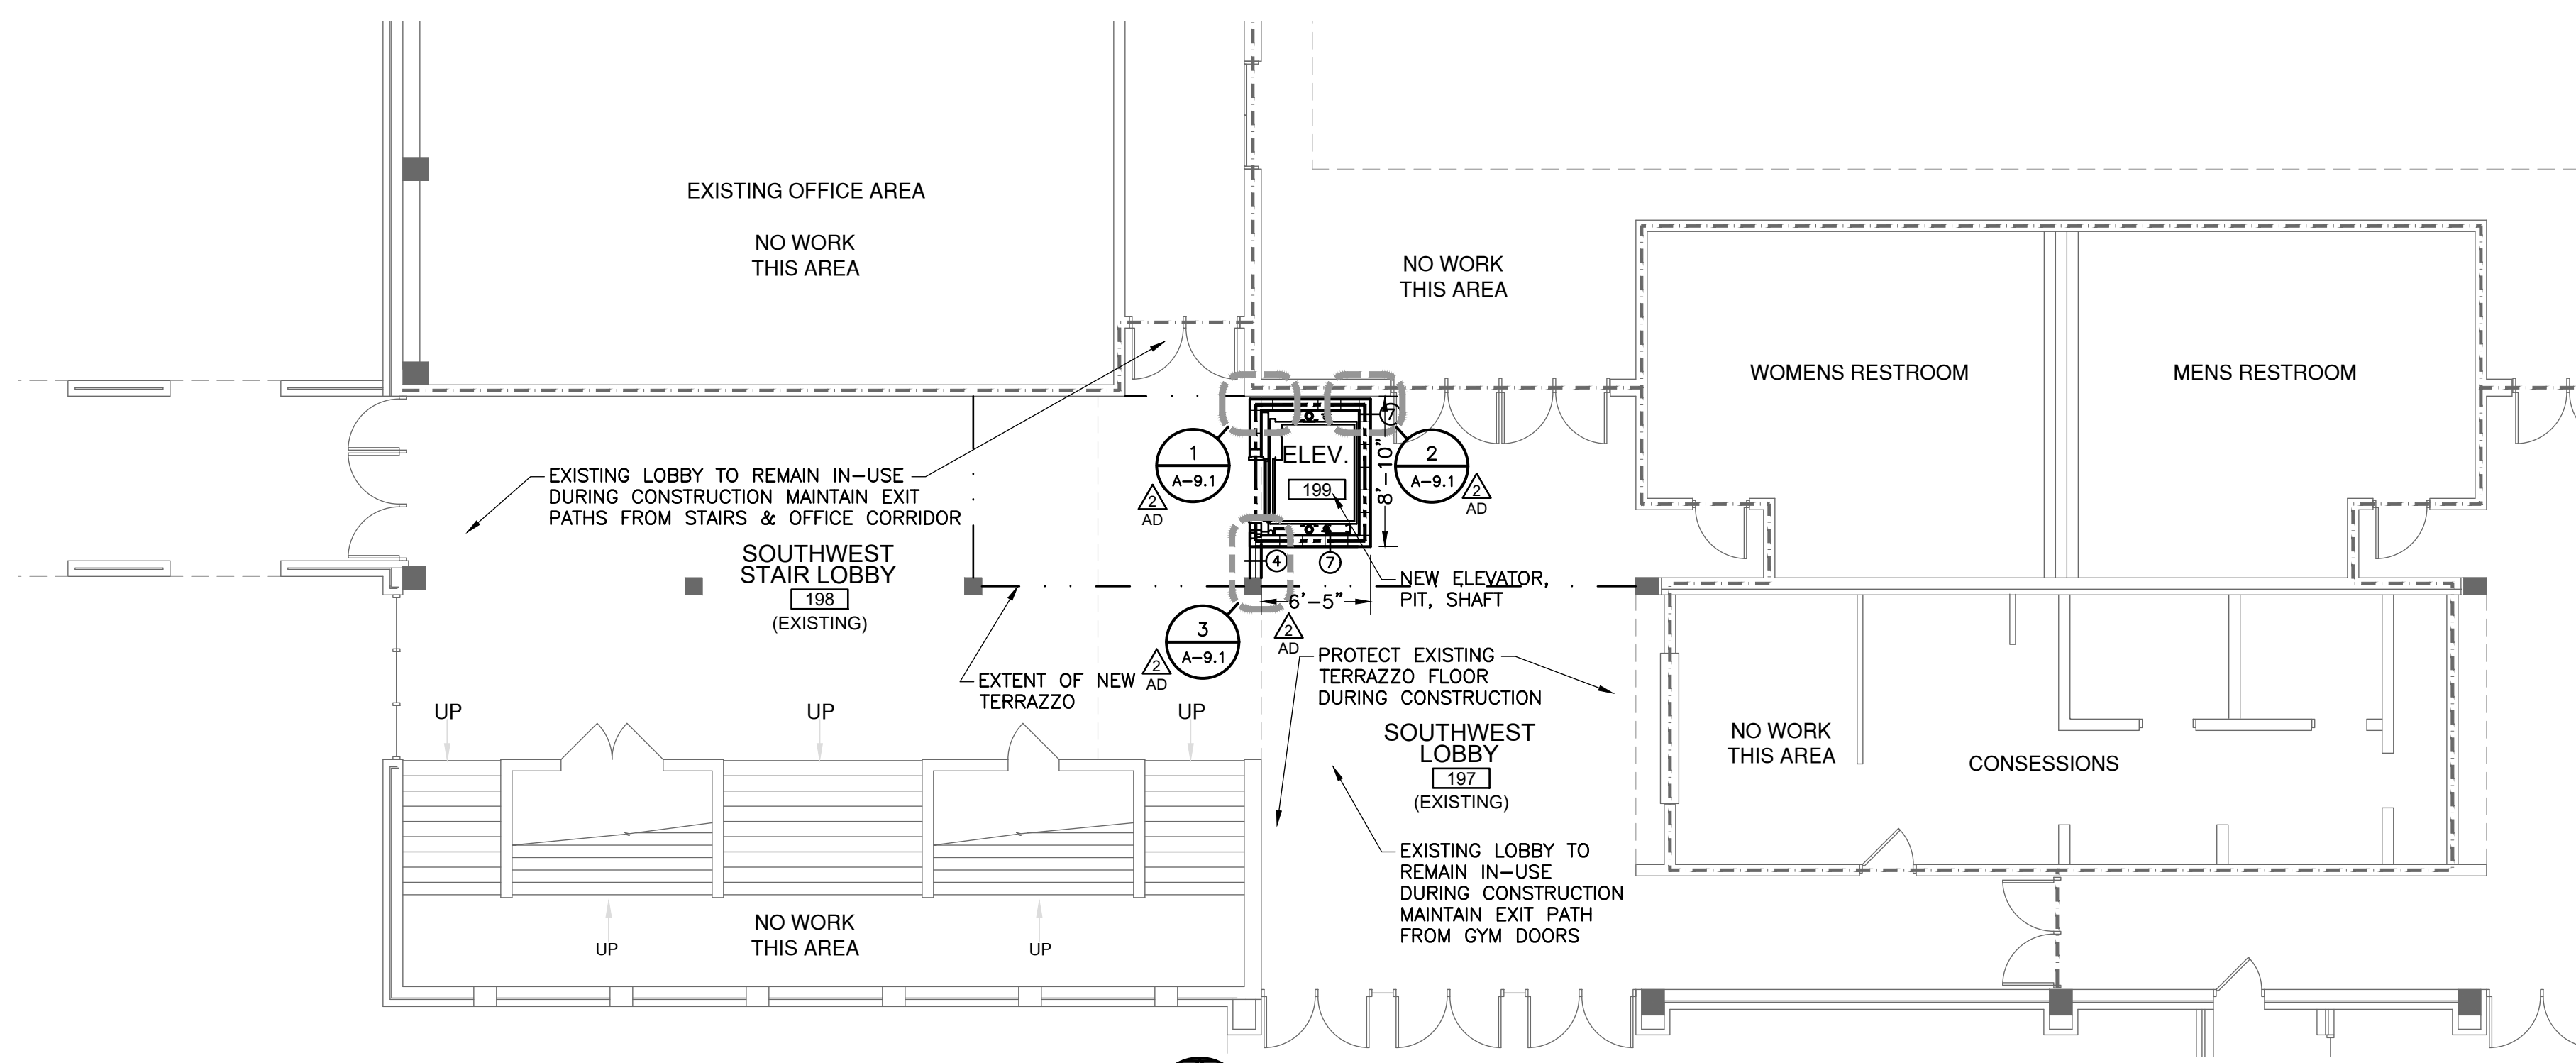


2
A-1.2
PARTIAL SOUTHWEST LOBBY PLAN
SCALE: 1/8" = 1'-0"
NORTH

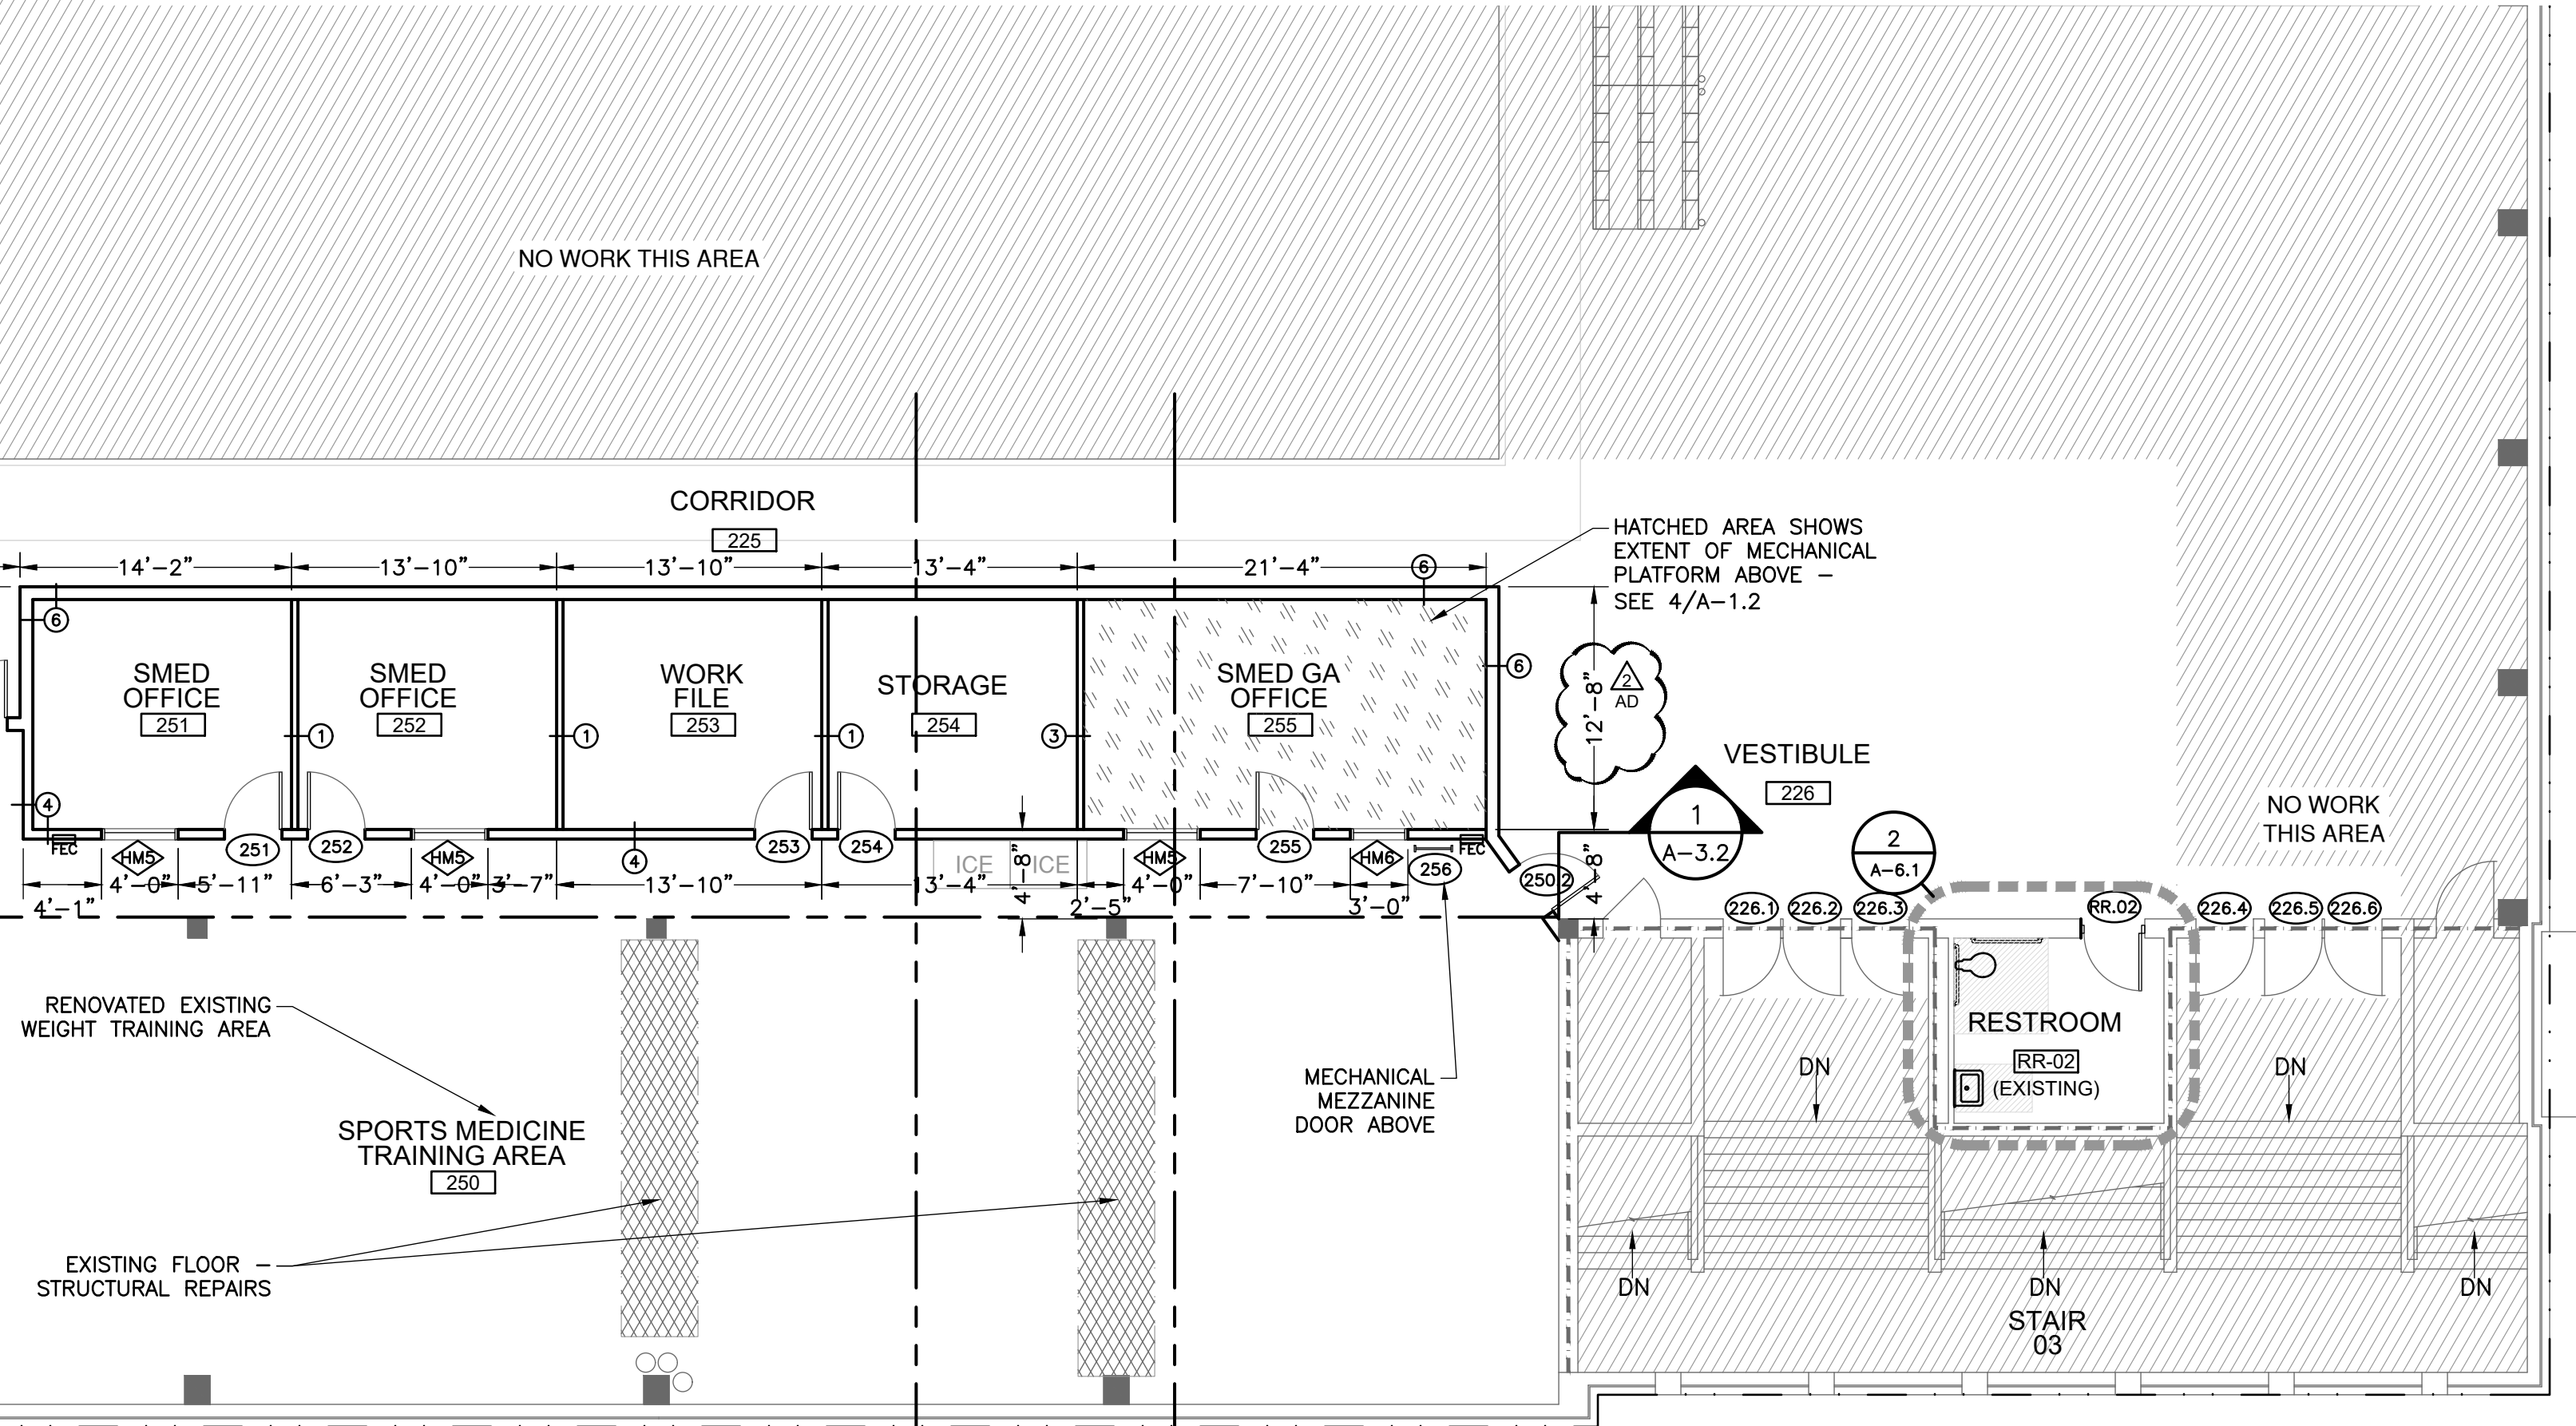

1
A-1.2
PARTIAL MEZZANINE PLAN
SCALE: 1/8" = 1'-0"
NORTH

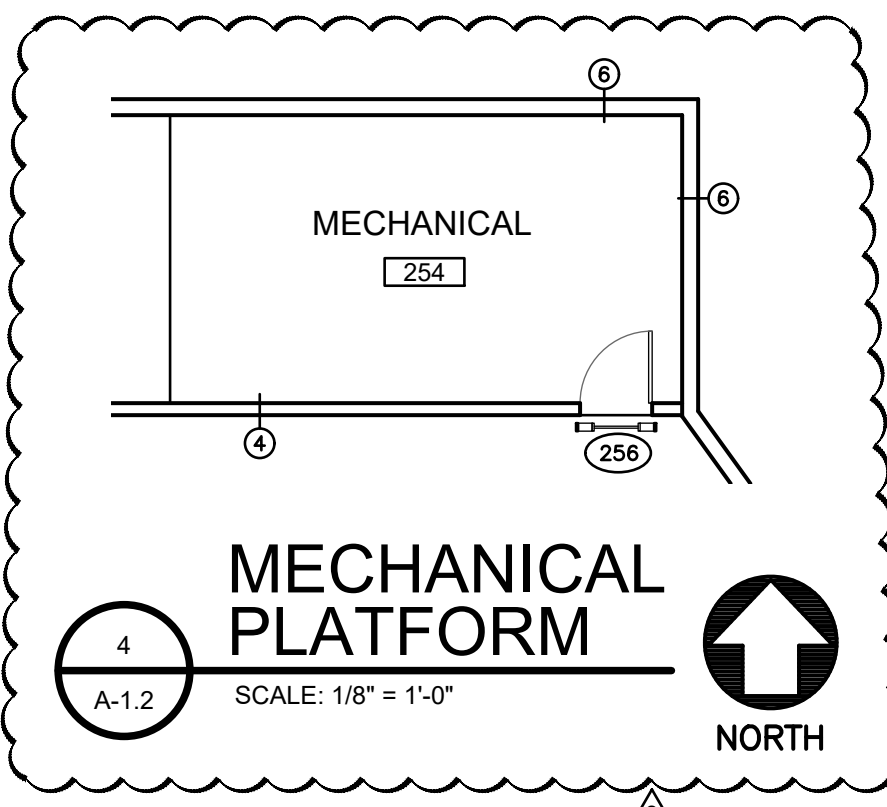

4
A-1.2
MECHANICAL PLATFORM
SCALE: 1/8" = 1'-0"
NORTH

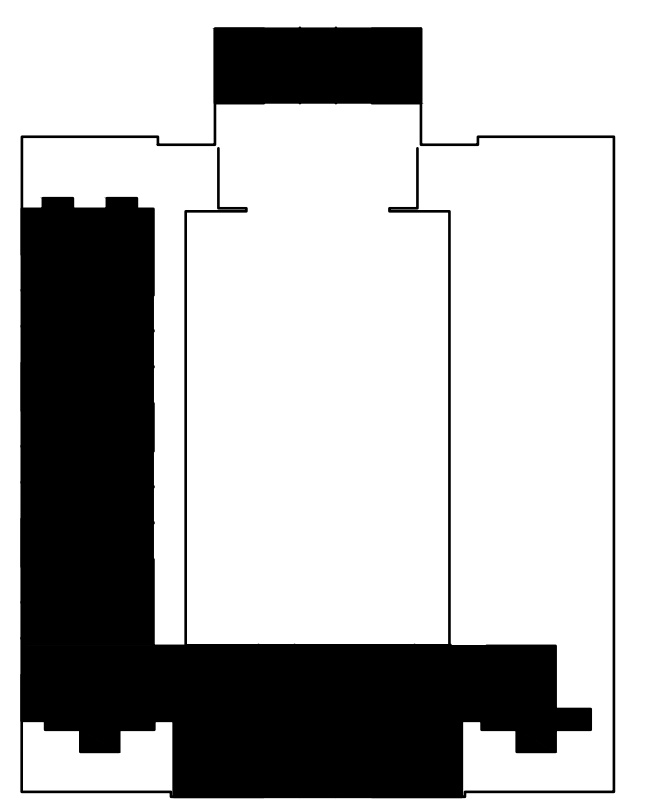

KEY PLAN
NOT TO SCALE

FIRE-RATING LEGEND	
NON-RATED WALL ASSEMBLY	EXISTING NON-RATED WALL ASSEMBLY
ONE-HOUR RATED WALL ASSEMBLY	EXISTING RATED WALL ASSEMBLY
TWO-HOUR RATED WALL ASSEMBLY	

GENERAL NOTES	
1. SEE PLAN FOR LOCATION OF OUTSIDE CORNERS TO RECEIVE CORNER PROTECTION	
2. ALL STUD WALLS SHALL HAVE BATT INSULATION TO 12" AFF. OR TOP OF WALL, WHICHEVER IS LOWER	
3. STUD WALLS SHALL HAVE OUTER MOST LAYER HIGH IMPACT GYP. BD. TO MINIMUM 8' AFF AT VESTIBULE 200A, VESTIBULE 222, VESTIBULE 223, CORRIDOR 224, CORRIDOR 225, VESTIBULE 226	
4. CEILING ASSEMBLY AT STUD ROOMS & LOUNGE SHALL HAVE BATT INSULATION	
5. SEE ROOM FINISH SCHEDULE FOR LOCATIONS OF CARPET TILE	
6. PROVIDE TEAR-DOWN BEAD AT ALL CORNER INTERSECTIONS BETWEEN CMU & GYP. BD.	
7. FIRE RATING SHALL CONTINUE ACROSS DOOR HEADERS	
8. APPLIANCES WHERE SHOWN ARE TO BE PROVIDED BY OWNER & INSTALLED BY CONTRACTOR. SEE SPECS.	
9. FURNITURE THAT DOES NOT HAVE A CASEWORK TAG IS NOT IN CONTRACT	
10. PROTECT ALL FLOORS DURING CONSTRUCTION. DAMAGED CAUSED TO EXISTING FLOORING DURING CONSTRUCTION MUST BE REPAIRED BY THE CONTRACTOR.	

WALL TYPES	
1 3-5/8" METAL STUDS @ 16" O.C. WITH 1 LAYER 5/8" BD. EACH SIDE, TOP OF WALL 4" MIN. ABOVE HIGHEST ADJACENT CEILING HEIGHT. BRACE TO STRUCTURAL IN 4' ALTERNATING DIAGONALS.	7 8" CMU; EXTEND TO BOTTOM OF STRUCTURAL DECK OR RATED ASSEMBLY
2 3-5/8" METAL STUDS WITH 1 LAYER 5/8" GYP. BD. ONE SIDE, TOP OF WALL 4" MIN. ABOVE HIGHEST ADJACENT CEILING HEIGHT.	
3 3-5/8" METAL STUDS @ 16" O.C. W/ 1 LAYER 5/8" GYP. OR 2 LAYERS 5/8" GYP. EACH SIDE AT 2-HOUR WALLS- EXTEND TO BOTTOM OF STRUCTURAL DECK, RATED ASSEMBLY OR AS NOTED IN SECTIONS	
4 6" METAL STUDS @ 16" O.C. W/ 1 LAYER 5/8" BD. EACH SIDE, TOP OF WALL 4" MIN. ABOVE HIGHEST ADJACENT CEILING HEIGHT. BRACE TO STRUCTURAL IN 4' ALTERNATING DIAGONALS AS REQUIRED.	
5 6" METAL STUDS W/ 1 LAYER 5/8" GYP. OR 2 LAYERS 5/8" GYP. EACH SIDE AT 2-HOUR WALLS- EXTEND TO BOTTOM OF STRUCTURAL DECK, RATED ASSEMBLY OR AS NOTED IN SECTIONS. SEE GENERAL NOTES FOR LOCATIONS TO RECEIVE 5/8" HIGH IMPACT GYP. BD.	
6 8" METAL STUDS W/ 1 LAYER 5/8" GYP. OR 2 LAYERS 5/8" GYP. EACH SIDE AT 2-HOUR WALLS- EXTEND TO BOTTOM OF STRUCTURAL DECK OR RATED ASSEMBLY. SEE GENERAL NOTES FOR LOCATIONS TO RECEIVE 5/8" HIGH IMPACT GYP. BD.	

STATE OF ALABAMA
NOLA VANPEURSEM
REGISTERED ARCHITECT
3871
REG. NO.
3535

NOLA VANPEURSEM
ARCHITECTS, PC
MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
301 JEFFERSON STREET
HUNTSVILLE, ALABAMA 35891
(256) 535-6617
NVPARCHITECTS.COM

THIS DRAWING MAY NOT BE
REPRODUCED IN WHOLE OR IN
PART WITHOUT THE CONSENT OF
NOLA VANPEURSEM ARCHITECTS

ALABAMA A&M UNIVERSITY
ELMORE SPORTS MEDICINE RENOVATIONS
NORMAL, ALABAMA



JOB NUMBER
20132

ESN / RVP / 09.03.20
DRAWN / CHECKED / DATE


REVISIONS
AD 11-29-20

SHEET TITLE
RENOVATION PLAN


SHEET NUMBER
A-1.2
OF

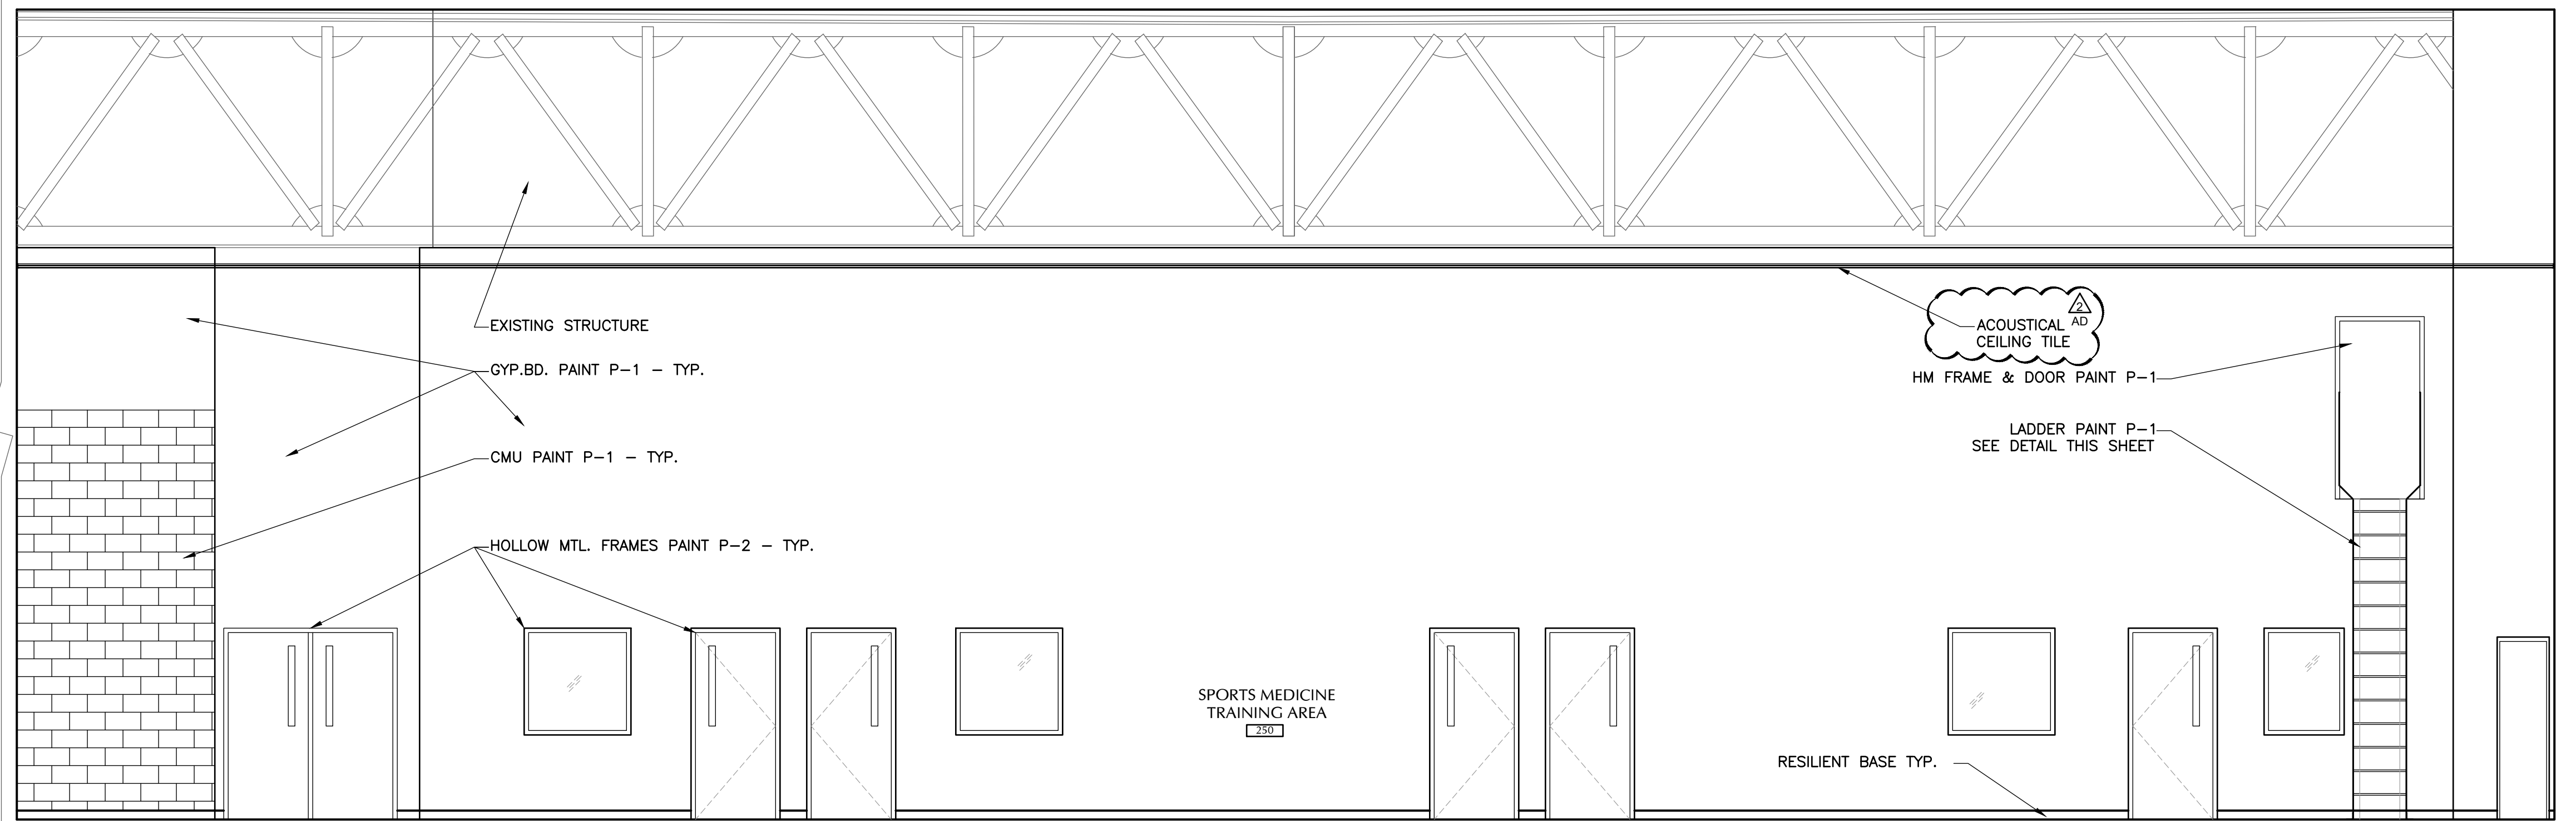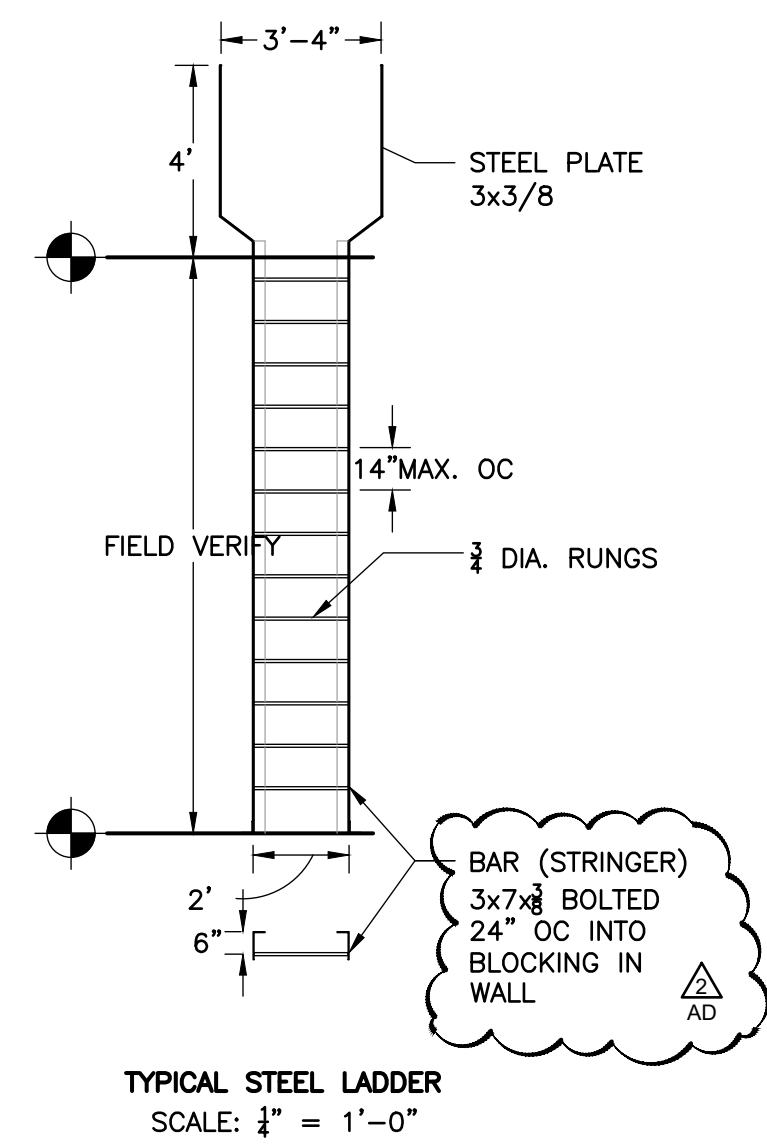


1 BUILDING SECTION
A-3.2 SCALE: 1/4" = 1'-0"

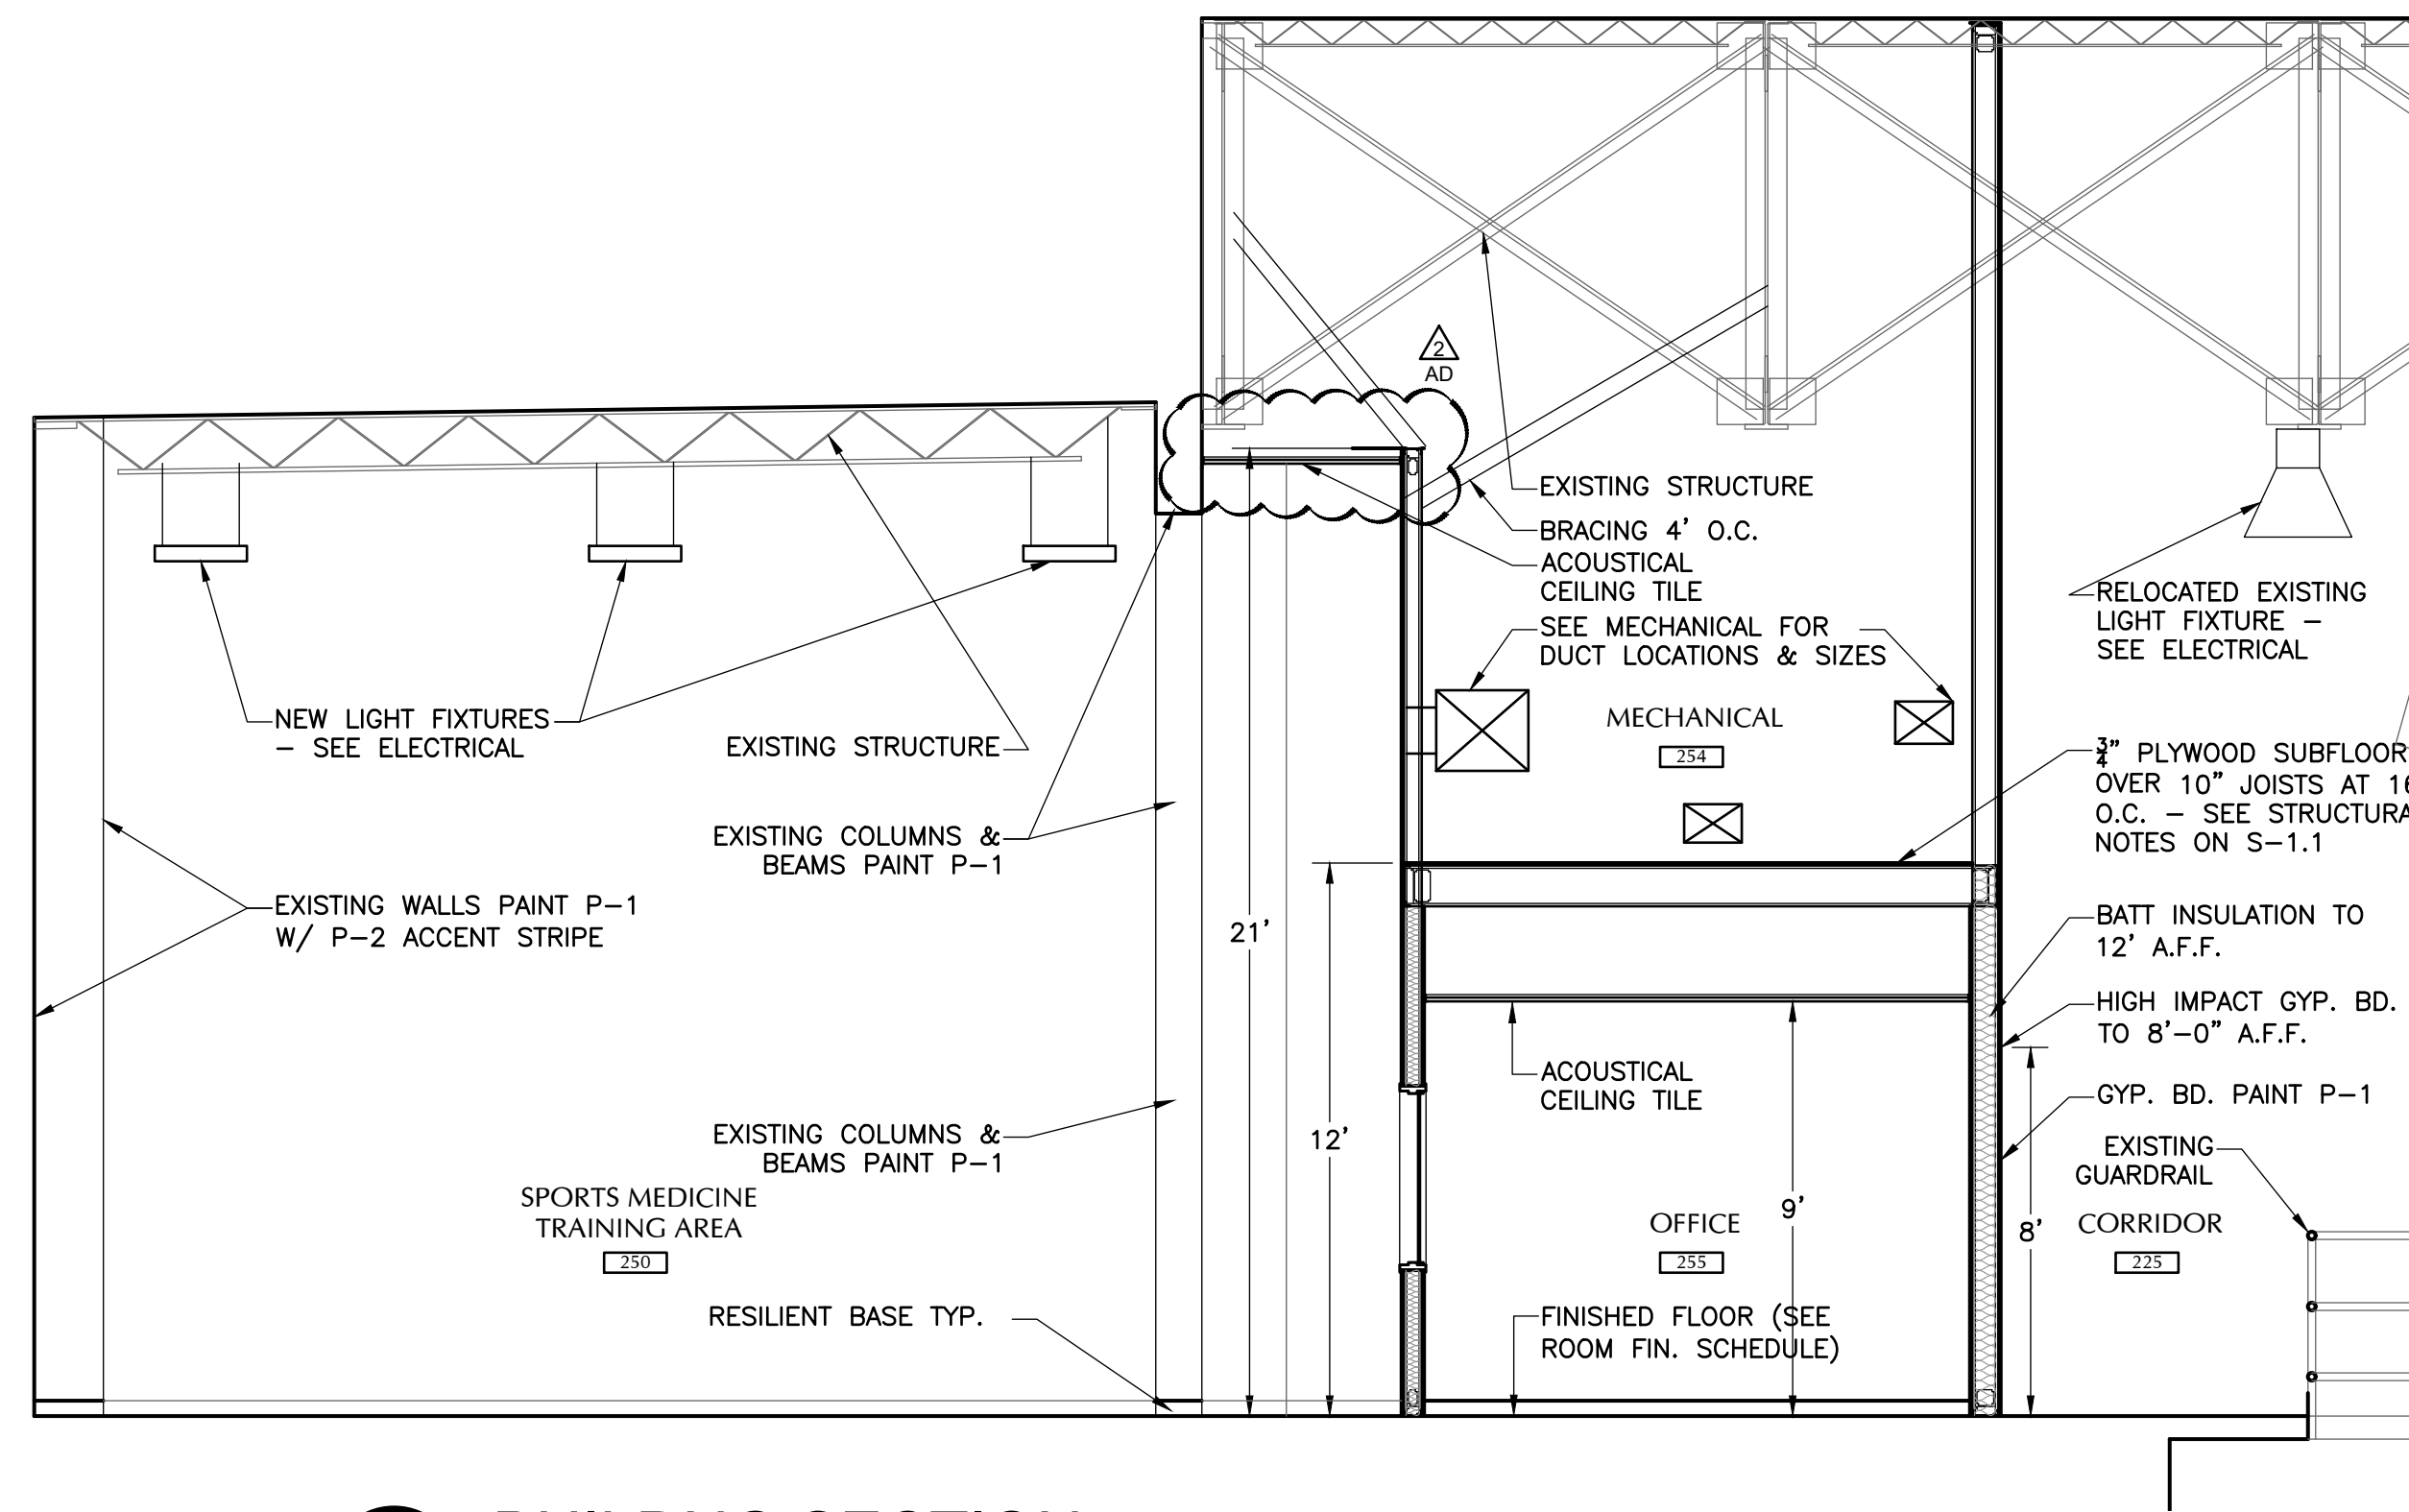


2 BUILDING SECTION
A-3.2 SCALE: 1/4" = 1'-0"

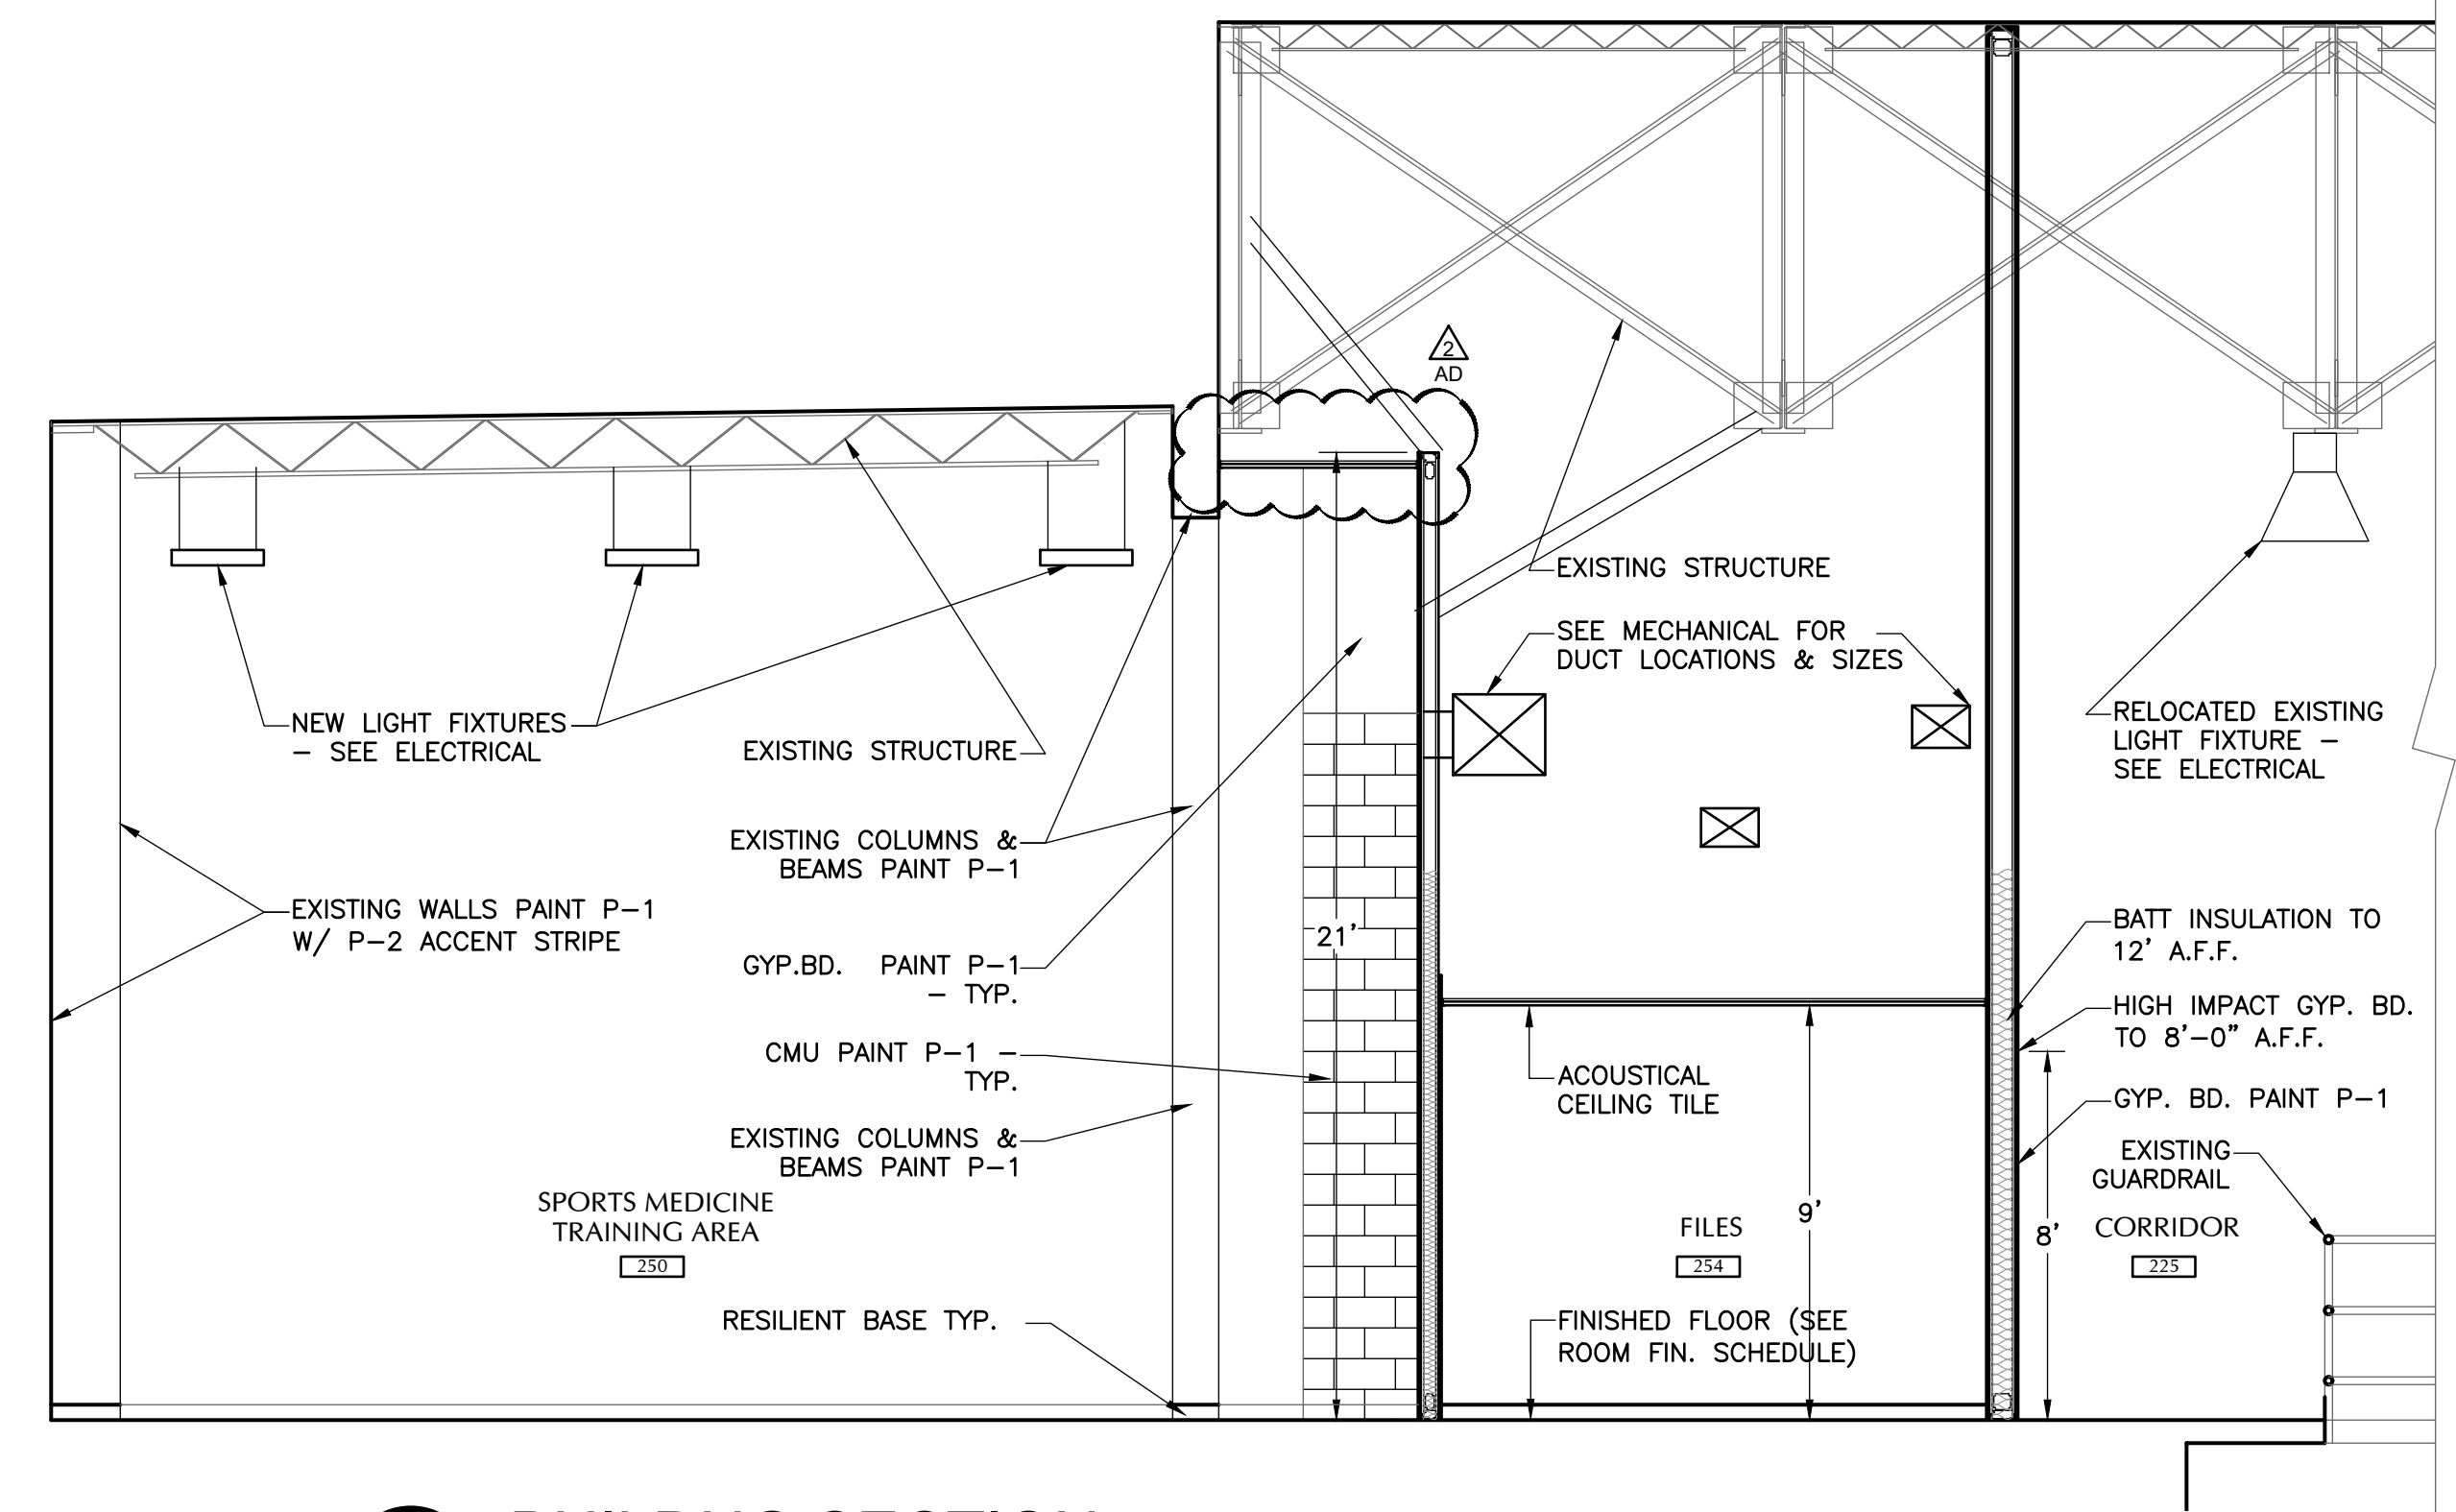


3 BUILDING SECTION
A-3.2 SCALE: 1/4" = 1'-0"

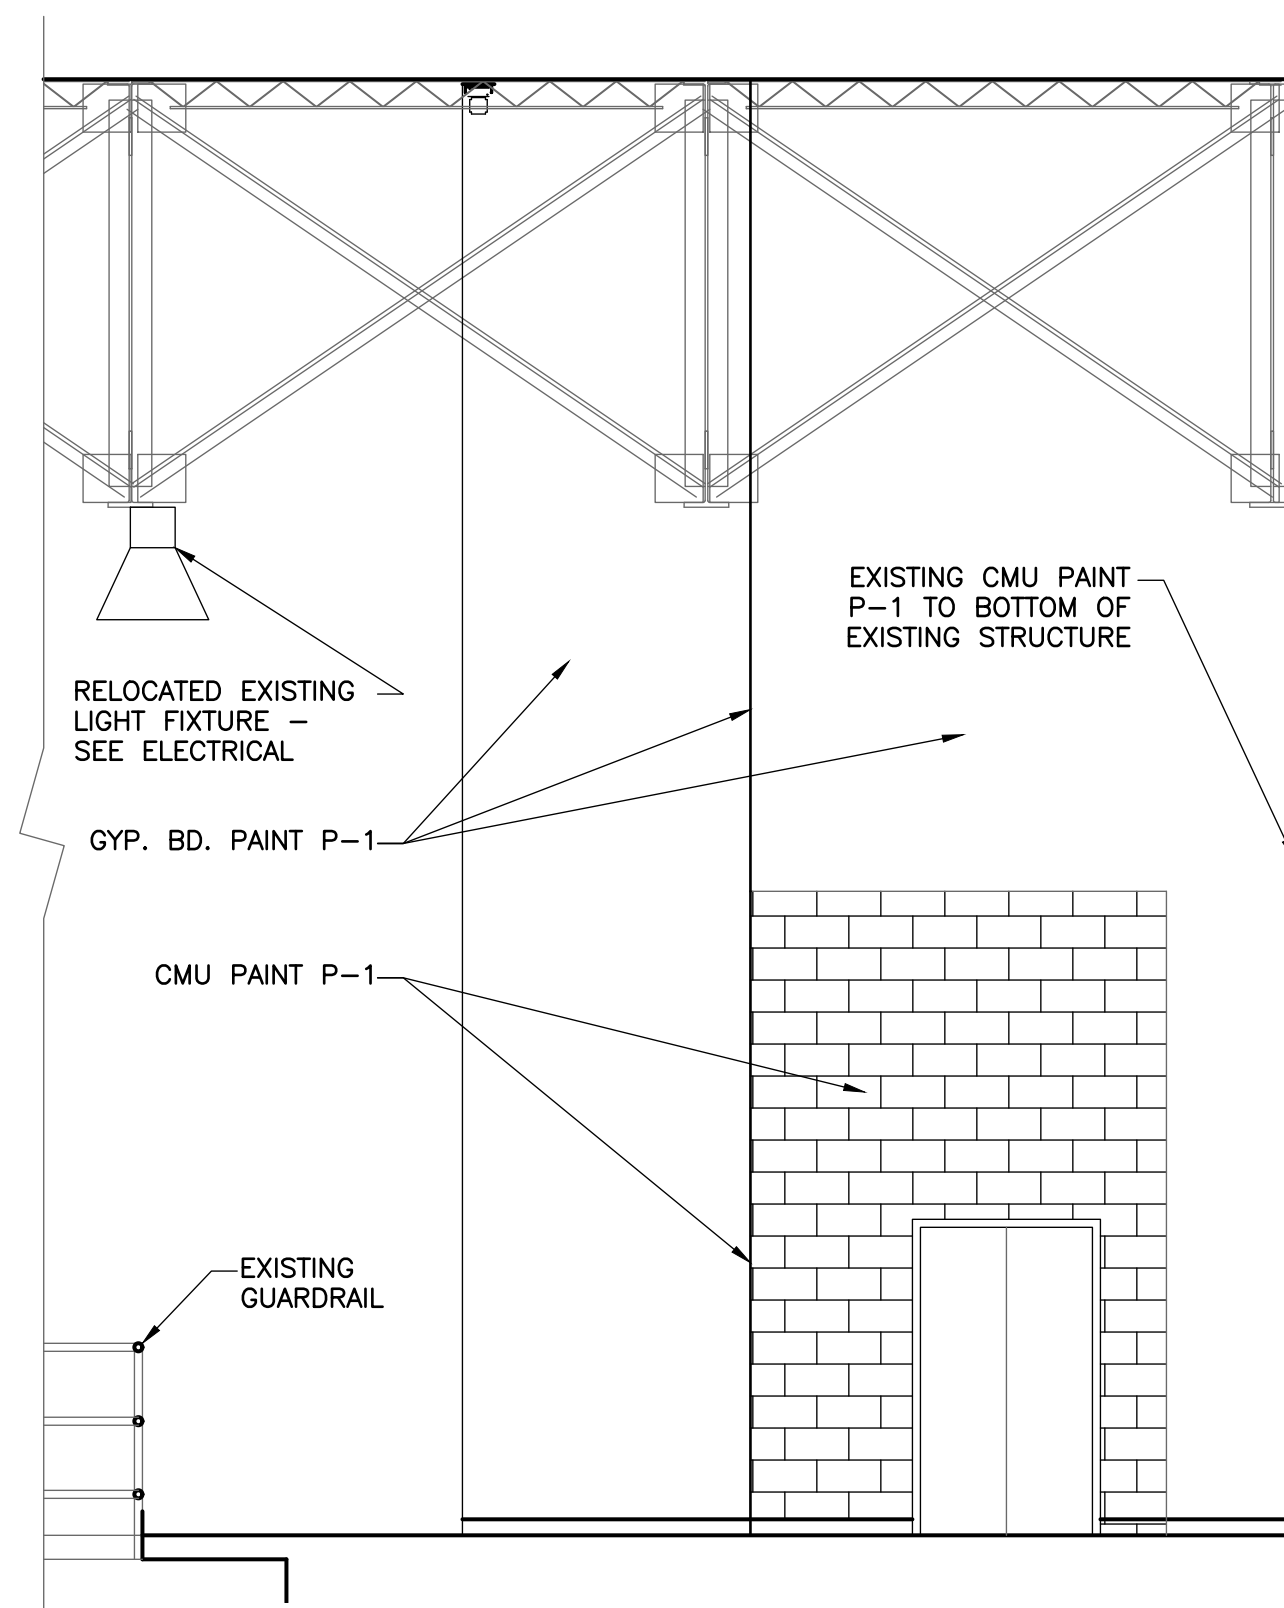

4 INTERIOR ELEVATION
A-3.2 SCALE: 1/4" = 1'-0"

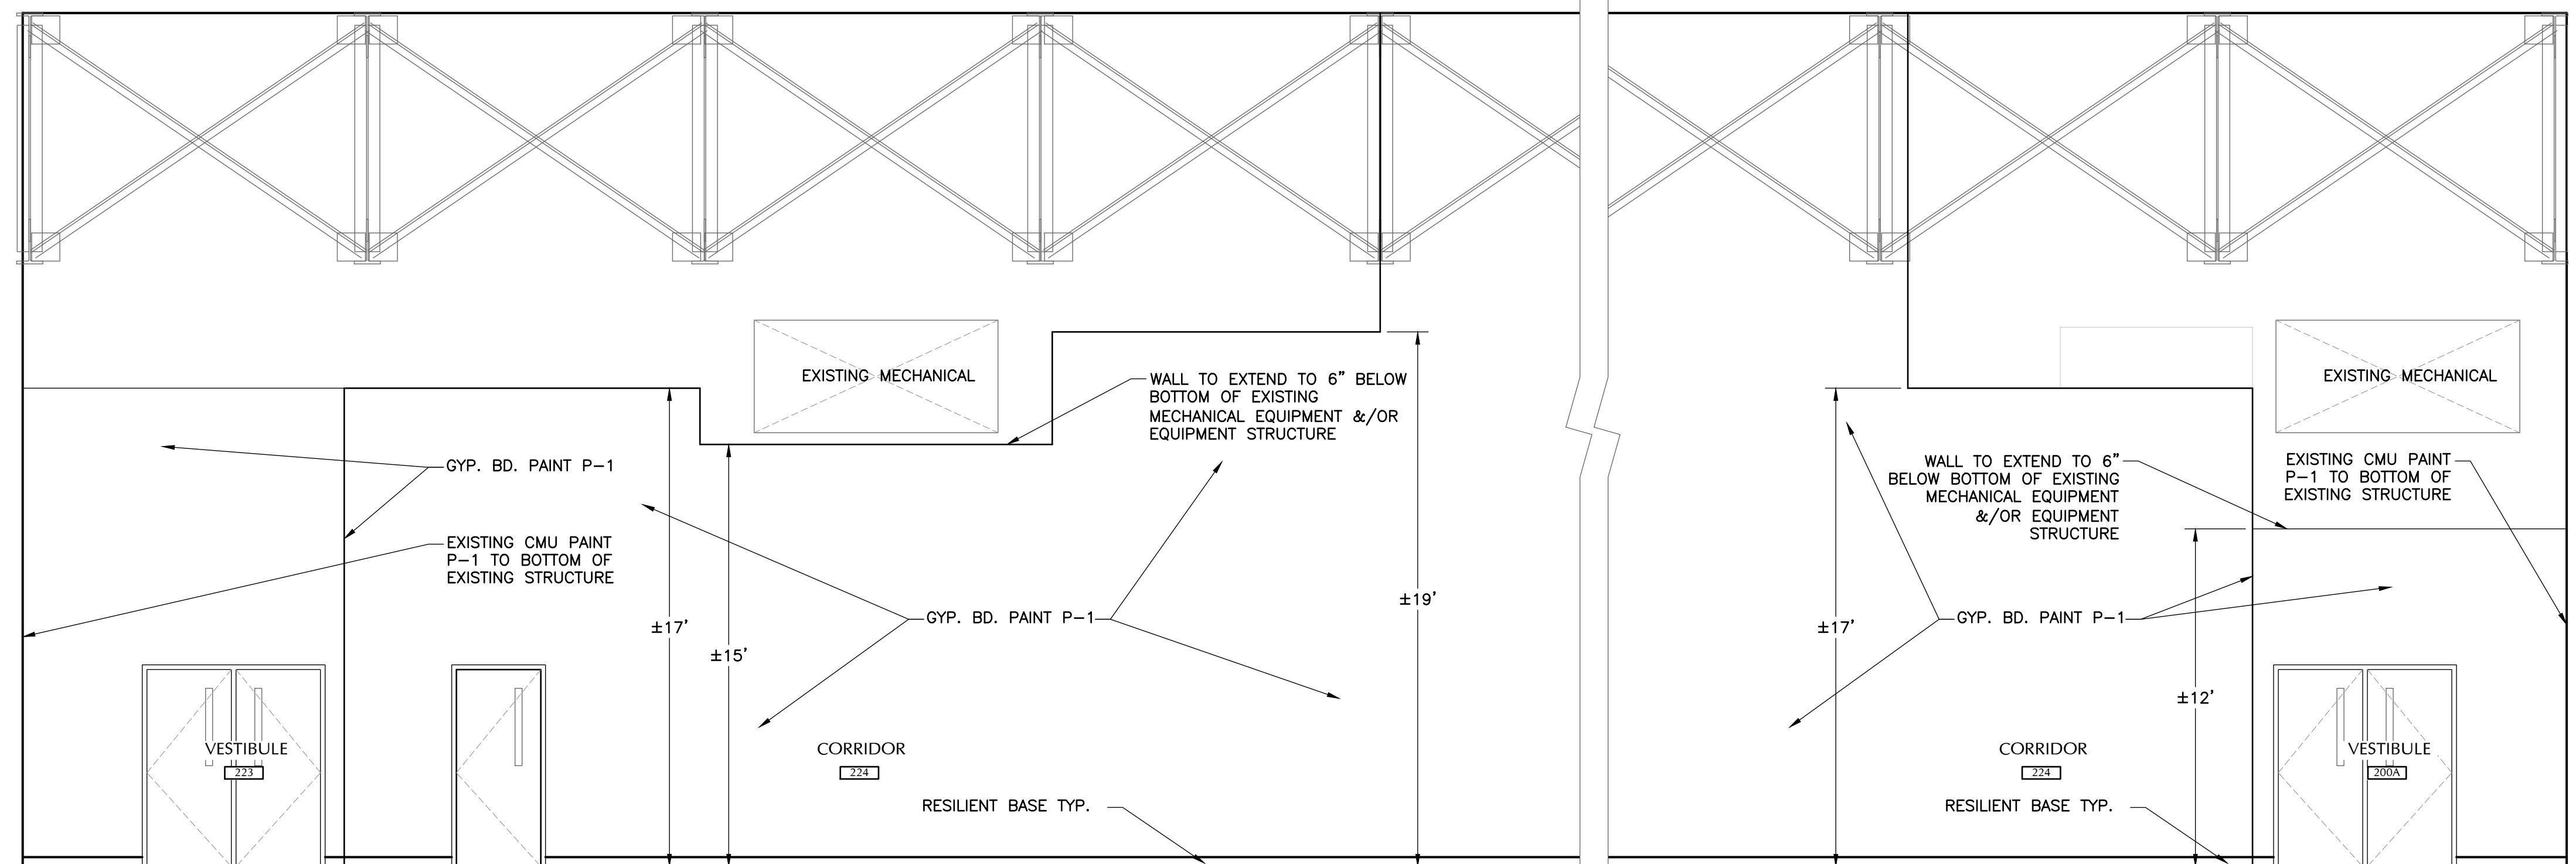

5 INTERIOR ELEVATION
A-3.2 SCALE: 1/4" = 1'-0"

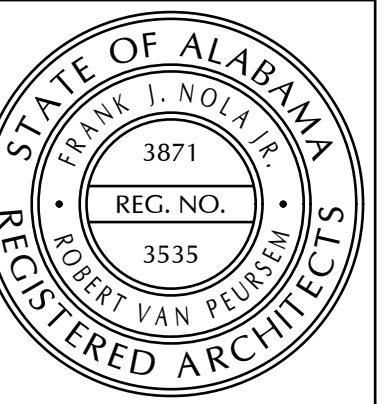

NOLA VANPURSEUM
ARCHITECTS, PC
MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
301 JEFFERSON STREET
HUNTSVILLE, ALABAMA 35891
(256) 535-6617
NVPARCHITECTS.COM

THIS DRAWING MAY NOT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE CONSENT OF NOLA VANPURSEUM ARCHITECTS

ALABAMA A&M UNIVERSITY
ELMORE SPORTS MEDICINE RENOVATIONS
NORMAL, ALABAMA


JOB NUMBER
20132

ESN / RVP / 09.03.20
DRAWN / CHECKED / DATE


REVISIONS
AD 11-29-20

SHEET TITLE
BUILDING SECTIONS & INTERIOR ELEVATIONS

SHEET NUMBER
A-3.2
OF

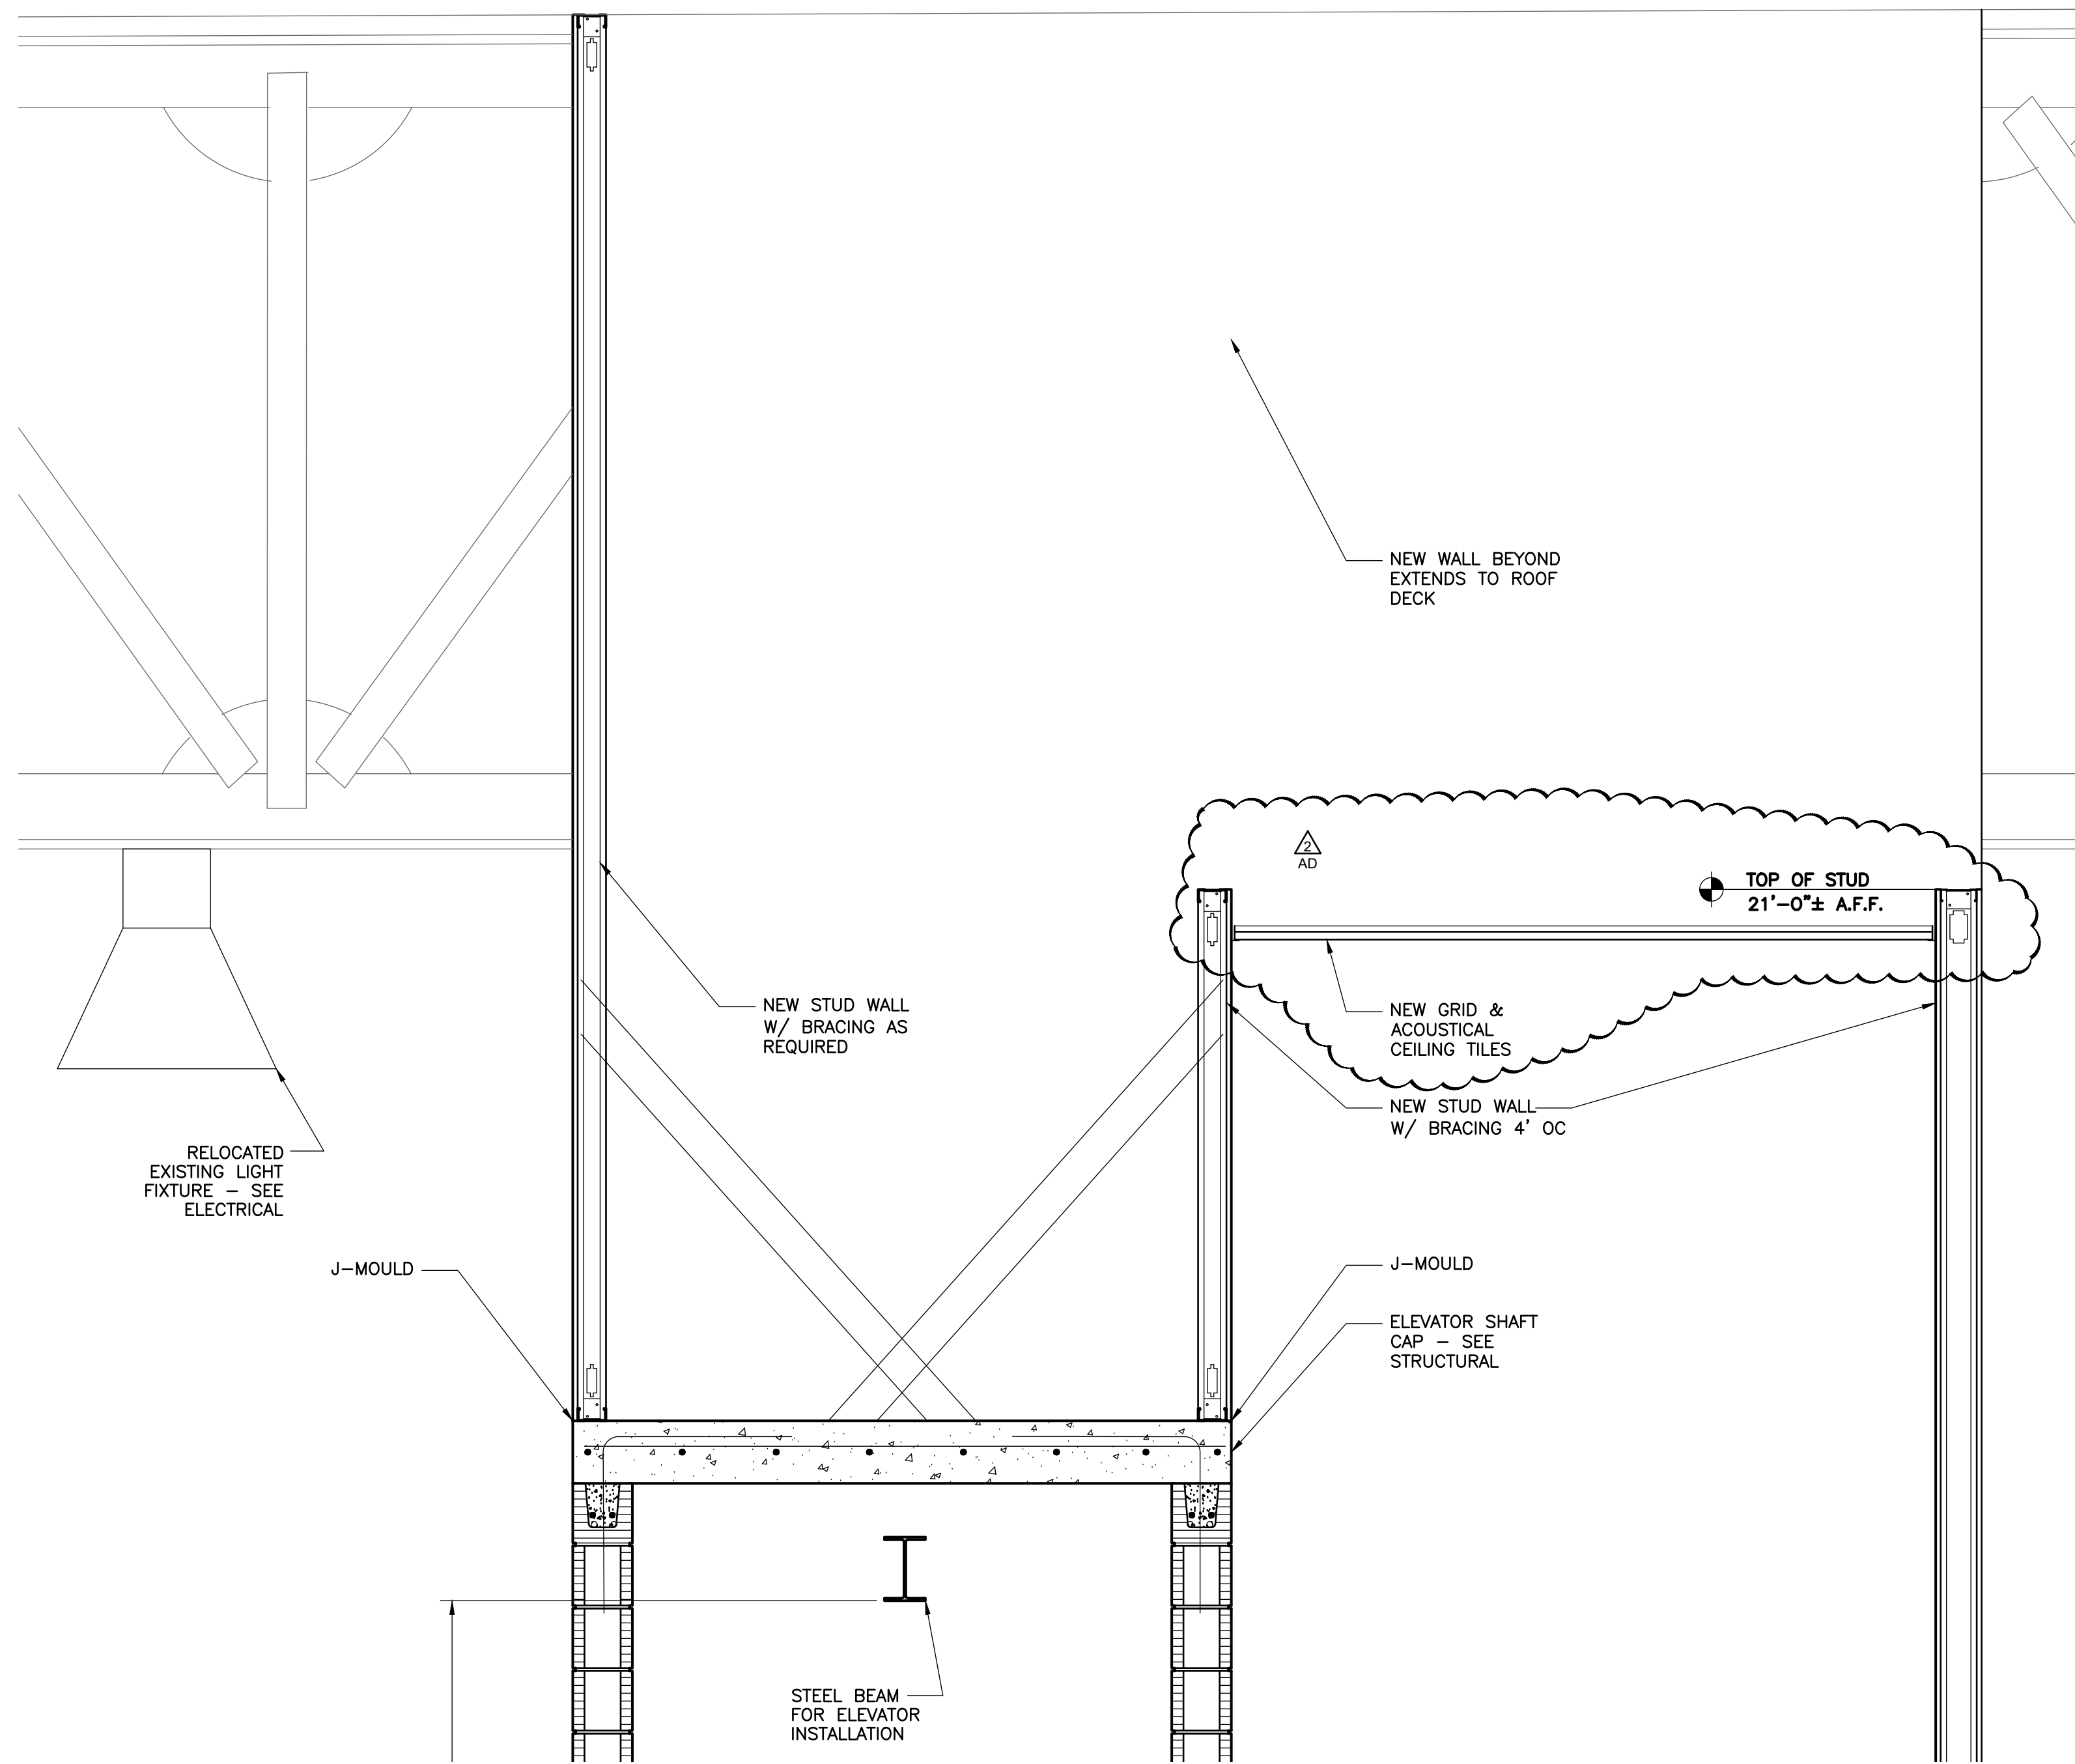

2 ELEVATOR SECTION
A-3.3 SCALE: 1/4" = 1'-0"

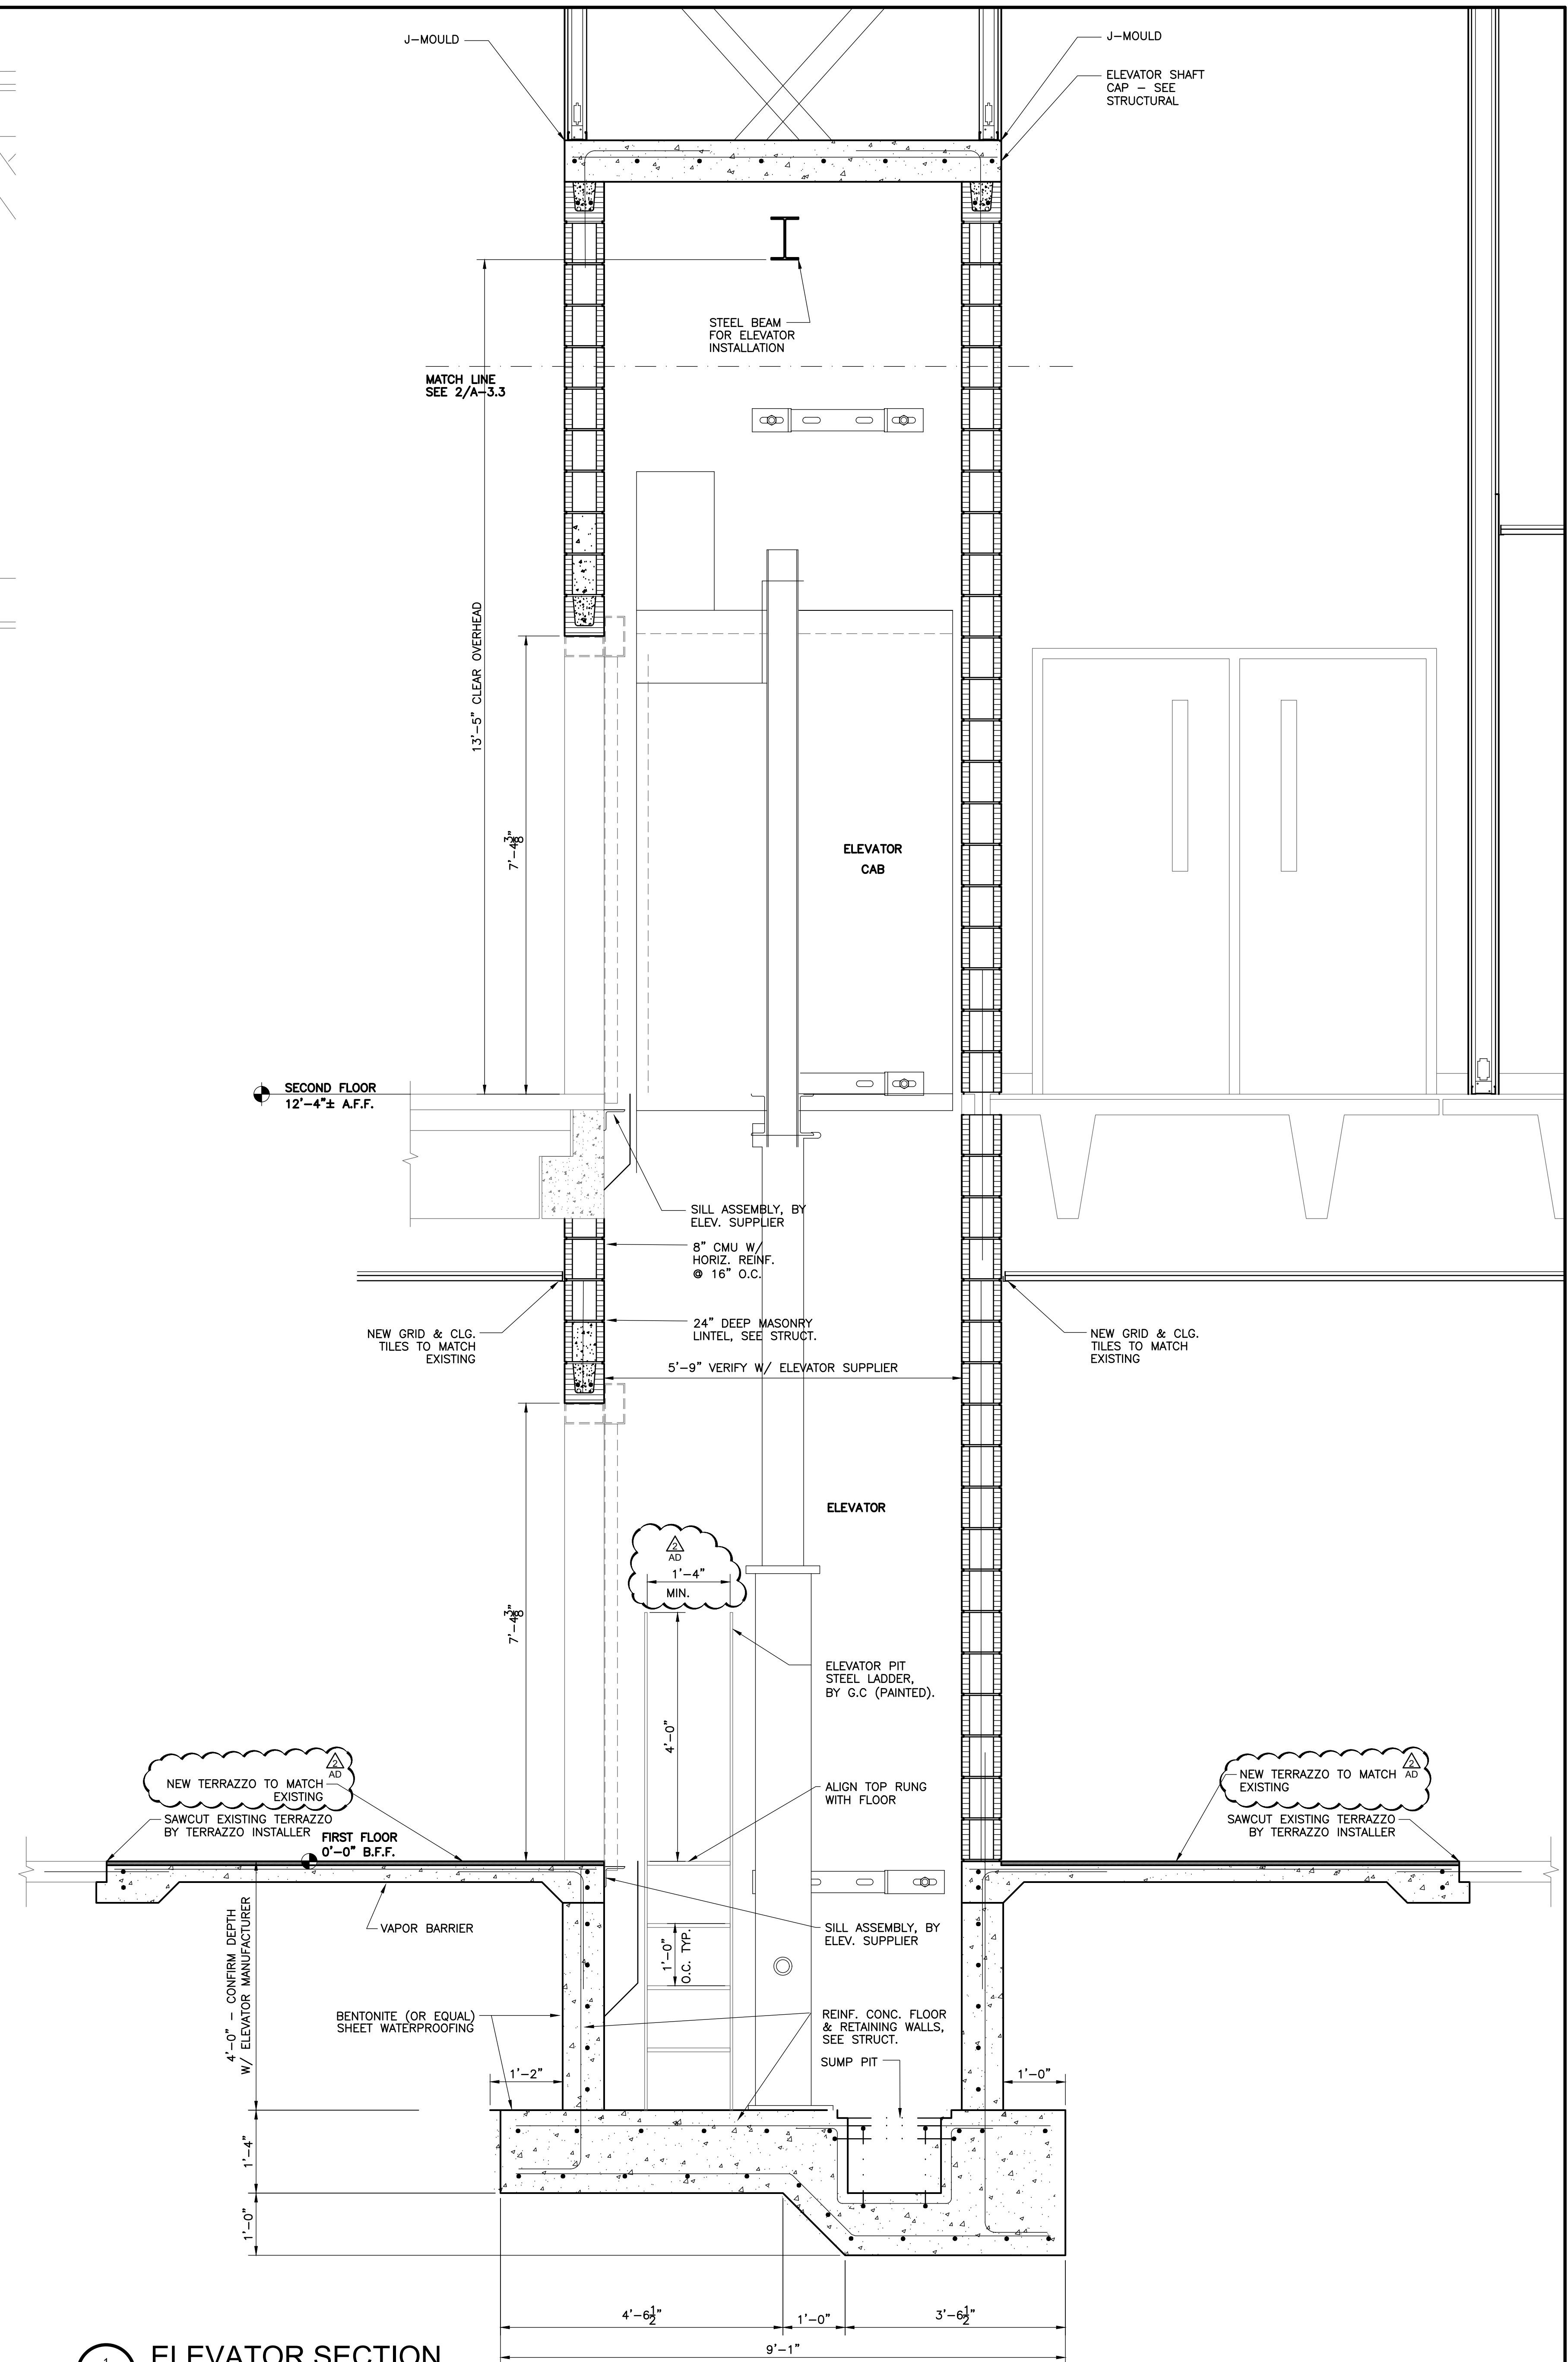

1 ELEVATOR SECTION
A-3.3 SCALE: 1/4" = 1'-0"



NOLA VANPURSEUM
ARCHITECTS, PC
MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
301 JEFFERSON STREET
HUNTSVILLE, ALABAMA 35891
(256) 535-6617
NVPARCHITECTS.COM

THIS DRAWING MAY NOT BE
REPRODUCED IN WHOLE OR IN
PART WITHOUT THE CONSENT OF
NOLA VANPURSEUM ARCHITECTS

ALABAMA A&M UNIVERSITY
ELMORE SPORTS MEDICINE RENOVATIONS
NORMAL, ALABAMA



JOB NUMBER
20132

ESN / RVP / 09.03.20
DRAWN / CHECKED / DATE

REVISIONS	
AD	11-29-20


SHEET TITLE
BUILDING SECTIONS

SHEET NUMBER
A-3.3
OF

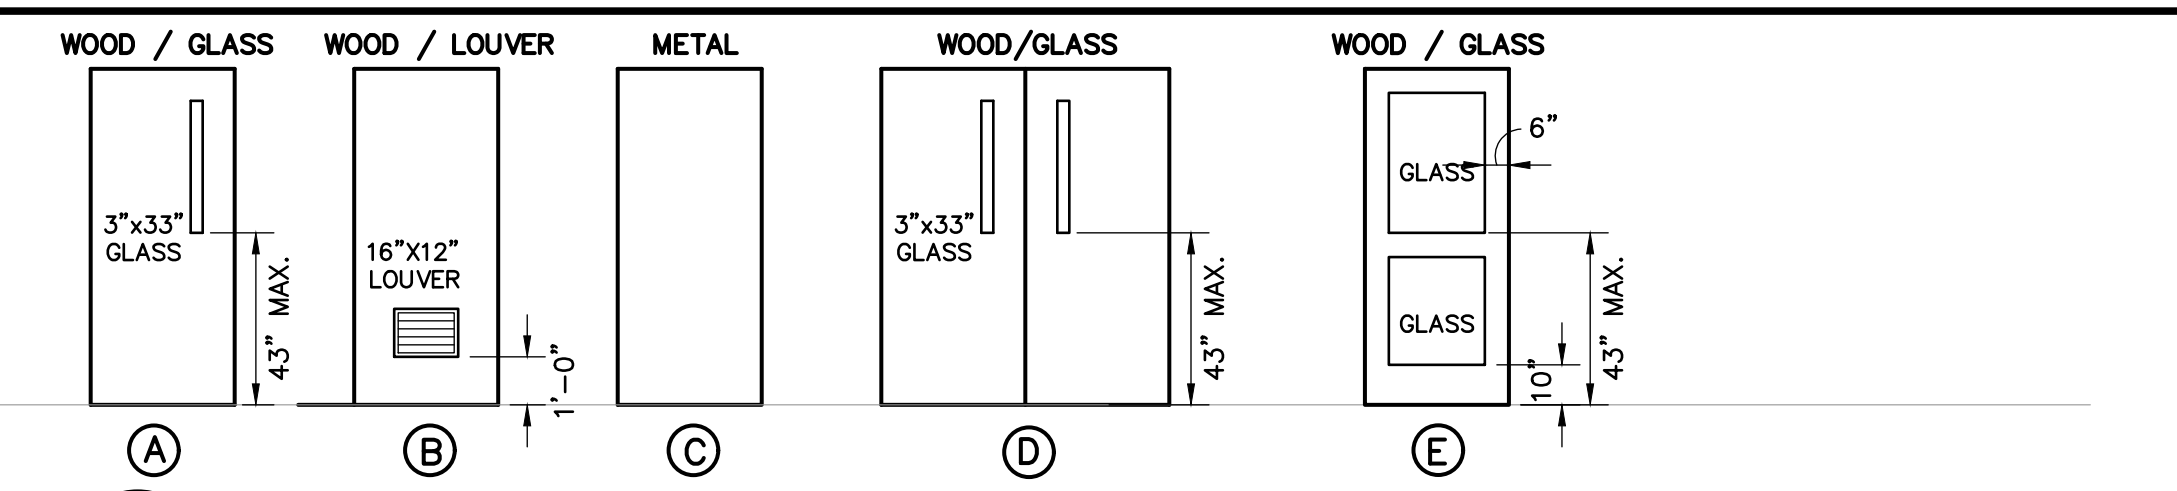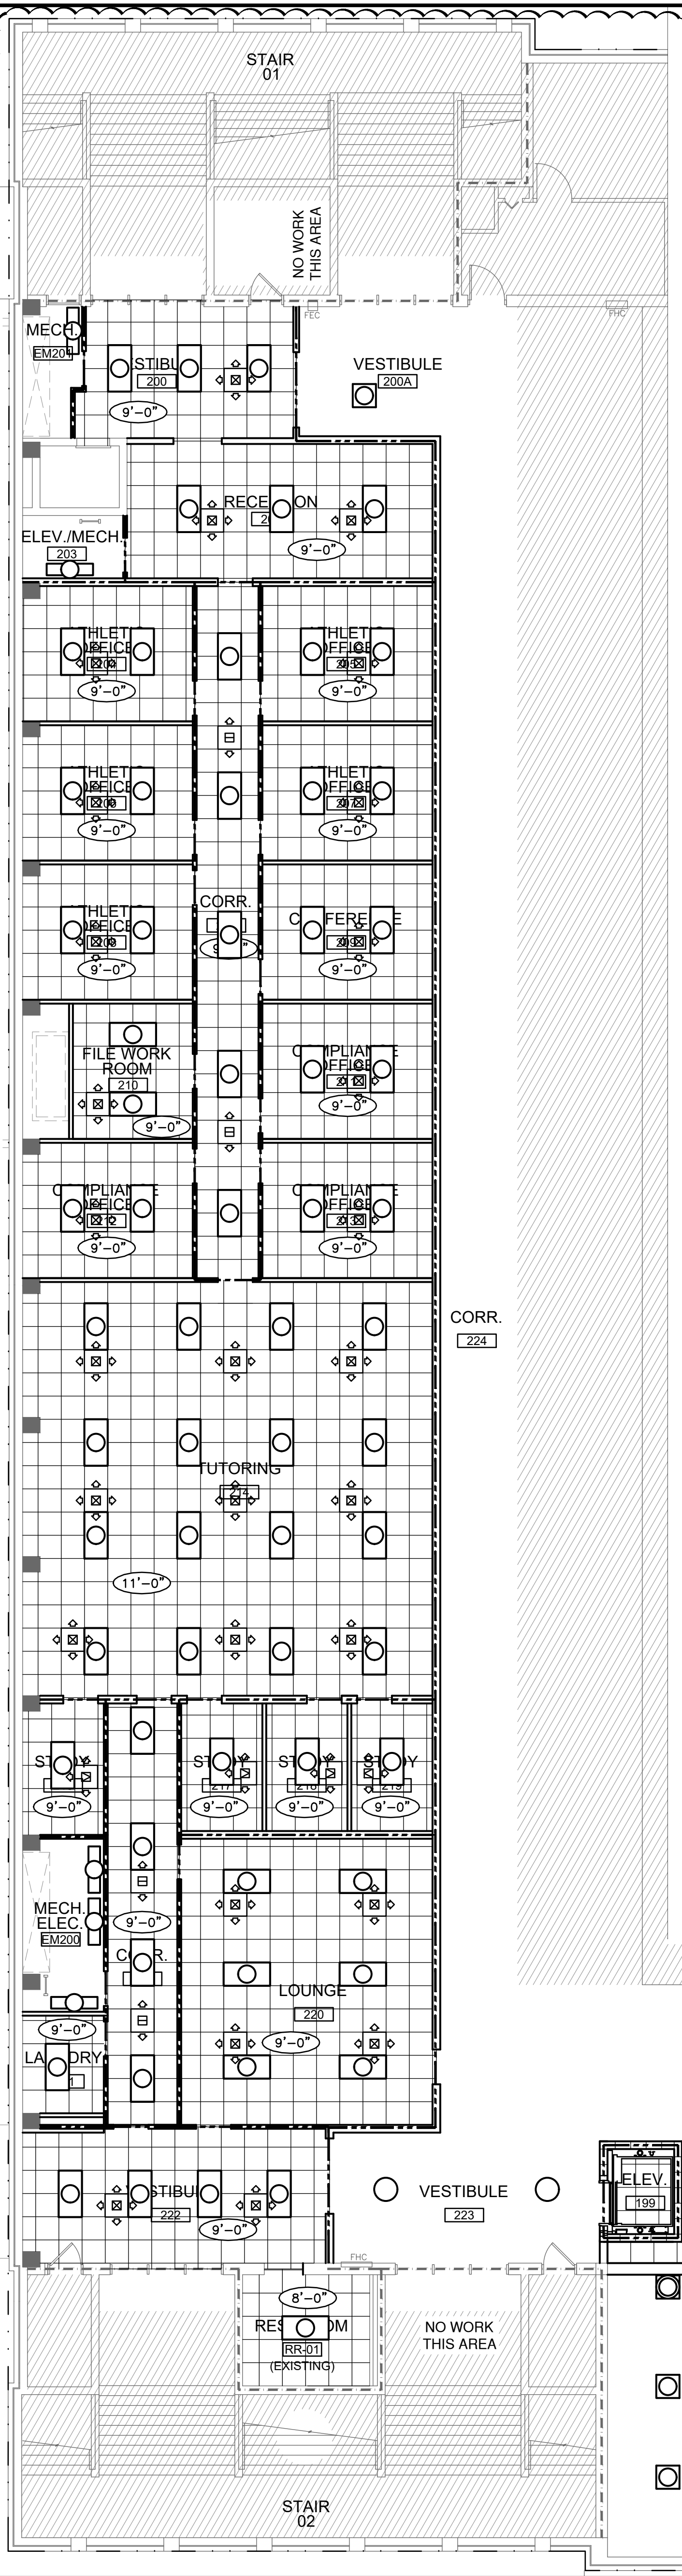


DOOR TYPES
SCALE: 1/4" = 1'-0"


NOTES: 1. CONTRACTOR TO COORDINATE PANIC HARDWARE W/ GLASS IN DOORS TO PREVENT OVERLAP.
2. ALL GLASS LITES IN AND ADJACENT TO NON-RATED DOORS SHALL BE TEMPERED GLASS.
3. ALL WOOD DOORS NOTED ON SCHEDULE ARE PRE-FINISHED WOOD DOORS. SEE SPECS.
4. ALL METAL DOORS SHALL BE PAINTED.

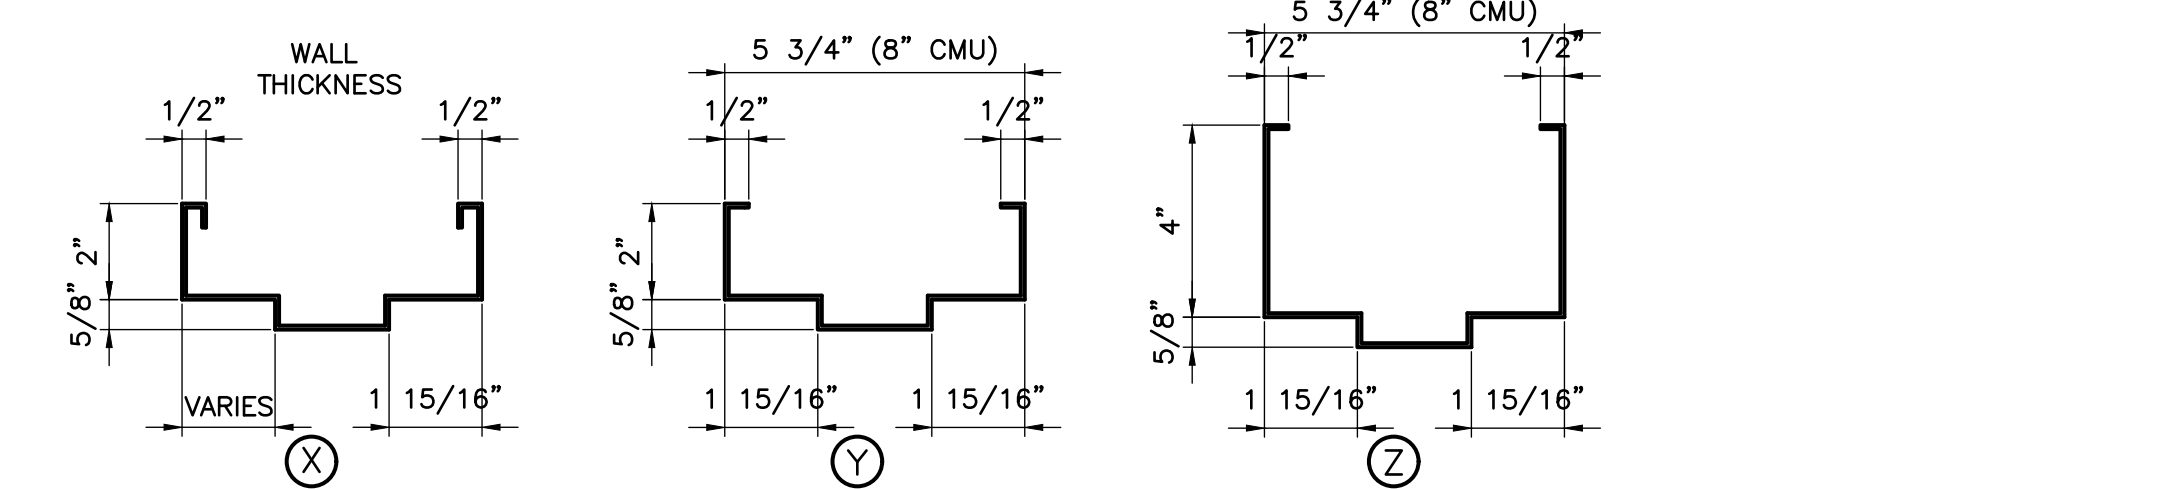

HOLLOW METAL DOOR FRAME DETAILS
SCALE: N.T.S.

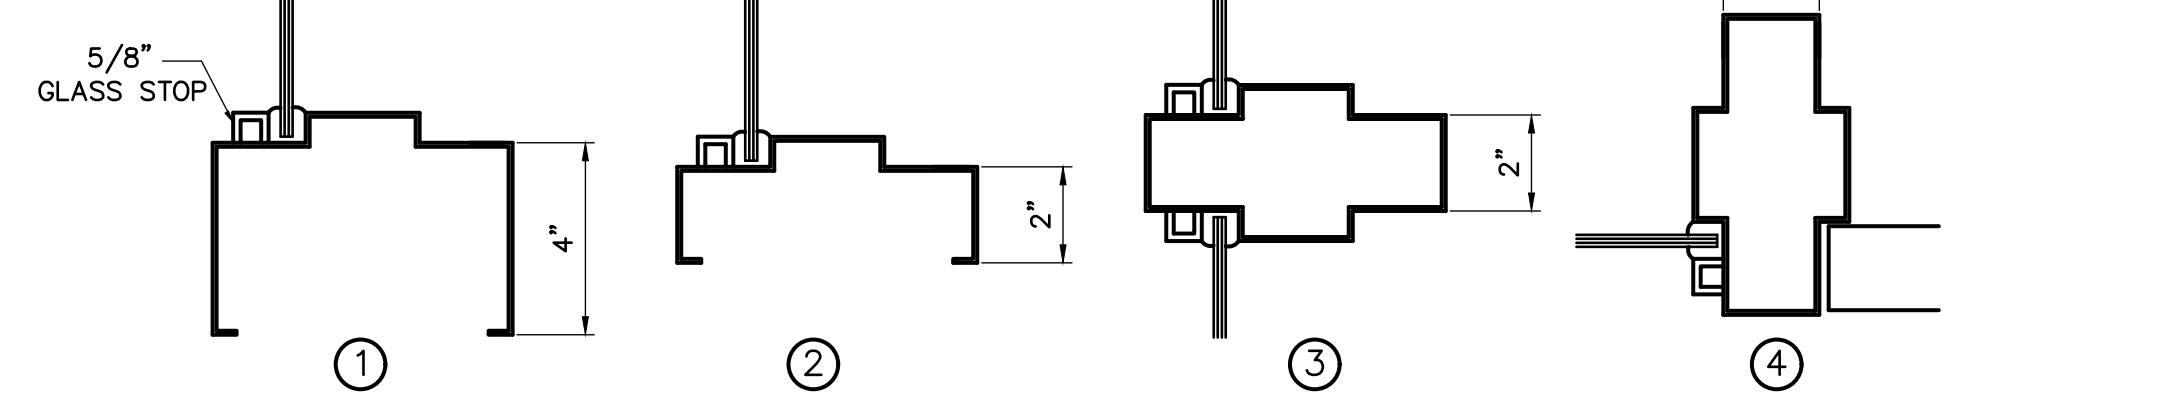


HOLLOW METAL DOOR & WINDOW FRAME DETAILS
SCALE: N.T.S.

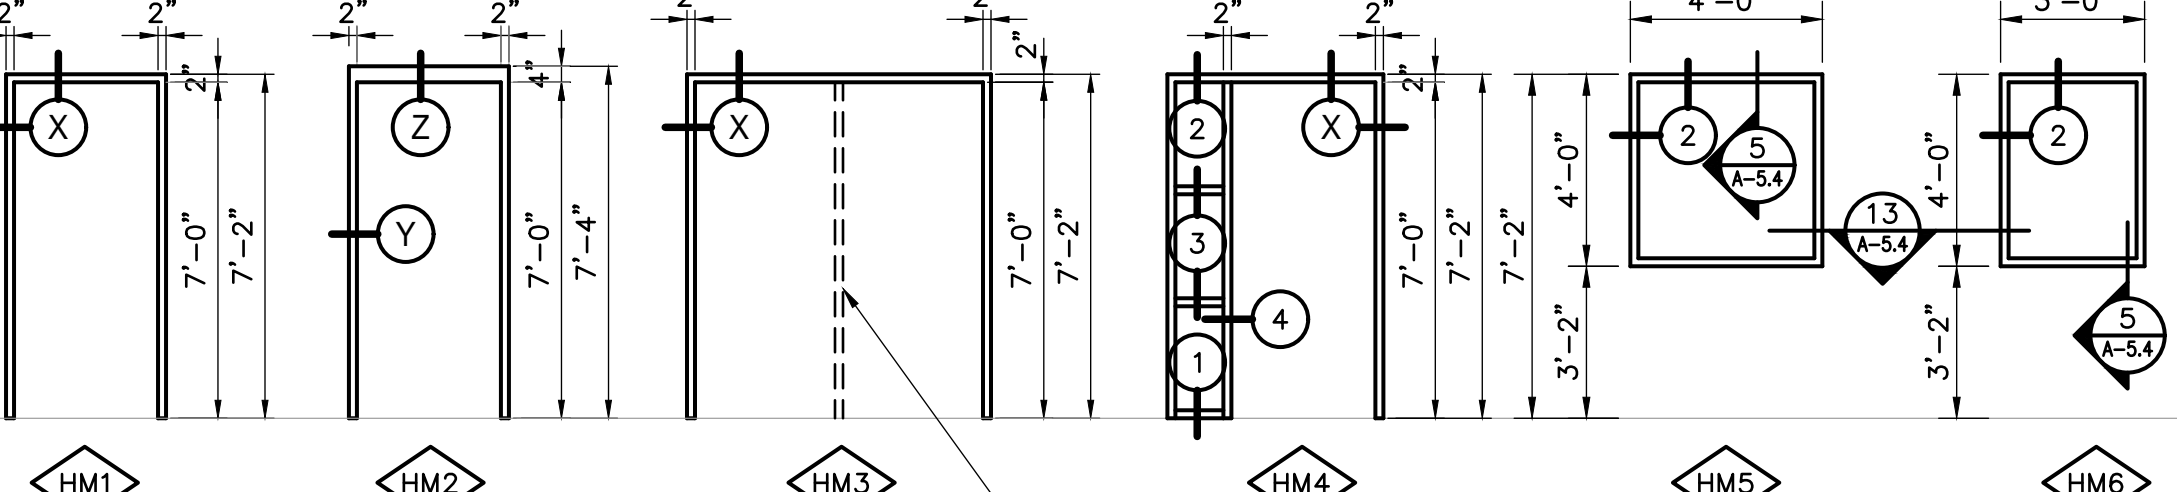



HOLLOW METAL DOOR & WINDOW FRAME ELEVATIONS
SCALE: 1/4" = 1'-0"

NOTES: 1. PROVIDE SAFETY GLASS AT ALL RATED WALL LOCATIONS.
2. PROVIDE TEMPERED GLASS AT LOCATIONS ADJACENT TO DOORS.
3. ALL HOLLOW METAL FRAMES SHALL BE PAINTED.

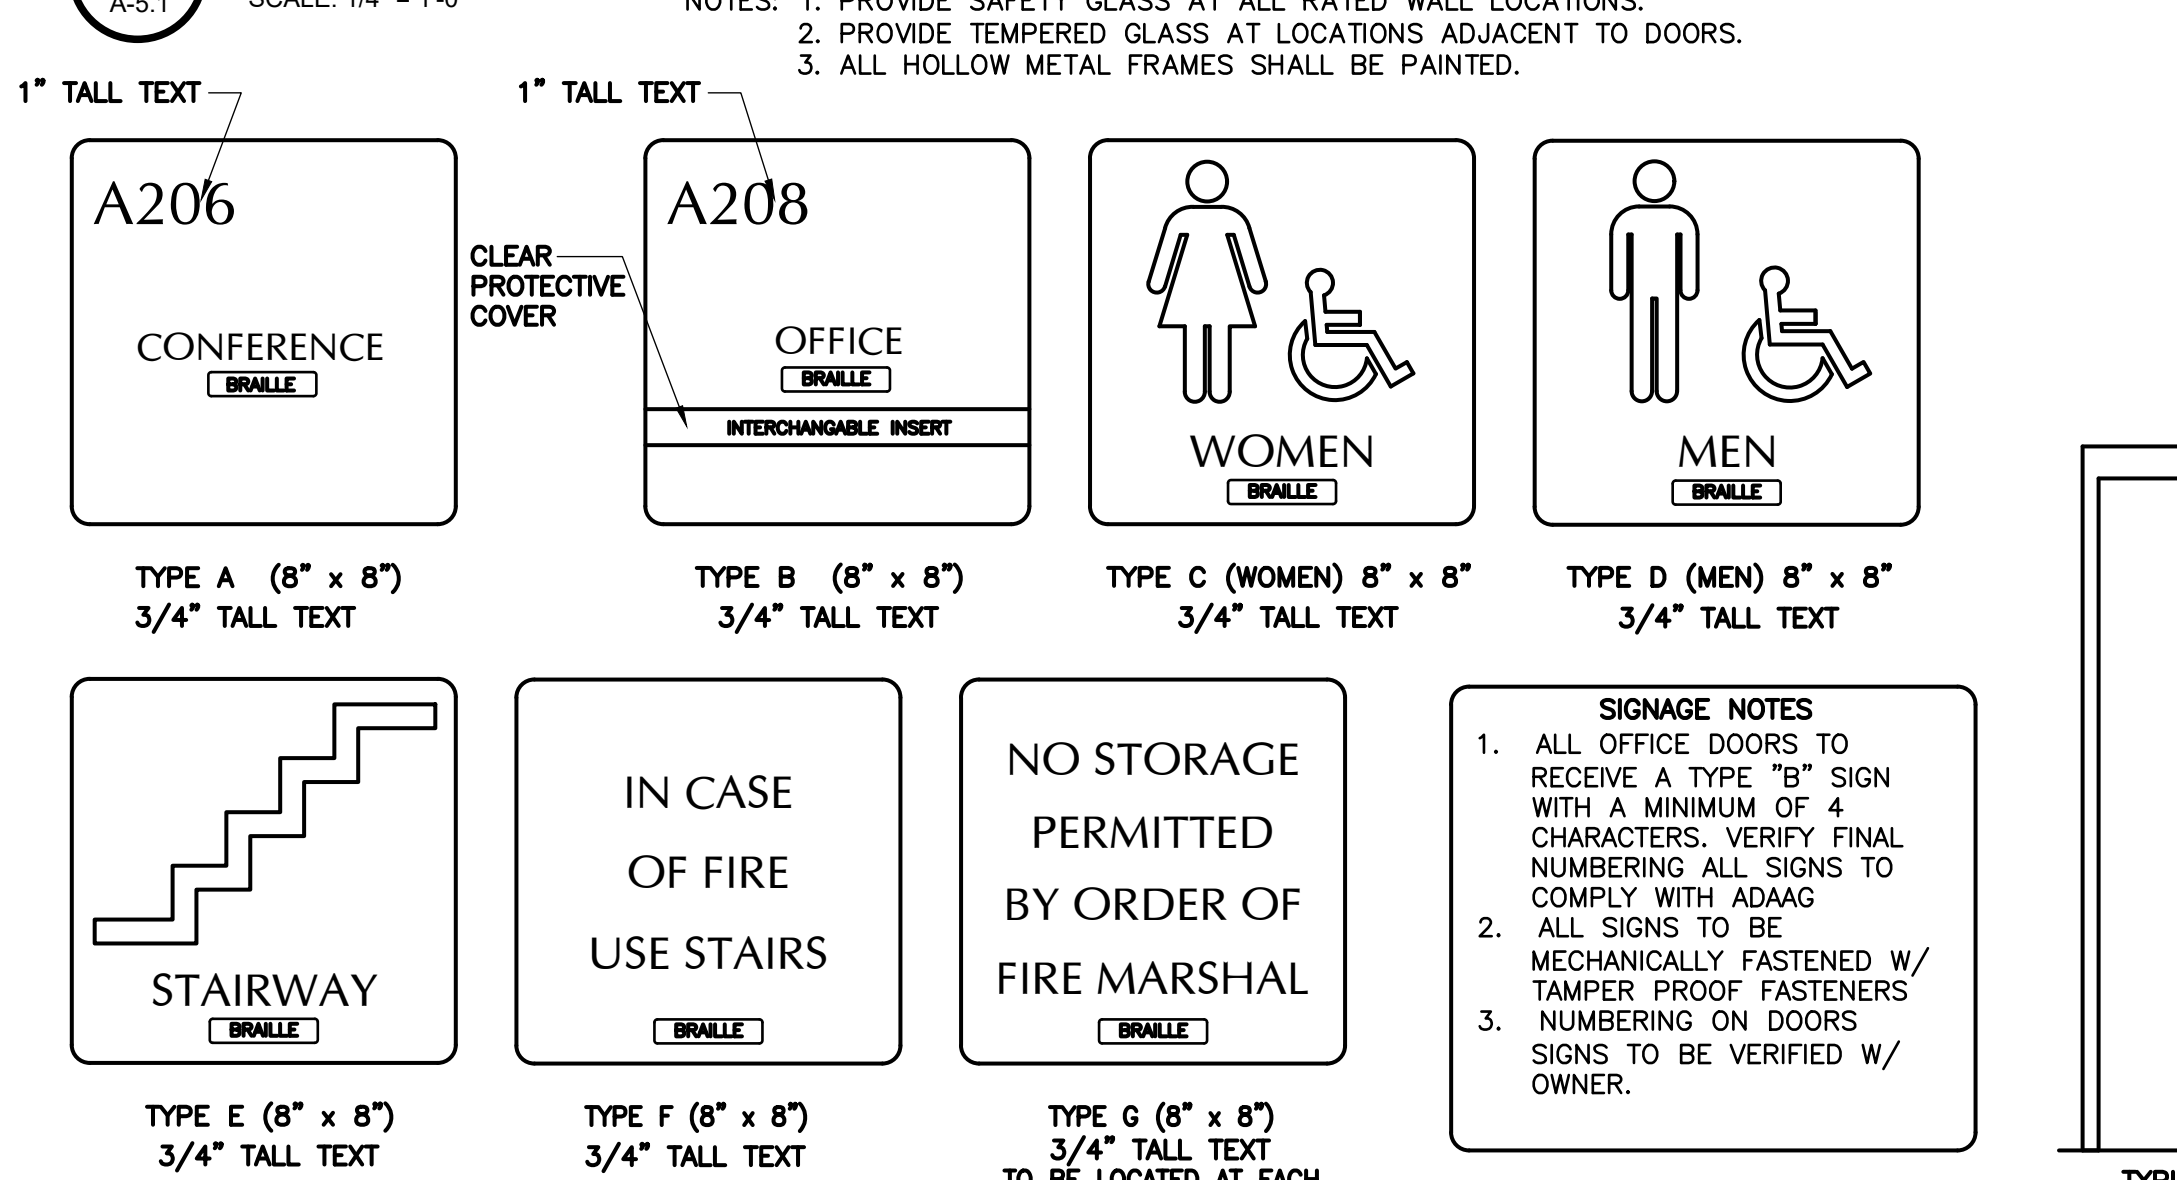

DOOR & DIRECTIONAL SIGN DETAILS
SCALE: 3" = 1'-0"

DOOR SCHEDULE														
DOOR NO.	LOCATION	DOORS			FIRE RATING	FRAMES			DETAILS			DOOR SIGN	COMMENTS	
		TYPE	W x H x T	MAT'L.		FINISH	TYPE	MAT'L.	FINISH	HEAD	JAMB			SILL
1ST FLOOR														
199.1	LOBBY TO ELEVATOR	---	---	---	---	---	---	---	---	---	---	---	---	TYPE "F"
2ND FLOOR														
199.2	VESTIBULE TO ELEVATOR	---	---	---	---	---	---	---	---	---	---	---	---	TYPE "F"
200.1	VESTIBULE TO VESTIBULE	D	RR 3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-3	HM	PT	---	---	---	---	REMOVABLE MULLION
200.2	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	REMOVABLE MULLION
200.3	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	REMOVABLE MULLION
200.4	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	REMOVABLE MULLION
200.5	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	REMOVABLE MULLION
200A.2	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	REMOVABLE MULLION
200A.3	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	REMOVABLE MULLION
201	RECEPTION TO VESTIBULE	E	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	
202	RECEPTION TO CORRIDOR	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	
203	RECEPTION TO MECHANICAL	B	3'-0"x7'-0"x1-3/4"	HM	PT	90 MN	HM-1	HM	PT	1	3	6	---	TYPE "A" MECHANICAL
204	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
205	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
206	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
207	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
208	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
209	CORRIDOR TO CONFERENCE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" CONFERENCE
210	CORRIDOR TO FILE WORK ROOM	B	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" WORK ROOM
211	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
212	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
213	CORRIDOR TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
214.1	TUTORING TO CORRIDOR	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" TUTORING
214.2	TUTORING TO CORRIDOR	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" TUTORING
215	TUTORING TO STUDY	A	3'-0"x7'-0"x1-3/4"	WD	ST	20 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDY
216	CORRIDOR TO VESTIBULE	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	
217	TUTORING TO STUDY	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDY
218	TUTORING TO STUDY	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDY
219	TUTORING TO STUDY	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDY
220.1	CORRIDOR TO LOUNGE	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDENT LOUNGE
220.2	LOUNGE TO VESTIBULE	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDENT LOUNGE
220.3	LOUNGE TO CORRIDOR	A	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	1	3	5	---	TYPE "A" STUDENT LOUNGE
221	CORRIDOR TO LAUNDRY	B	3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-1	HM	PT	---	---	---	---	TYPE "A" LAUNDRY
222.1	VESTIBULE TO VESTIBULE	D	RR 3'-0"x7'-0"x1-3/4"	WD	ST	90 MN	HM-3	HM	PT	---	---	---	---	REMOVABLE MULLION
222.2	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	
222.3	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	
222.4	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	
223.1	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	
223.2	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	
223.3	VESTIBULE TO STAIR	A	3'-0"x6'-8"x1-3/4"	WD	ST	60 MN	EXISTING	HM	PT	---	---	---	---	
226.1	VESTIBULE TO STAIR	EXISTING	3'-0"x6'-8"x1-3/4"	WD	EXISTING	60 MN	EXISTING	HM	PT	---	---	---	---	RELOCATED EXISTING DOOR
226.2	VESTIBULE TO STAIR	EXISTING	3'-0"x6'-8"x1-3/4"	WD	EXISTING	60 MN	EXISTING	HM	PT	---	---	---	---	RELOCATED EXISTING DOOR
226.3	VESTIBULE TO STAIR	EXISTING	3'-0"x6'-8"x1-3/4"	WD	EXISTING	60 MN	EXISTING	HM	PT	---	---	---	---	RELOCATED EXISTING DOOR
226.4	VESTIBULE TO STAIR	EXISTING	3'-0"x6'-8"x1-3/4"	WD	EXISTING	60 MN	EXISTING	HM	PT	---	---	---	---	RELOCATED EXISTING DOOR
226.5	VESTIBULE TO STAIR	EXISTING	3'-0"x6'-8"x1-3/4"	WD	EXISTING	60 MN	EXISTING	HM	PT	---	---	---	---	RELOCATED EXISTING DOOR
226.6	VESTIBULE TO STAIR	EXISTING	3'-0"x6'-8"x1-3/4"	WD	EXISTING	60 MN	EXISTING	HM	PT	---	---	---	---	RELOCATED EXISTING DOOR
250.1	CORRIDOR TO SPORTS MEDICINE TRAINING	D	RR 3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-3	HM	PT	1	3	6	---	TYPE "A" SPORTS MEDICINE TRAINING
250.2	CORRIDOR TO SPORTS MEDICINE TRAINING	A	3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-1	HM	PT	1	3	6	---	TYPE "A" SPORTS MEDICINE TRAINING
251	TRAINING TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
252	TRAINING TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
253	TRAINING TO FILE	A	3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-1	HM	PT	1	3	5	---	TYPE "A" WORK ROOM
254	TRAINING TO STORAGE	A	3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-1	HM	PT	1	3	5	---	TYPE "A" STORAGE
255	TRAINING TO OFFICE	A	3'-0"x7'-0"x1-3/4"	WD	ST	---	HM-1	HM	PT	1	3	5	---	TYPE "B" OFFICE
256	TRAINING TO MECH. MEZZ.	C	3'-0"x3'-0"x1-3/4"	HM	PT	---	HM-1	HM	PT	---	---	---	---	
ELECTRICAL/MECHANICAL														
EM201	CORRIDOR TO MECHANICAL/ELECTRICAL	C	3'-0"x6'-8"x1-3/4"	HM	PT	90 MN	HM-1	HM	PT	1	3	6	---	TYPE "A" MECHANICAL ELECTRICAL
EM201	VESTIBULE TO MECHANICAL	C	3'-0"x6'-8"x1-3/4"	HM	PT	90 MN	HM-1	HM	PT	1	3	6	---	TYPE "A" MECHANICAL
RESTROOM														
RR-01	VESTIBULE TO RESTROOM	B	3'-0"x6'-8"x1-3/4"	WD	ST	---	HM-2	HM	PT	2	4	6	---	TYPE "C" WOMEN
RR-02	VESTIBULE TO RESTROOM	B	3'-0"x6'-8"x1-3/4"	WD	ST	---	HM-2	HM	PT	2	4	6	---	TYPE "C" MEN

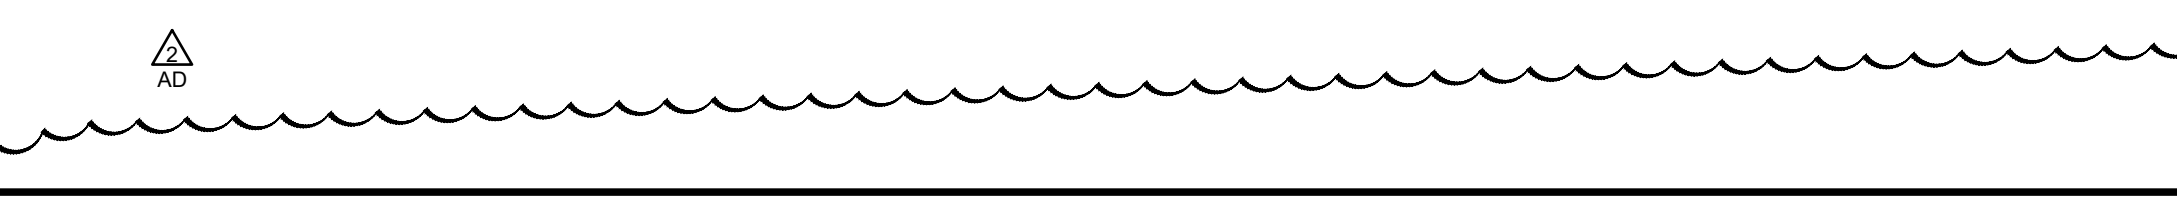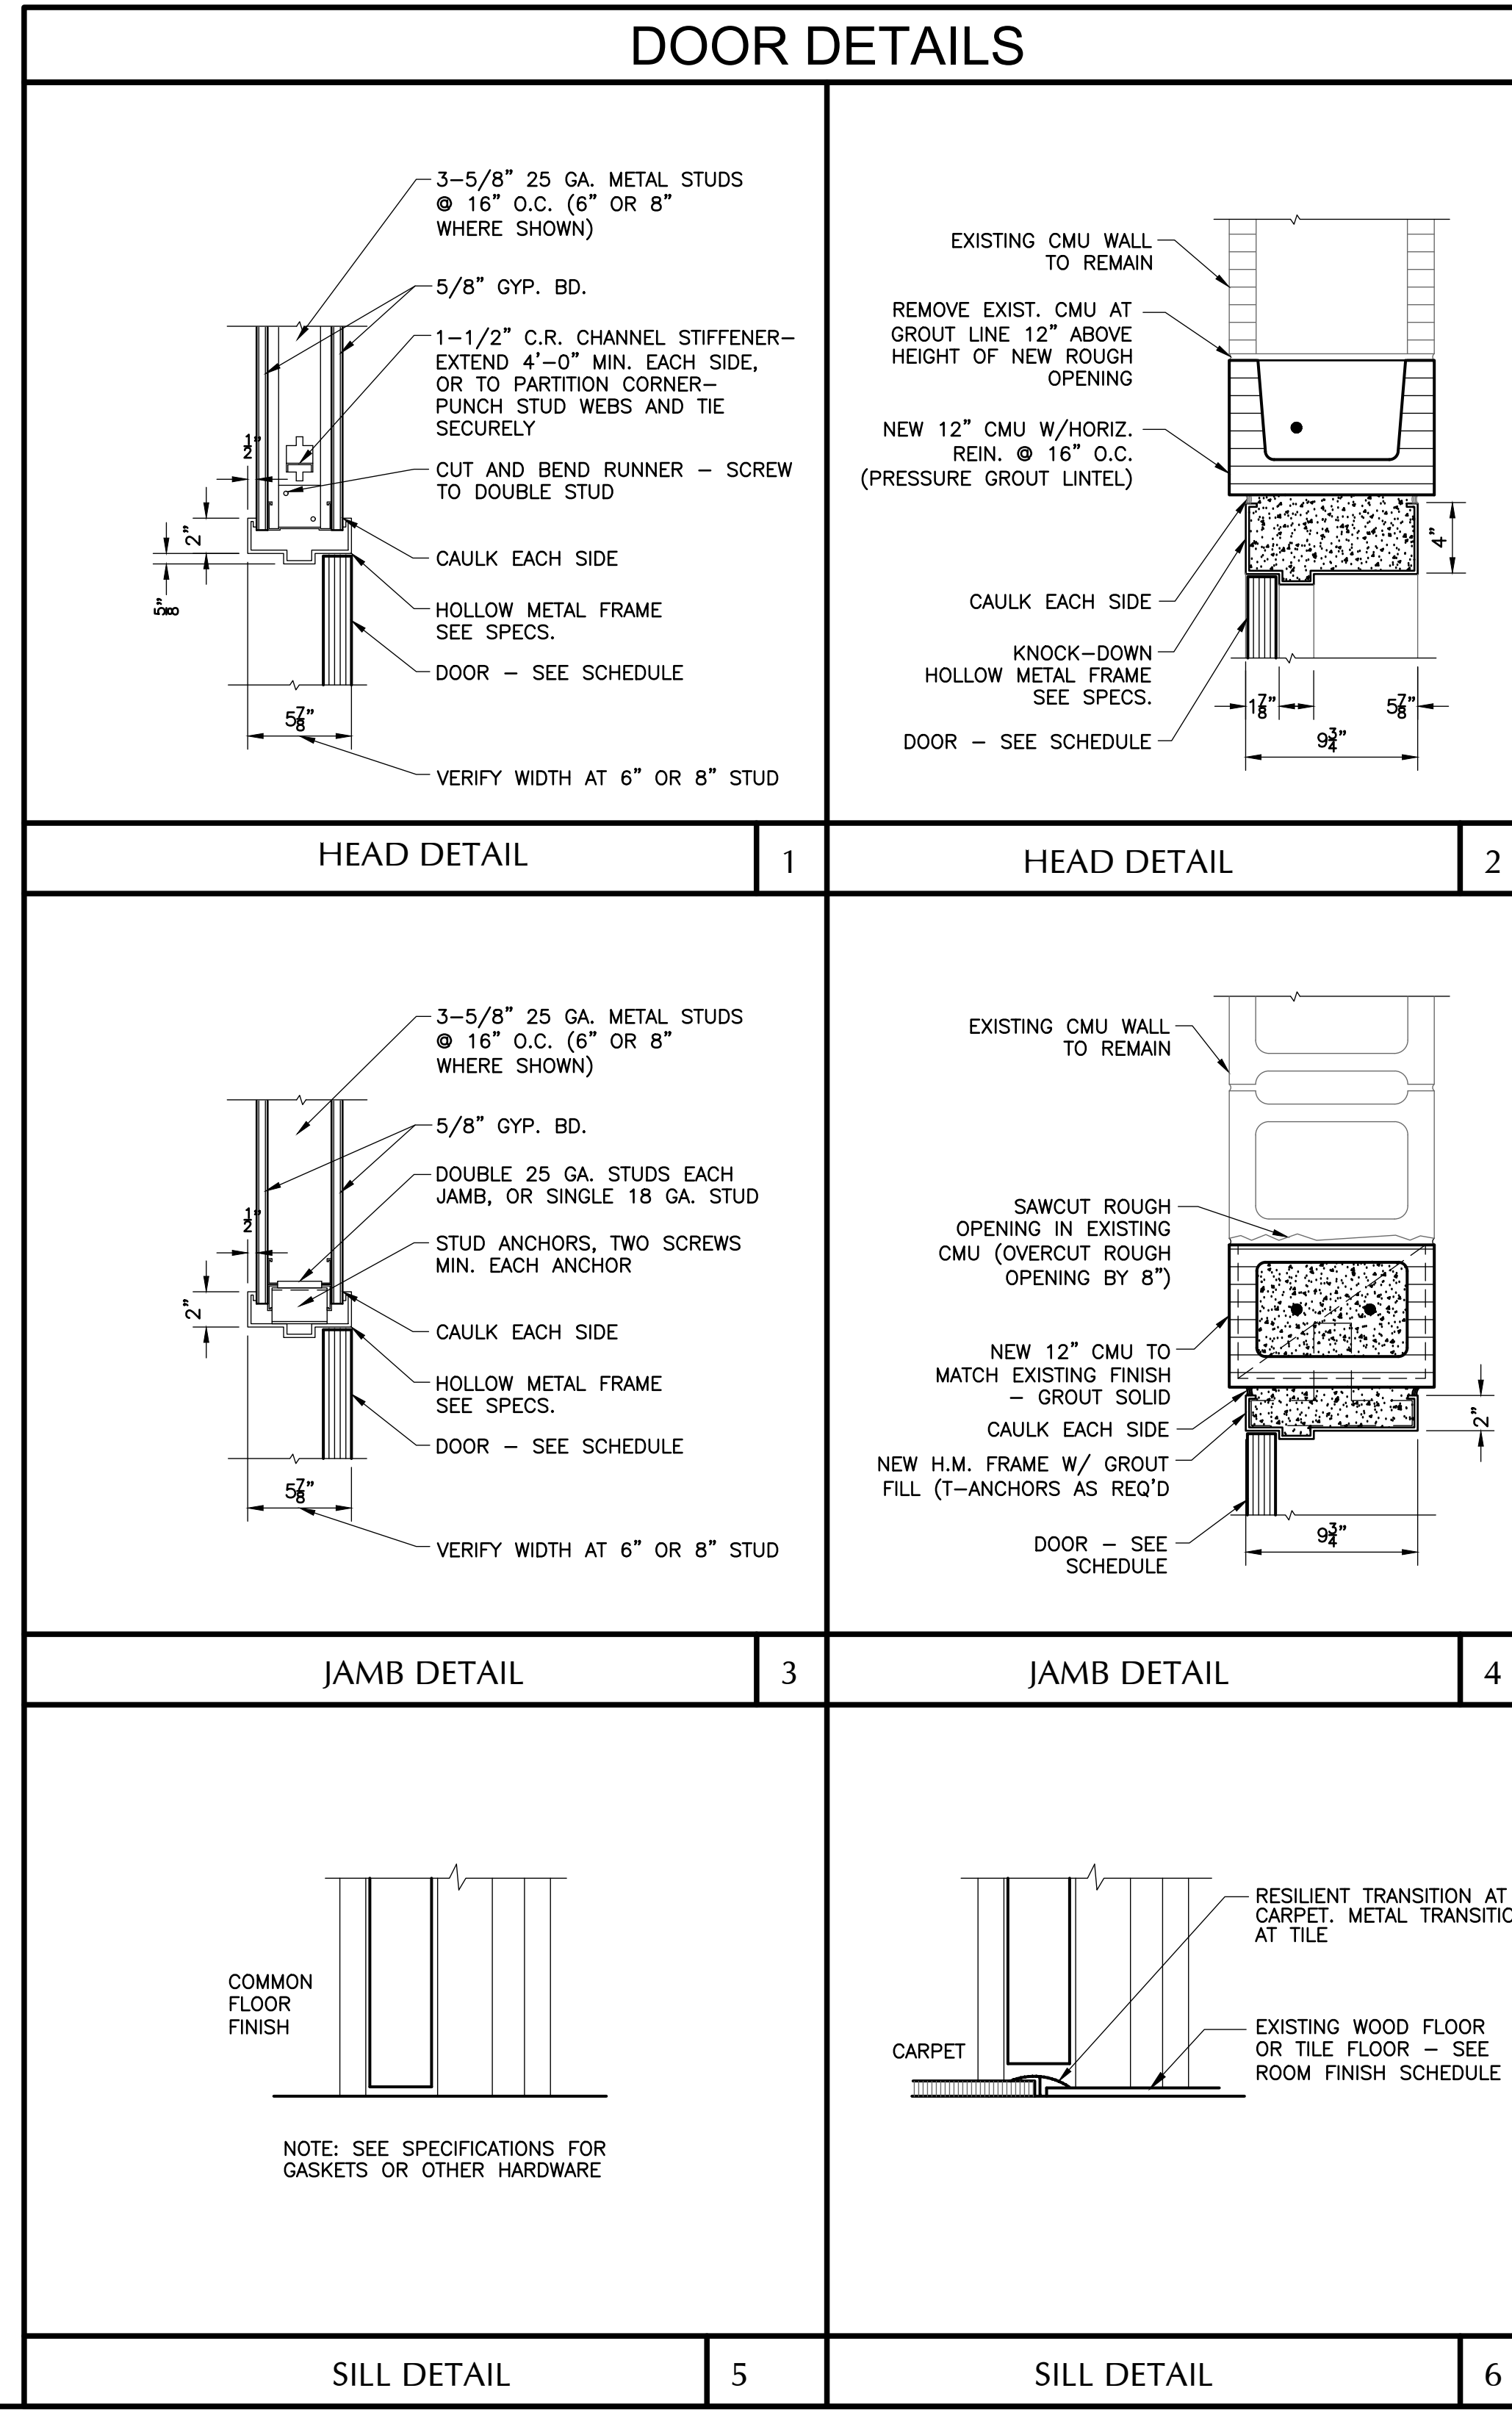

STATE OF ALABAMA
3871
REG. NO.
3535
REGISTERED ARCHITECTS

NOLA VANPURSEM
ARCHITECTS, PC

MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS

301 JEFFERSON STREET
HUNTSVILLE, ALABAMA 35891

(256) 535-6617
NVPARCHITECTS.COM

THIS DRAWING MAY NOT BE
REPRODUCED IN WHOLE OR IN
PART WITHOUT THE CONSENT OF
NOLA VANPURSEM ARCHITECTS

ALABAMA A&M UNIVERSITY
ELMORE SPORTS MEDICINE RENOVATIONS
NORMAL, ALABAMA




JOB NUMBER
20132

ESN / RVP / 09.03.20
DRAWN / CHECKED / DATE

REVISIONS
AD 11-20-20





SHEET TITLE
DOOR SCHEDULE
& DETAILS

SHEET NUMBER
A-5.1
OF

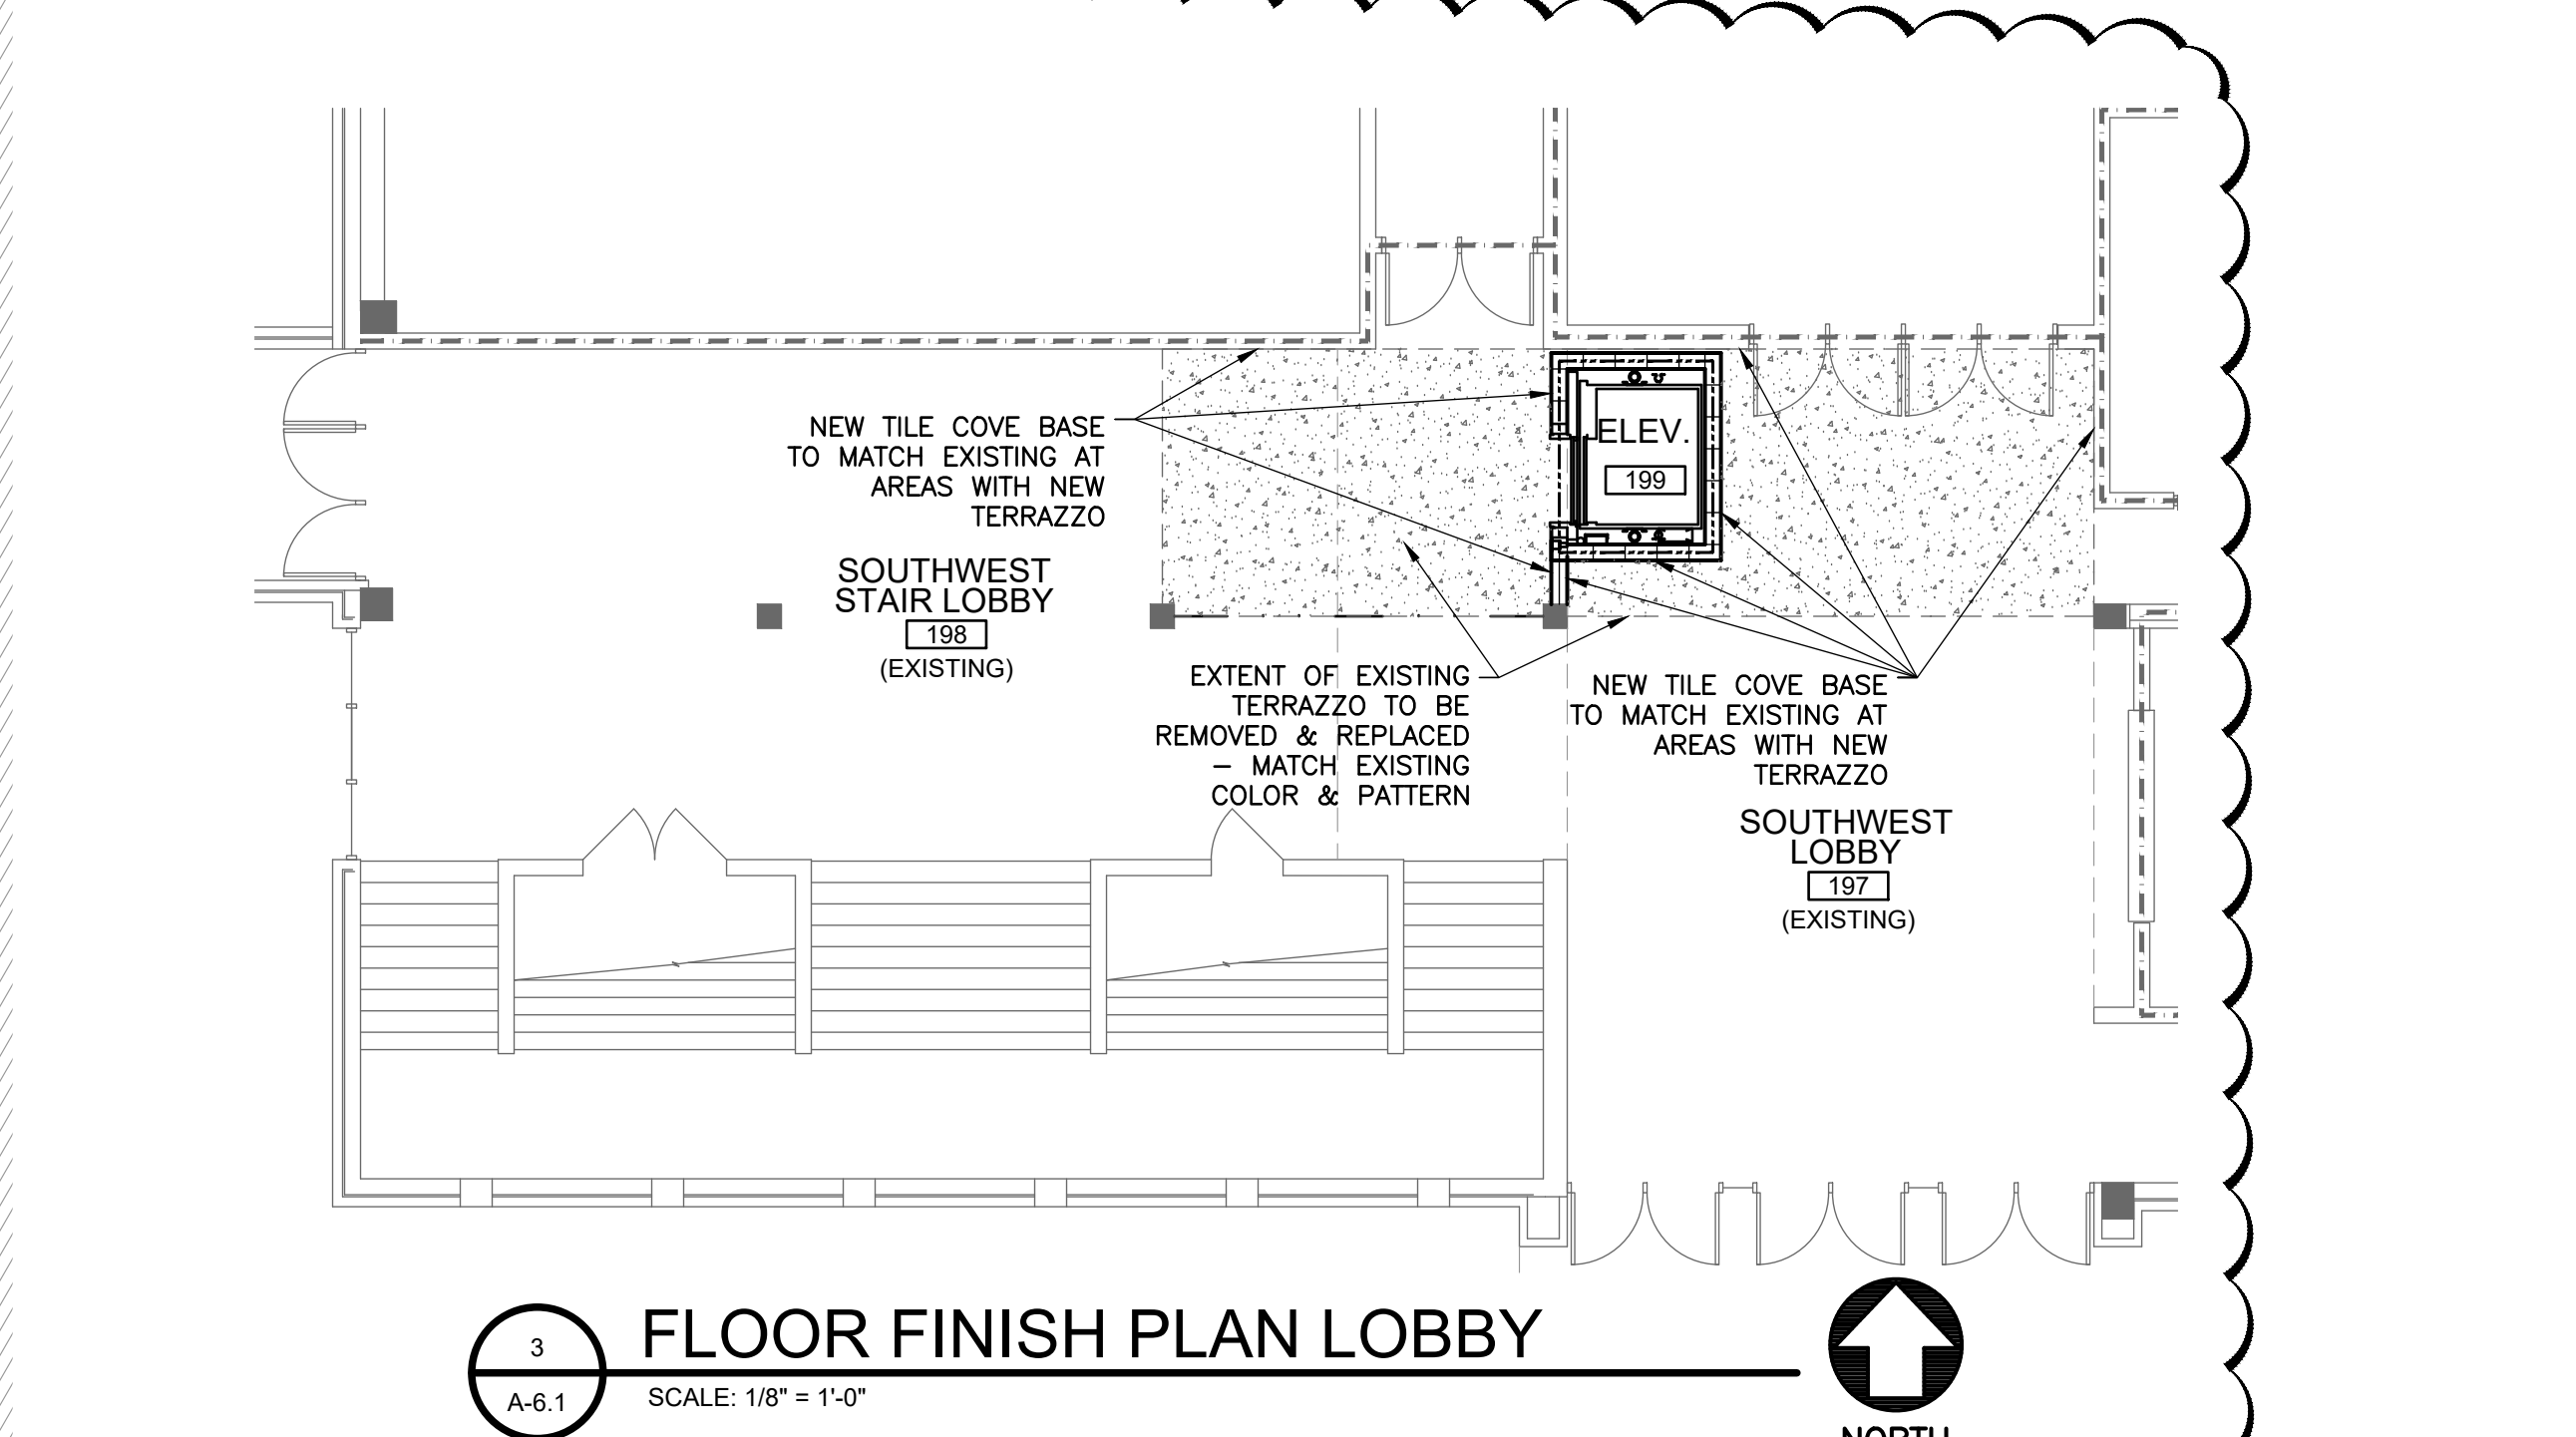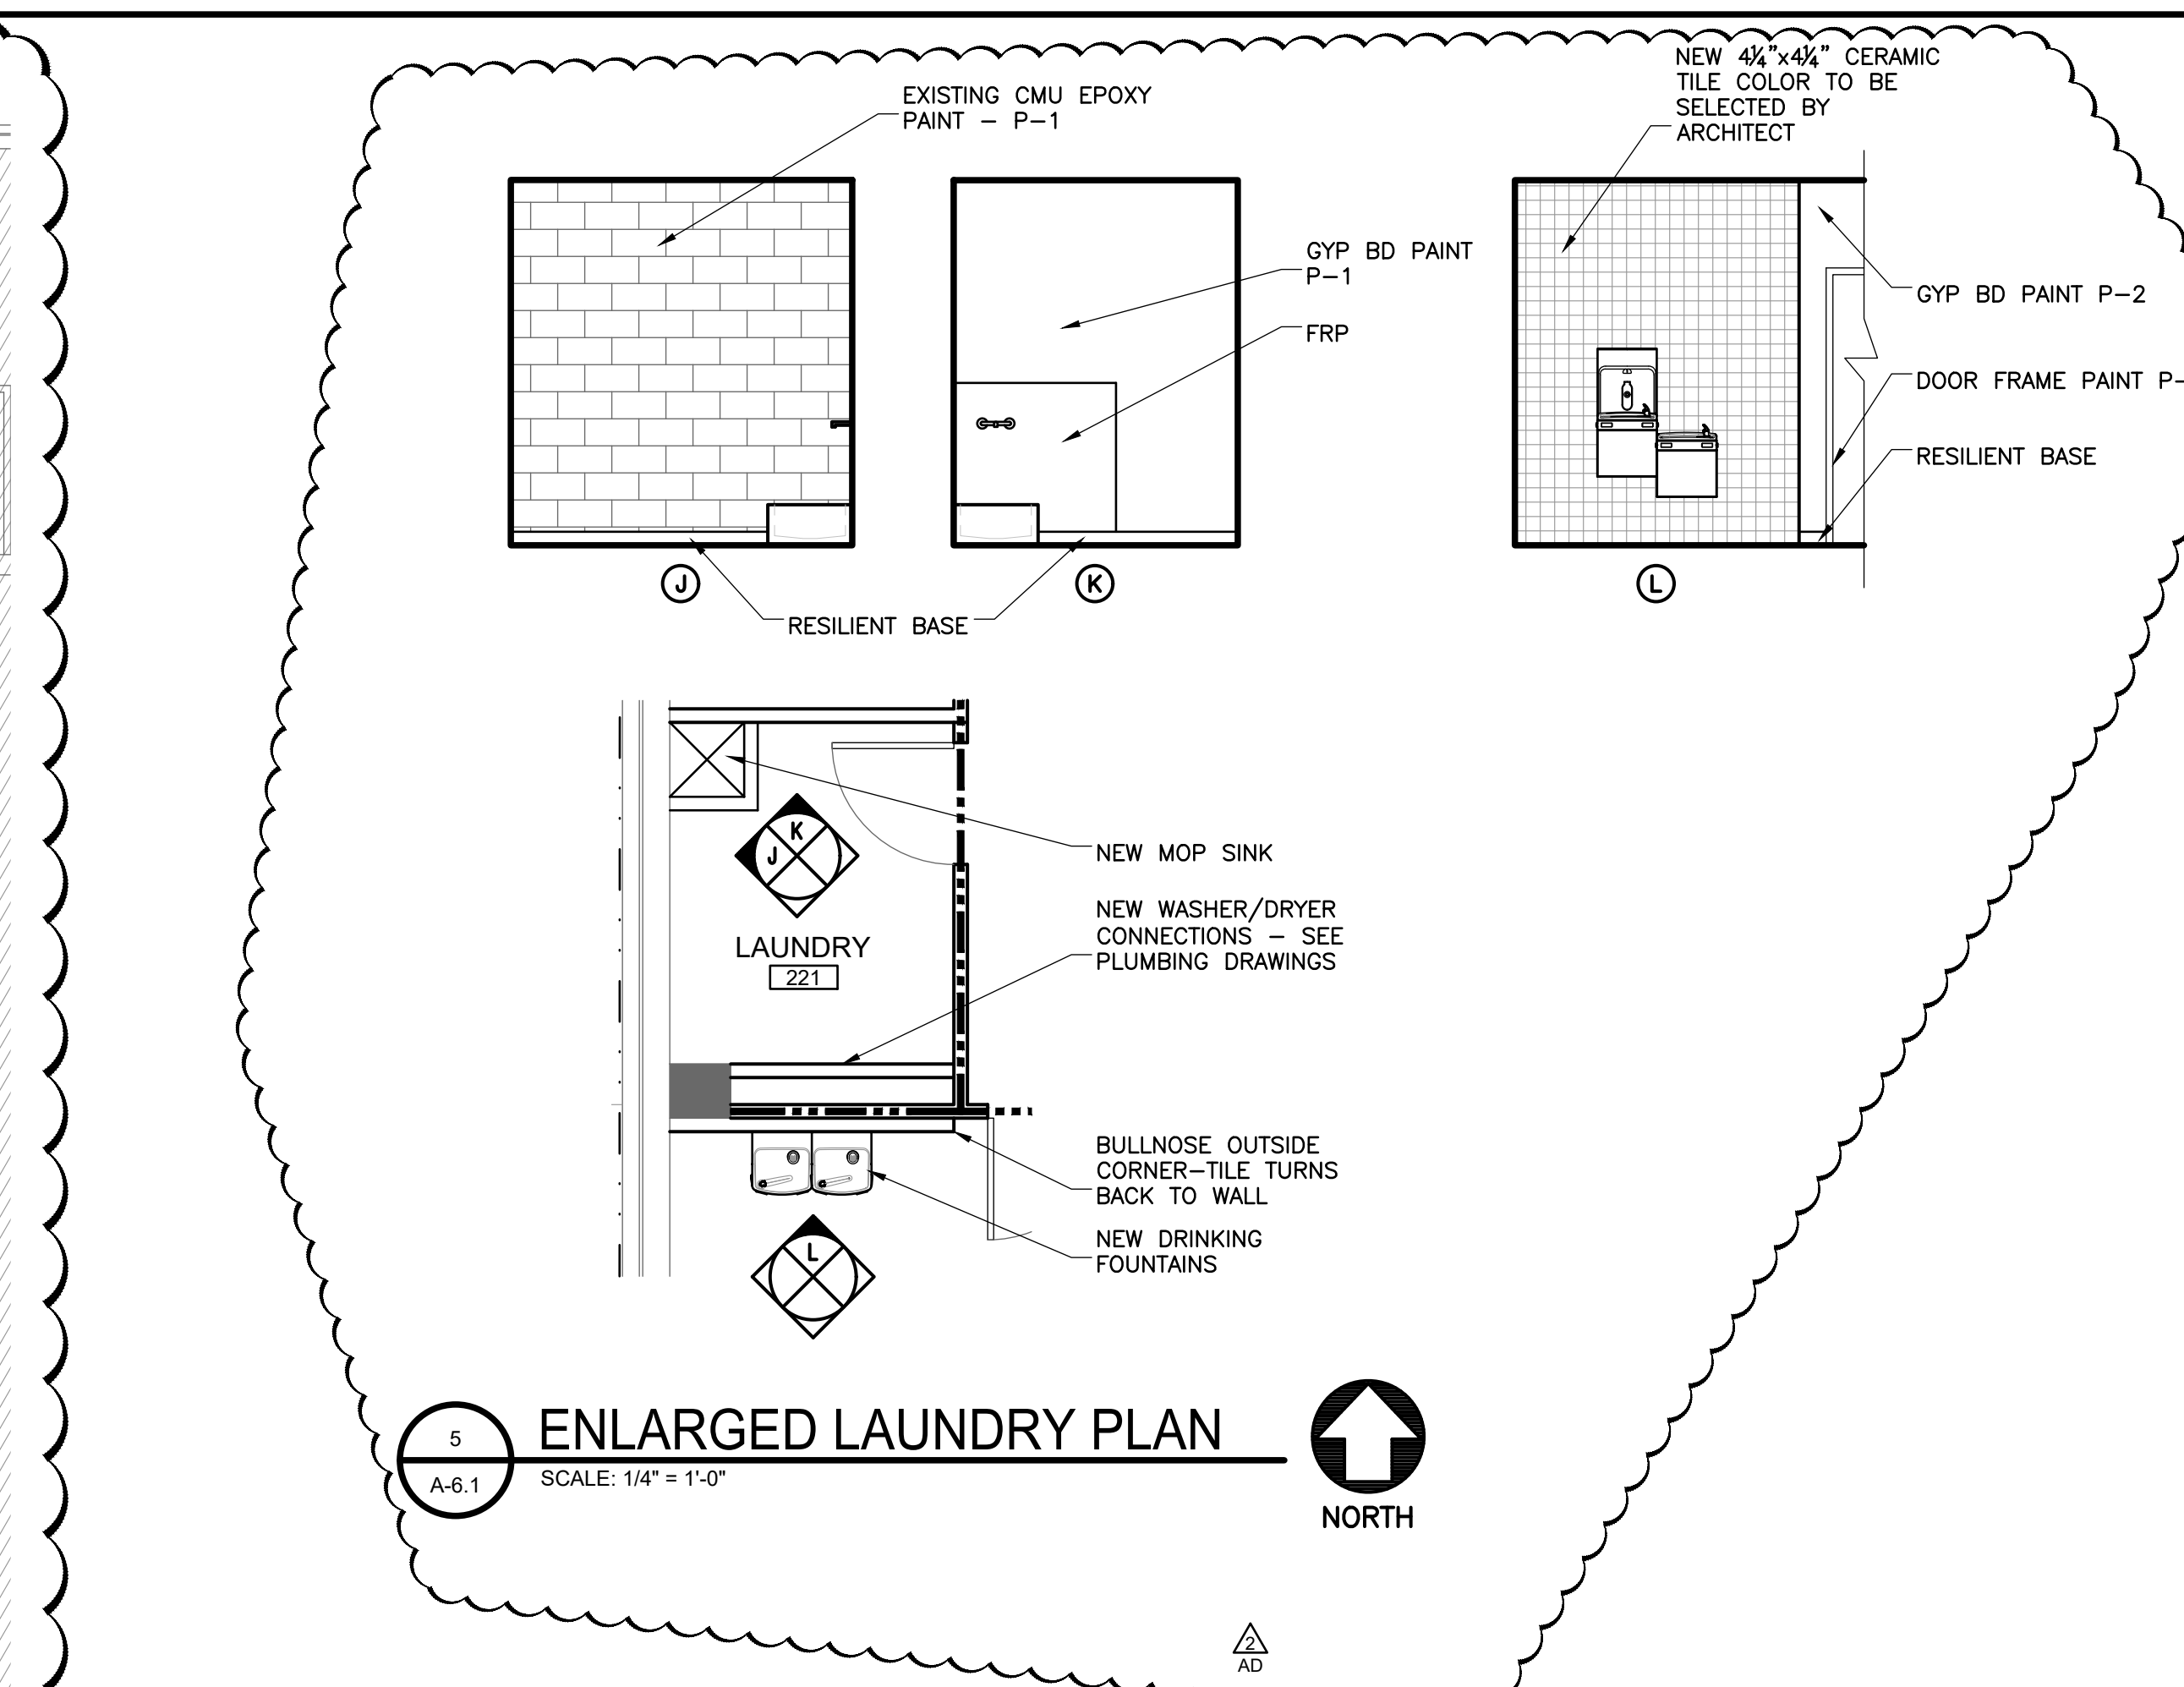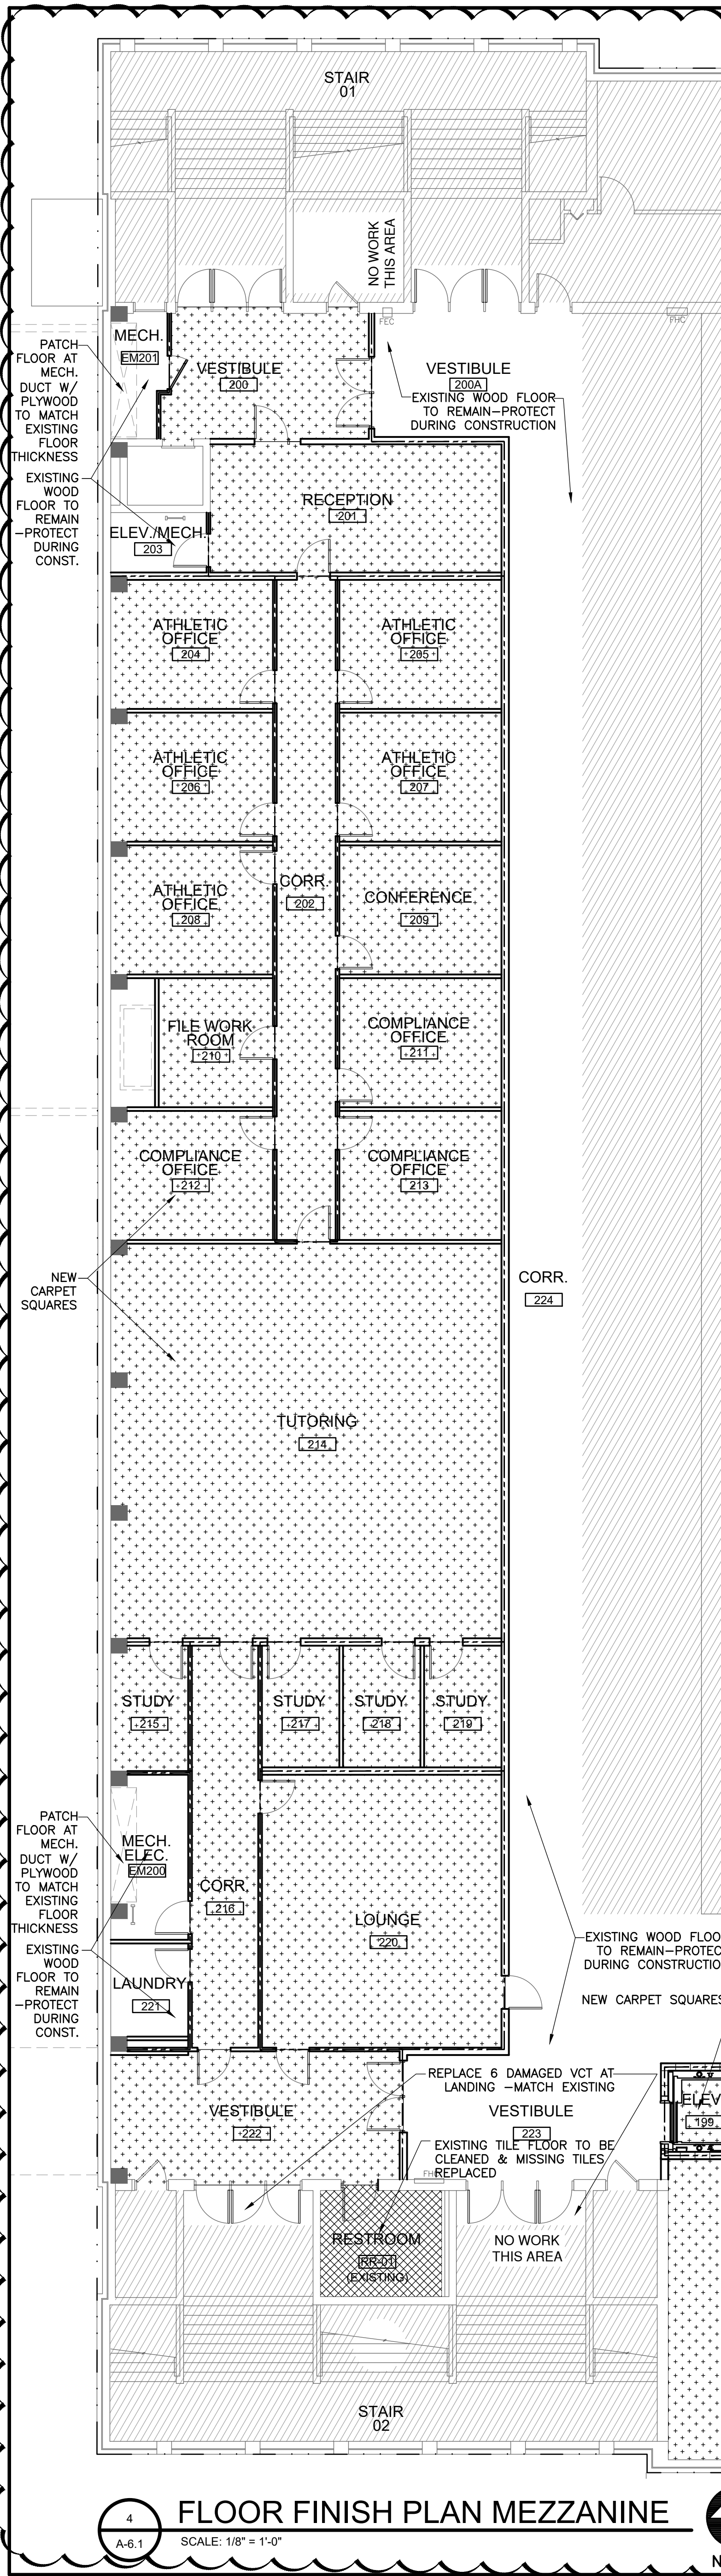


ROOM FINISH SCHEDULE										
ROOM	ROOM NAME	FLOOR	FLOOR BASE	NORTH	EAST WALLS	SOUTH WALLS	WEST WALLS	CEILING FINISH	CEILING HEIGHT	REMARKS
197	SOUTHWEST LOBBY	TERRAZZO	EX CT/NEW CT	CMUP	EXIST	CMUP/GBP	EXIST	ACT #1	MATCH EXST	NEW TERRAZZO TO MATCH EXISTING
198	SOUTHWEST STAIR LOBBY	TERRAZZO	EX CT/NEW CT	EXIST	CMUP/GBP	EXIST	EXIST	ACT #1	MATCH EXST	NEW TERRAZZO TO MATCH EXISTING
199	ELEVATOR	CPT-1	RESILIENT	CMUP	SS + P-LAM	SS + P-LAM	SS + P-LAM	ACT #1	MATCH EXST	
200	VESTIBULE	CPT-1	RESILIENT	CMUP	GBP	CMUP/GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
201	RECEPTION	CPT-1	RESILIENT	CMUP	GBP	CMUP/GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
202	CORRIDOR	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	10'-0"	1-HOUR RATED CEILING LID
203	ELEVATOR / MECHANICAL	EXST WOOD	RESILIENT	EXIST	GBP	GBP	GBP	ACT #1	9'-0"	
204	ATHLETIC OFFICE	CPT-1	RESILIENT	CONC P/GBP	GBP	CONC P/GBP	CMUP	ACT #1	9'-0"	
205	ATHLETIC OFFICE	CPT-1	RESILIENT	CONC P/GBP	GBP	CONC P/GBP	CMUP	ACT #1	9'-0"	
206	ATHLETIC OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
207	ATHLETIC OFFICE	CPT-1	RESILIENT	CONC P/GBP	GBP	CONC P/GBP	CMUP	ACT #1	9'-0"	
208	ATHLETIC OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
209	CONFERENCE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
210	FILE WORK ROOM	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
211	COMPLIANCE OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
212	COMPLIANCE OFFICE	CPT-1	RESILIENT	CONC P/GBP	GBP	CONC P/GBP	CMUP	ACT #1	9'-0"	
213	COMPLIANCE OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
214	TUTORING	CPT-1	RESILIENT	GBP	GBP	GBP	CMUP	ACT #1	11'-0"	
215	STUDY	CPT-1	RESILIENT	CONC P/GBP	GBP	GBP	CMUP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
216	CORRIDOR	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
217	STUDY	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
218	STUDY	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
219	STUDY	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
220	LOUNGE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
221	LAUNDRY	EXST WOOD	RESILIENT	GBP	GBP	CONC P/GBP	CMUP	ACT #2	9'-0"	ALUMINUM CEILING GRID
222	VESTIBULE	CPT-1	RESILIENT	GBP	CMUP/GBP	CMUP	CMUP	ACT #1	9'-0"	2-HOUR RATED CEILING LID
223	VESTIBULE	EXST WOOD	RESILIENT	GBP	CMUP/GBP	CMUP	GBP	OPEN	STRUCT	
224	CORRIDOR	EXST WOOD	RESILIENT	---	---	---	---	OPEN	STRUCT	
250	SPORTS MEDICINE TRAINING AREA	CPT-1	RESILIENT	CONC P/GBP	CMUP/GBP	CMUP	CMUP/GBP	OPEN / ACT #1	STRUCT / 20'-6"	
251	SMED OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
252	SMED OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
253	WORK FILE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
254	STORAGE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
255	SMED GA OFFICE	CPT-1	RESILIENT	GBP	GBP	GBP	GBP	ACT #1	9'-0"	
256	MECHANICAL PLATFORM	PLYWOOD	---	---	---	---	---	OPEN	STRUCT	
RR-01	RESTROOM	EXST CT	EX CT/NEW CT	CT/CMUP	CT/CMUP	EXIST CT/CMUP	EXIST CT/CMUP	ACT #2	7'-5" VERIFY	AL CLG. GRID - MATCH EXISTING CEILING HEIGHT
RR-02	RESTROOM	EXST CT	EX CT/NEW CT	CT/CMUP	EXIST CT/CMUP	EXIST CT/CMUP	CT/CMUP	ACT #2	7'-5" VERIFY	AL CLG. GRID - MATCH EXISTING CEILING HEIGHT
EV-200	MECHANICAL	EX WD/PLYWOOD	RESILIENT	GBP	GBP	GBP	CMUP	OPEN	STRUCT	
EV-201	MECHANICAL ELECTRICAL	EX WD/PLYWOOD	RESILIENT	GBP	GBP	GBP	CMUP	OPEN	STRUCT	

ROOM FINISH NOTES:
1. PROVIDE SCHLUTER THRESHOLD AT ALL DOORS OR DOORWAYS SEPARATING CARPET TILE FLOORING FROM ADJ. EXISTING WOOD FLOORING.

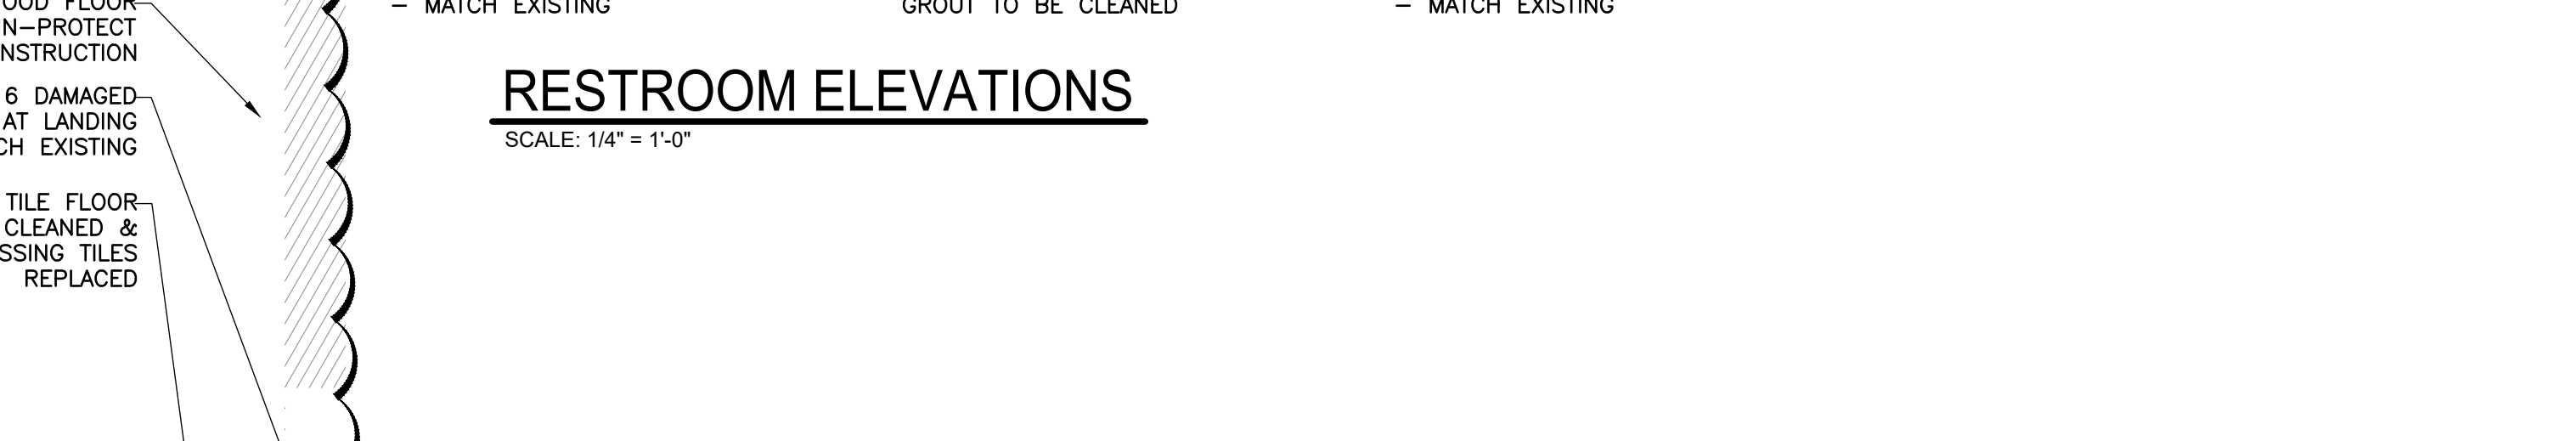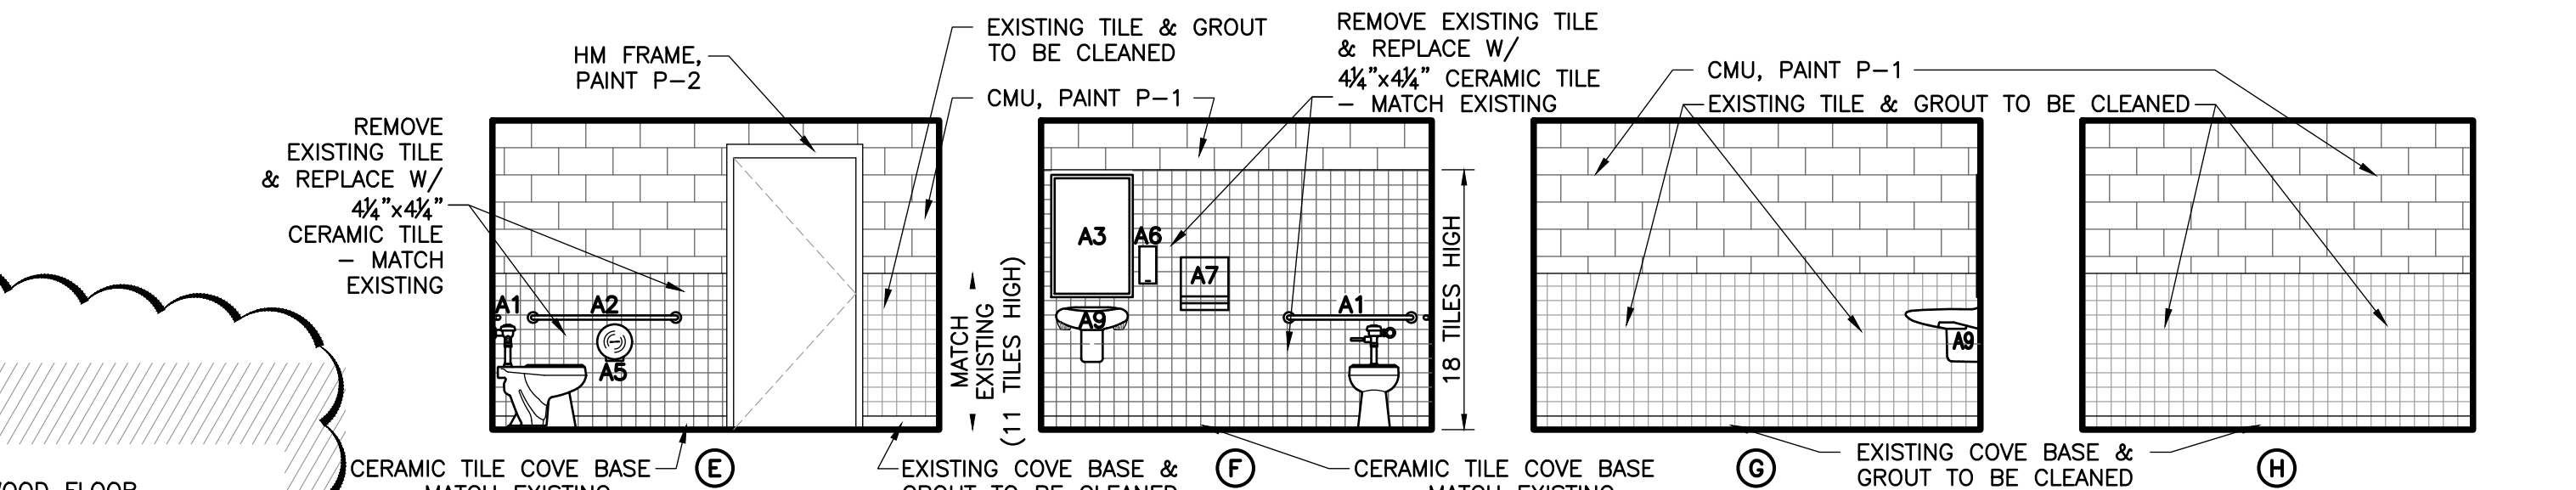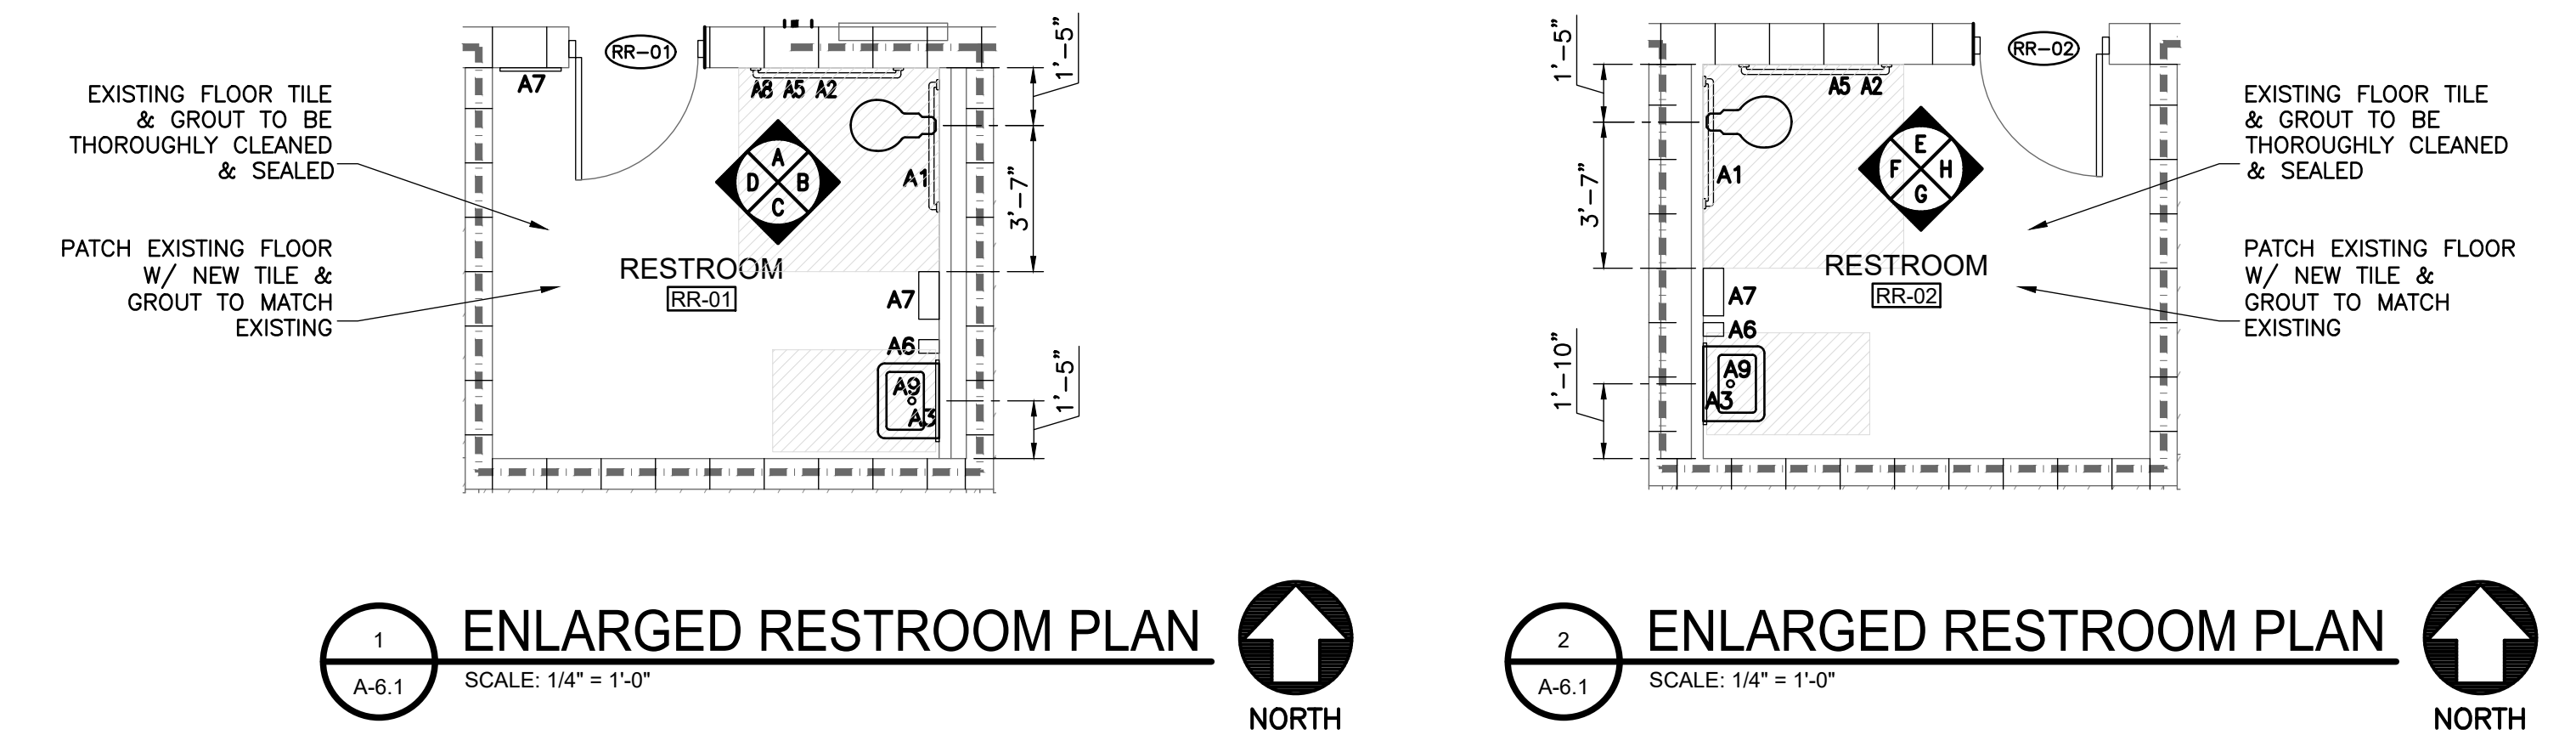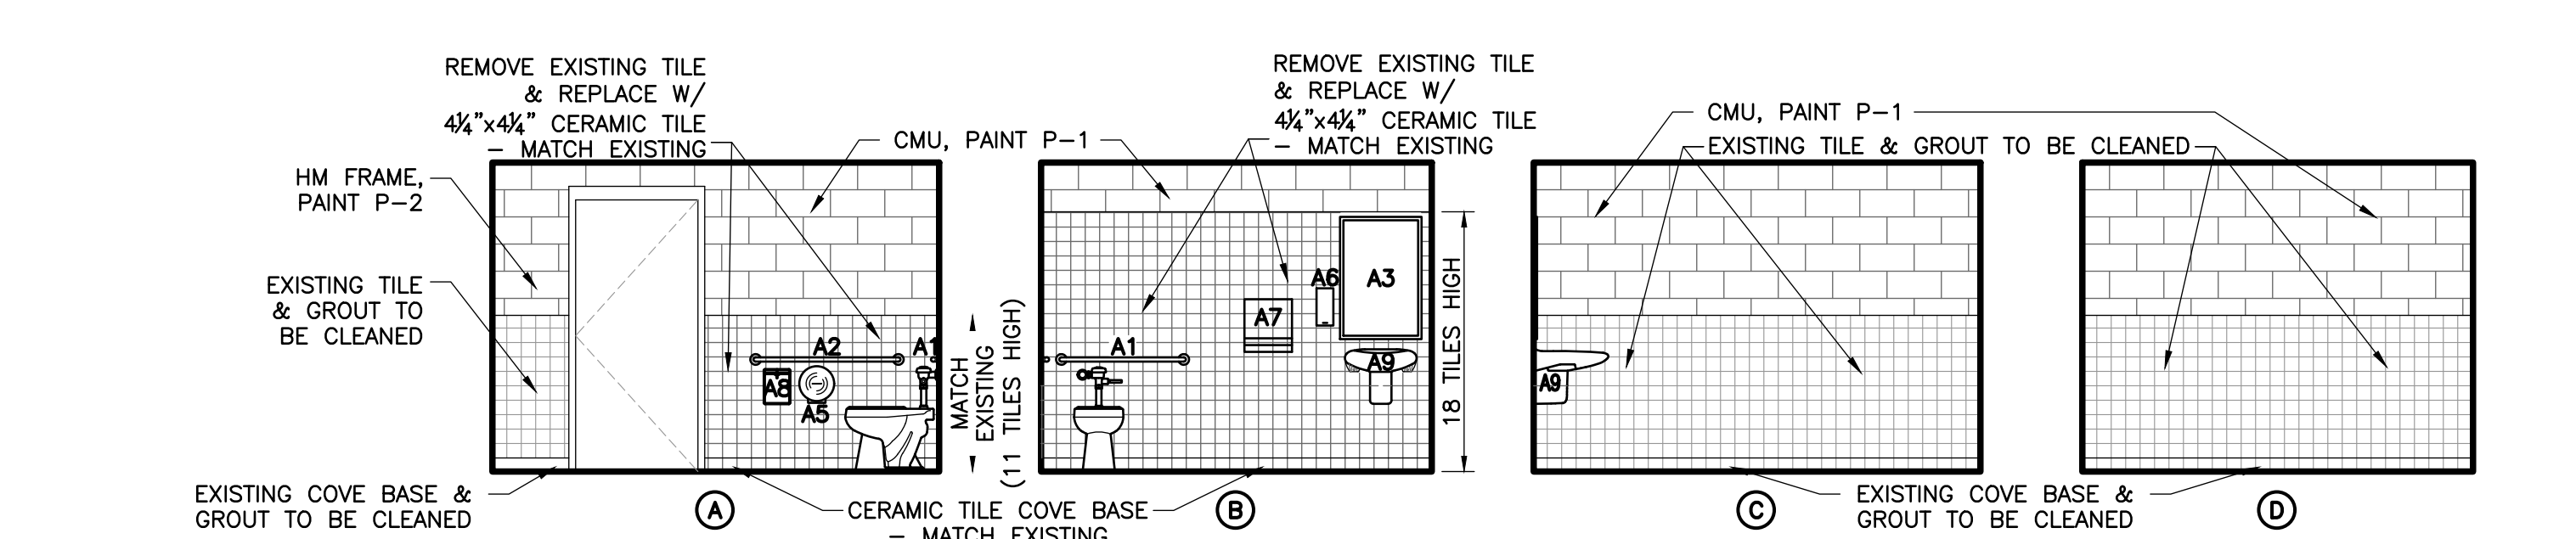

TYPICAL RESTROOM NOTES:
1. PROVIDE SCHLUTER THRESHOLD AT ALL DOORS OR DOORWAYS SEPARATING TILE FLOORING @ RESTROOM FROM ADJ. FLOORING.
2. PROVIDE SCHLUTER THRESHOLD BETWEEN TILE AND VCT FLOORING AT ALCOVE AREA BELOW ALL DRINKING FOUNTAINS.
3. TOILET PAPER, PAPER TOWEL, SANITARY NAPKIN & SOAP DISPENSERS ARE TO BE PROVIDED BY OWNER AND INSTALLED BY CONTRACTOR.
4. SEE SPECS FOR ALL TOILET ACCESSORIES.

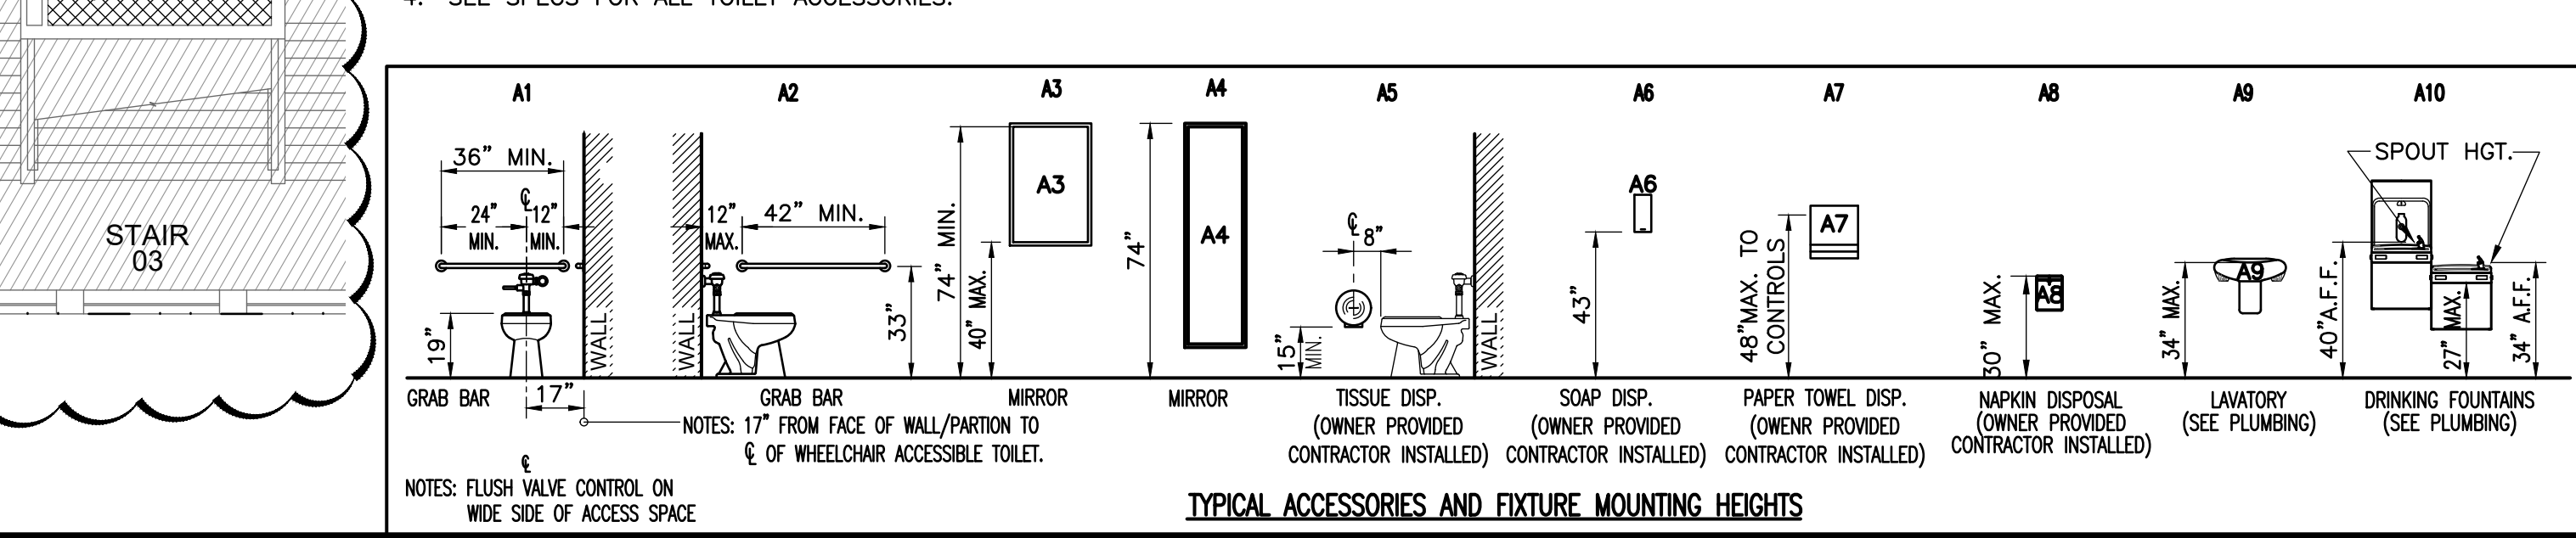

STATE OF ALABAMA
NOLA VANPURSEM
ARCHITECTS, PC
MEMBERS OF THE AMERICAN INSTITUTE OF ARCHITECTS
301 JEFFERSON STREET
HUNTSVILLE, ALABAMA 35890
(256) 535-6617
NVPARCHITECTS.COM

ALABAMA A&M UNIVERSITY
ELMORE SPORTS MEDICINE RENOVATIONS
NORMAL, ALABAMA

JOB NUMBER
20132

ESN / RVP 09.03.20
DRAWN / CHECKED / DATE

REVISIONS
AD 11-23-20

SHEET TITLE
FINISH FLOOR SCHEDULE & ENLARGED RESTROOMS

SHEET NUMBER
A-6.1
OF